


OIL ANALYSIS REPORT

Sample Rating Trend







PHR G3 GOV

Component

Governor System

MOBIL DTE OIL HVY MEDIUM (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#2001 Jan2004 Jul2007 Jan2010 Jul2012 Jan2015 Sep2017 Jan2020						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0445325	WC0455598	WC0316853
Sample Date		Client Info		16 Jan 2023	21 Nov 2022	11 Jan 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>50	2	2	3
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	<1	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	<1
Aluminum	ppm	ASTM D5185(m)	>3	0	<1	<1
Lead	ppm	ASTM D5185(m)	>75	0	0	<1
Copper	ppm	ASTM D5185(m)	>15	0	0	<1
Tin	ppm	ASTM D5185(m)	>55	<1	<1	<1
Antimony	ppm	ASTM D5185(m)	>5	<1	<1	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		<1	<1	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		0	0	<1
Calcium	ppm	ASTM D5185(m)		0	0	<1
Phosphorus	ppm	ASTM D5185(m)		1	1	3
Zinc	ppm	ASTM D5185(m)		3	3	4
Sulfur	ppm	ASTM D5185(m)		1240	1215	1247
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>8	0	0	<1
Sodium	ppm	ASTM D5185(m)		0	0	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	0
FLUID DEGRADA		method	limit/base		history1	
Acid Number (AN)	mg KOH/g	ASTM D974*	- mm/base	current 0.15	0.10	history2 0.12
ACIO INUITIDEI (AIN)	iliy NOD/ÿ	70 LINI D214		0.13	0.10	0.12



OIL ANALYSIS REPORT

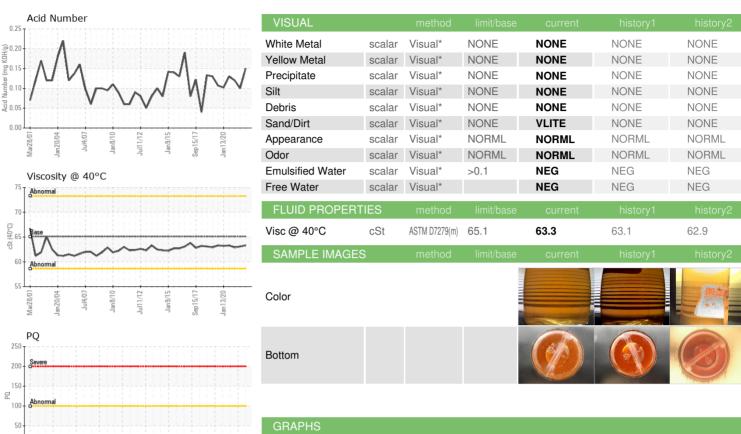

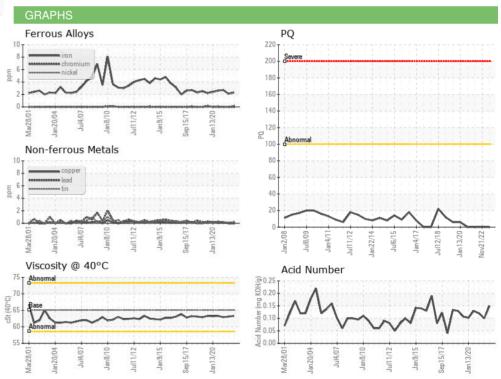



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : 02554185 : 5567200

: WC0445325

Received Diagnosed

: 28 Apr 2023 : Wes Davis Diagnostician

: 28 Apr 2023

Test Package : IND 2 (Additional Tests: TAN Man) To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

NEWFOUNDLAND POWER INC.

50 DUFFY PLACE, PO BOX 8910 ST. JOHNS, NL CA A1B 3P6

Contact: Paul Martin pmartin@newfoundlandpower.com

F: (709)737-2926

T: