


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

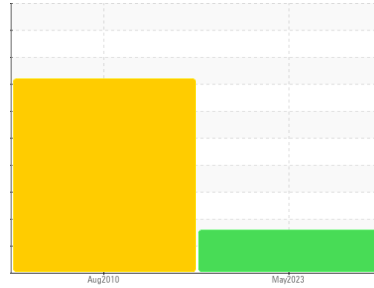

Machine Id
06D03008781 (S/N 06D030308781)

Component
After Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

▲ Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Le fluide n'était pas spécifié, toutefois, une comparaison avec d'autres fluides indiqua que ce fluide est du (GENERIC) DIESEL ENGINE OIL SAE 40. Veuillez confirmer.

Wear

Les taux d'usure de tous les composants sont normaux.

▲ Contamination

Il y a une trace d'humidité dans l'huile. Le test de glycol est négatif.

Fluid Condition

L'état de l'huile est acceptable pour la durée de service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | WA0018758 | DD0001082 | --- |
| Sample Date | Client Info | | | 10 May 2023 | 23 Aug 2010 | --- |
| Machine Age | hrs | Client Info | | 0 | 446 | --- |
| Oil Age | hrs | Client Info | | 0 | 0 | --- |
| Oil Changed | Client Info | | | N/A | Changed | --- |
| Sample Status | | | | MARGINAL | SEVERE | --- |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel | WC Method | | >5 | <1.0 | <1.0 | --- |


| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|---------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185(m) | >200 | 26 | 3 | --- |
| Chromium | ppm | ASTM D5185(m) | >6 | <1 | <1 | --- |
| Nickel | ppm | ASTM D5185(m) | >4 | <1 | 0 | --- |
| Titanium | ppm | ASTM D5185(m) | >2 | <1 | 0 | --- |
| Silver | ppm | ASTM D5185(m) | >2 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185(m) | >30 | 1 | <1 | --- |
| Lead | ppm | ASTM D5185(m) | >30 | 2 | 1 | --- |
| Copper | ppm | ASTM D5185(m) | >30 | 6 | 19 | --- |
| Tin | ppm | ASTM D5185(m) | >10 | 4 | <1 | --- |
| Antimony | ppm | ASTM D5185(m) | | 0 | 3 | --- |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | --- |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|---------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) | 250 | 11 | 15 | --- |
| Barium | ppm | ASTM D5185(m) | 10 | 0 | 0 | --- |
| Molybdenum | ppm | ASTM D5185(m) | 100 | 50 | 49 | --- |
| Manganese | ppm | ASTM D5185(m) | | <1 | <1 | --- |
| Magnesium | ppm | ASTM D5185(m) | 450 | 767 | 7 | --- |
| Calcium | ppm | ASTM D5185(m) | 3000 | 1255 | 1162 | --- |
| Phosphorus | ppm | ASTM D5185(m) | 1150 | 1019 | 455 | --- |
| Zinc | ppm | ASTM D5185(m) | 1350 | 1112 | 592 | --- |
| Sulfur | ppm | ASTM D5185(m) | 4250 | 2635 | 5722 | --- |
| Lithium | ppm | ASTM D5185(m) | | <1 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|-----------------|-----------|----------|
| Silicon | ppm | ASTM D5185(m) | >30 | 9 | 5 | --- |
| Sodium | ppm | ASTM D5185(m) | >216 | 5 | ▲ 386 | --- |
| Potassium | ppm | ASTM D5185(m) | >20 | <1 | ▲ 59 | --- |
| Water | % | ASTM D6304* | >0.2 | ▲ 0.101 | 🔴 4.467 | --- |
| ppm Water | ppm | ASTM D6304* | >2000 | ▲ 1019.1 | 🔴 44670.3 | --- |
| Glycol | % | ASTM D7922* | | 0.0 | 🔴 0.12 | --- |

| INFRA-RED | | method | limit/base | current | history1 | history2 |
|-----------|---------|-------------|------------|-------------|----------|----------|
| Soot % | % | ASTM D7844* | >3 | 0.5 | --- | --- |
| Nitration | Abs/cm | ASTM D7624* | >20 | 6.4 | --- | --- |
| Sulfation | Abs.1mm | ASTM D7415* | >30 | 18.4 | --- | --- |

OIL ANALYSIS REPORT










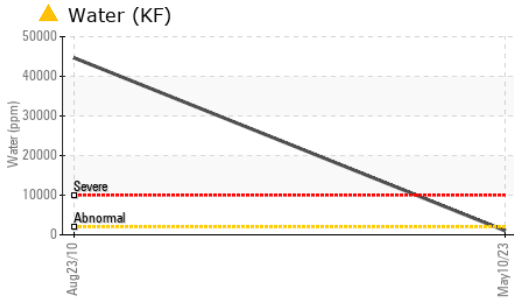


| FLUID DEGRADATION | method | limit/base | current | history1 | history2 |
|-------------------|----------|-------------|---------|-------------|----------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 12.8 | --- |

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|--------------|----------|
| Emulsified Water | scalar | Visual* | >0.2 | ▲ .2% | ▲ .1% |
| Free Water | scalar | Visual* | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|---------------|---------|-------------|----------|
| Visc @ 100°C | cSt | ASTM D7279(m) | 14.4 | 13.1 | 15.9 |

GRAPHS

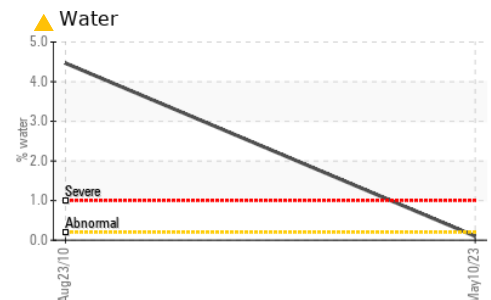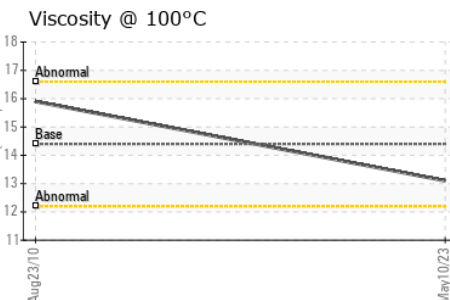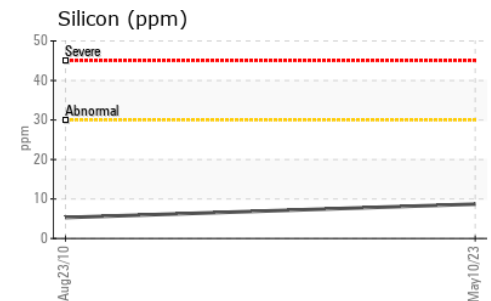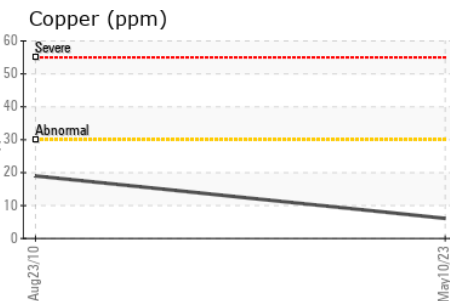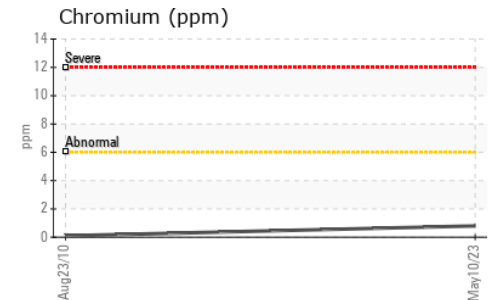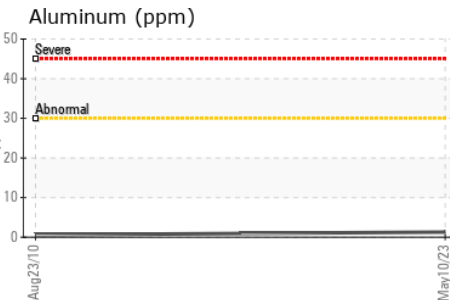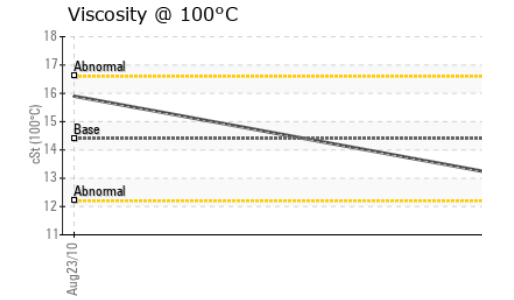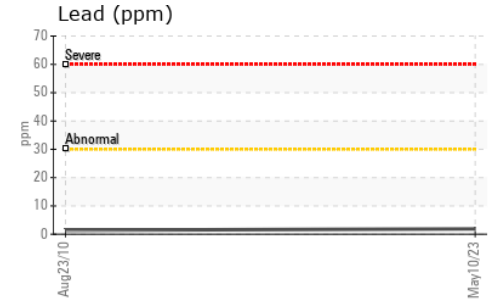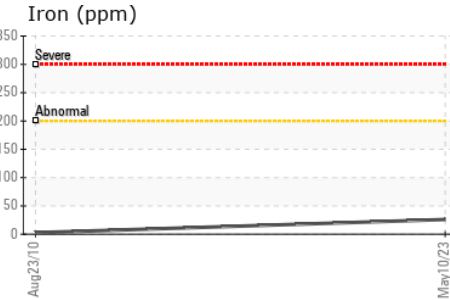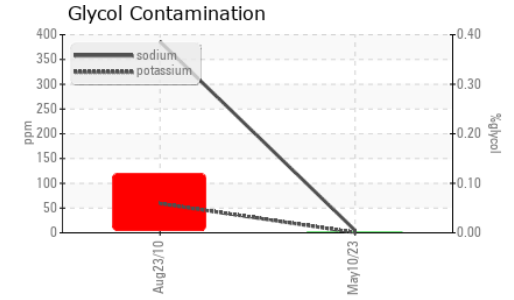

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0018758 **Received** : 11 May 2023
Lab Number : 02556965 **Diagnosed** : 12 May 2023
Unique Number : 5578005 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: KF)

Wajax Power Systems
 2997 AV. WATT
 Quebec, QC
 CA G1X 3W1
 Contact: Steve Racine
 sracine@wajax.com
 T:
 F: (418)651-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.