

# **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL



# Building 21 Dried Grains Storage Machine Id BUCKET ELEVATOR - DRIED GRAINS TRUCK LOADING (S/N 21ELV-GB)

Component

Gearbox

9815 SYNOLEC GEAR LUBE (10 GAL)

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil

## Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		·		May2023	<del></del>	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0582741		
Sample Date		Client Info		08 May 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0		
Iron	ppm	ASTM D5185(m)	>200	16		
Chromium	ppm	ASTM D5185(m)	>15	0		
Nickel	ppm	ASTM D5185(m)	>15	0		
Titanium	ppm	ASTM D5185(m)		<1		
Silver	ppm	ASTM D5185(m)		0		
Aluminum	ppm	ASTM D5185(m)	>25	<1		
Lead	ppm	ASTM D5185(m)	>100	0		
Copper	ppm	ASTM D5185(m)	>200	0		
Tin	ppm	ASTM D5185(m)	>25	0		
Antimony	ppm	ASTM D5185(m)	>5	0		
Vanadium	ppm	ASTM D5185(m)		0		
Beryllium	ppm	ASTM D5185(m)		0		
Cadmium	ppm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		11		
Barium	ppm	ASTM D5185(m)		0		
Molybdenum	ppm	ASTM D5185(m)		0		
Manganese	ppm	ASTM D5185(m)		<1		
Magnesium	ppm	ASTM D5185(m)		<1		
Calcium	ppm	ASTM D5185(m)		0		
Phosphorus	ppm	ASTM D5185(m)		455		
Zinc	ppm	ASTM D5185(m)		12		
Sulfur	ppm	ASTM D5185(m)		5166		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	20		
Sodium	ppm	ASTM D5185(m)		<1		
Potassium	ppm	ASTM D5185(m)	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

0.88

Acid Number (AN) mg KOH/g ASTM D974\*



# **OIL ANALYSIS REPORT**

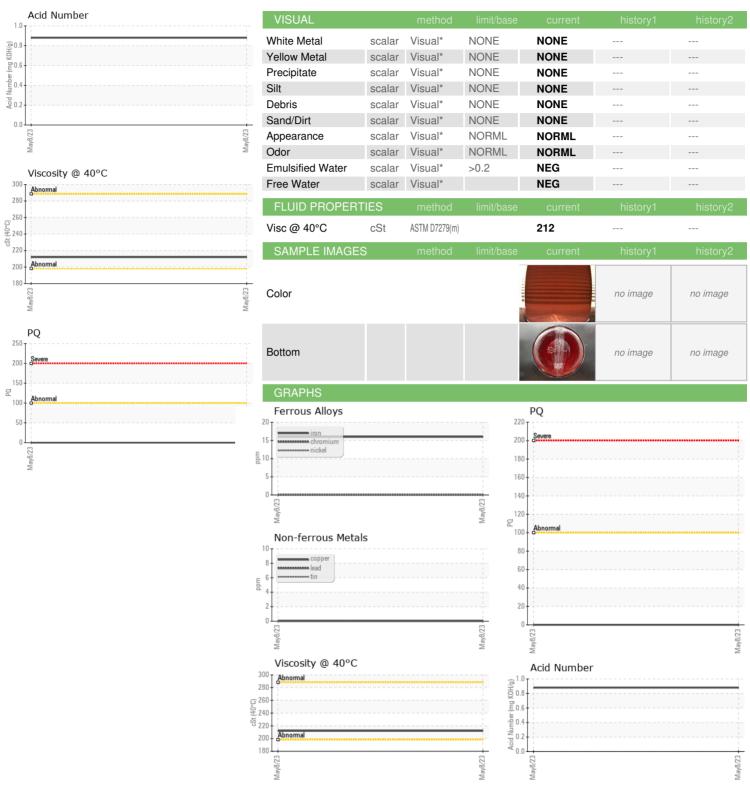



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : WC0582741

: 02557307 : 5578347

Received : 12 May 2023 Diagnosed Diagnostician : Wes Davis

: 12 May 2023 Test Package : IND 2 (Additional Tests: PQ, TAN Man)

HIRAM WALKER & SONS LTD. 2072 RIVERSIDE DRIVE EAST, BOX 2518 WINDSOR, ON

> CA N8Y 4S5 Contact: Matt Morand

> > T: (519)561-5359

F: (519)971-5719

To discuss this sample report, contact Customer Service at 1-800-268-2131. matt.morand@pernod-ricard.com Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.