




# OIL ANALYSIS REPORT

Sample Rating Trend

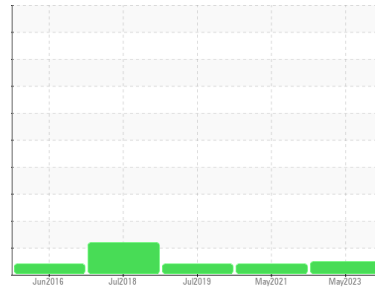

**NORMAL**



Machine Id  
**COMPRESSOR #1 NDE**  
 Component  
**Bearing**  
 Fluid  
**PETRO CANADA COMPRO OIL 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0811974</b>	WC0582089	WC0305224
Sample Date	Client Info			<b>15 May 2023</b>	11 May 2021	11 Jul 2019
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>0</b>	0	<1
Lead	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	1	2
Copper	ppm	ASTM D5185(m)	>20	<b>4</b>	10	15
Tin	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	1	<1
Antimony	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m)		<b>49</b>	50	56
Zinc	ppm	ASTM D5185(m)		<b>2</b>	2	3
Sulfur	ppm	ASTM D5185(m)		<b>1485</b>	1472	1475
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185(m)		<b>1</b>	2	1
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	<1




# OIL ANALYSIS REPORT

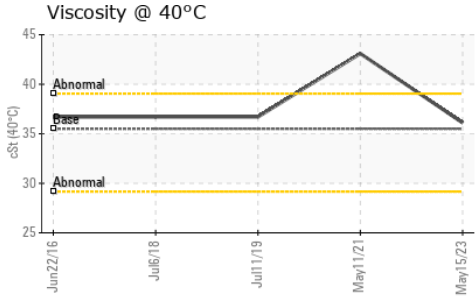




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	VLITE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	35.5	<b>36.1</b>	▲ 43.1	▲ 36.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

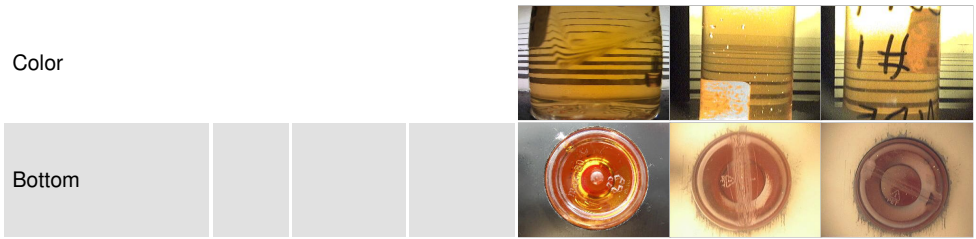

## GRAPHS

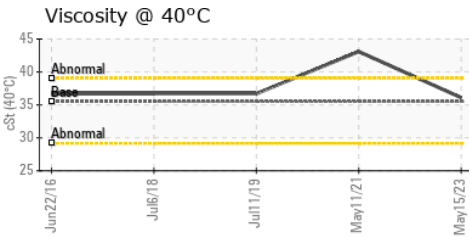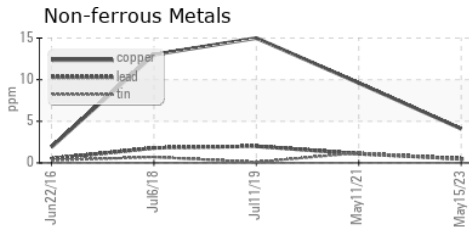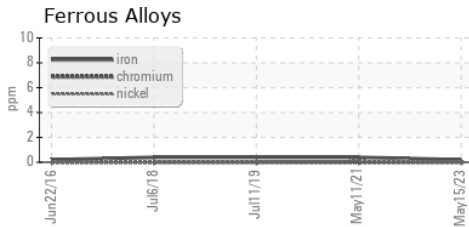

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9    **Wajax - Northpoint Technical Services**  
**Sample No.** : WC0811974    **Received** : 17 May 2023    1108 WebbWood Drive.  
**Lab Number** : **02558098**    **Tested** : 17 May 2023    Sudbury, ON  
**Unique Number** : 5579138    **Diagnosed** : 17 May 2023 - Kevin Marson    CA P3C 3B7  
**Test Package** : IND 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Nick Walker  
 nwalker@northpoints.com  
 T: (705)499-2387  
 F: (795)690-9010