




PROBLEM SUMMARY

Area
MANITOU FALLS GS
 Machine Id
FP2G1
 Component
Turbine Bearing
 Fluid
ESSO TERESSO ISO 46 (--- GAL)

Sample Rating Trend

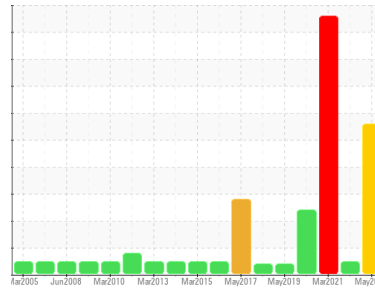


ISO




COMPONENT CONDITION SUMMARY

Particle Trend

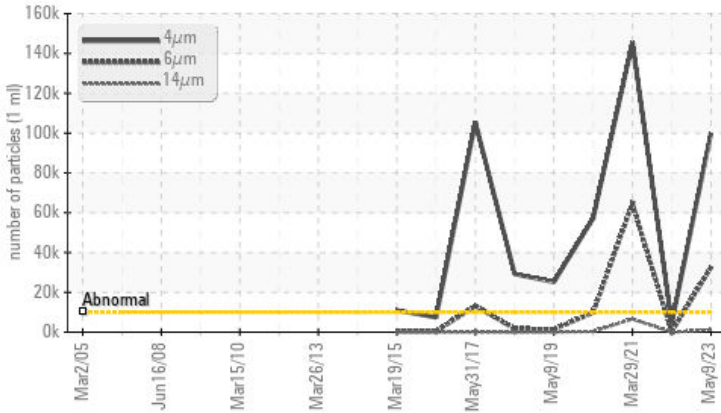

Non-ferrous Metals

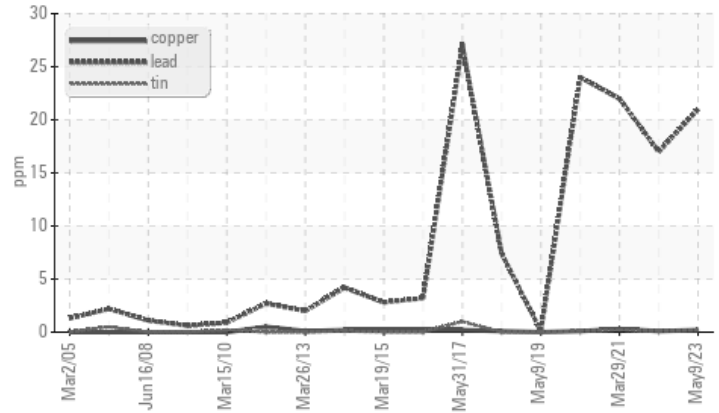

RECOMMENDATION

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	NORMAL	SEVERE
Lead	ppm	ASTM D5185(m) >20	▲ 21	17	▲ 22
Particles >4µm		ASTM D7647 >10000	● 99877	4623	● 145563
Particles >6µm		ASTM D7647 >2500	● 32593	277	● 64479
Particles >14µm		ASTM D7647 >160	▲ 1228	3	● 6630
Particles >21µm		ASTM D7647 >40	▲ 267	1	● 1555
Particles >38µm		ASTM D7647 >10	▲ 17	0	● 90
Oil Cleanliness		ISO 4406 (c) >20/18/14	● 24/22/17	19/15/9	● 24/23/20

Customer Id: ONTKEE
 Sample No.: WC0806461
 Lab Number: 02558994
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where contaminants can enter the system.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

11 Jul 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



29 Mar 2021 Diag: Kevin Marson

ISO



Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) R&O OIL ISO 46. Please confirm. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Lead ppm levels are noted. All other component wear rates are normal. Particles >14µm are severely high. Particles >21µm are severely high. Particles >38µm are severely high. Particles >6µm are severely high. Particles >4µm are severely high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Jul 2020 Diag: Kevin Marson

WEAR



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Lead ppm levels are abnormal. Bearing wear is indicated. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Particles >14µm are notably high. Particles >21µm are notably high. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

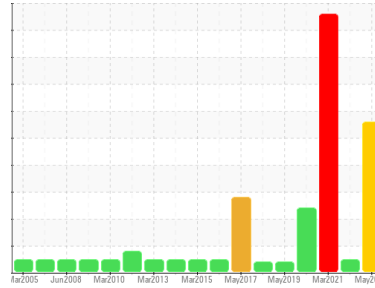

ISO



Area
MANITOU FALLS GS
Machine Id
FP2G1
Component
Turbine Bearing
Fluid
ESSO TERESSO ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Lead ppm levels are abnormal. Bearing wear is indicated.

Contamination

There is a high amount of particulates (2 to 100 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0806461	WC0686276	WC0560630
Sample Date	Client Info		09 May 2023	11 Jul 2022	29 Mar 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m) >20	4	2	3
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	<1
Aluminum	ppm	ASTM D5185(m) >20	<1	<1	<1
Lead	ppm	ASTM D5185(m) >20	▲ 21	17	▲ 22
Copper	ppm	ASTM D5185(m) >20	<1	<1	<1
Tin	ppm	ASTM D5185(m) >20	<1	<1	<1
Antimony	ppm	ASTM D5185(m)	<1	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES






	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	0	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m) 0	<1	0	<1
Calcium	ppm	ASTM D5185(m) 0	0	<1	1
Phosphorus	ppm	ASTM D5185(m) 2.4	0	1	2
Zinc	ppm	ASTM D5185(m) 0	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	1730	1657	1694
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	3	2	3
Sodium	ppm	ASTM D5185(m)	0	0	<1
Potassium	ppm	ASTM D5185(m) >20	0	<1	<1



OIL ANALYSIS REPORT

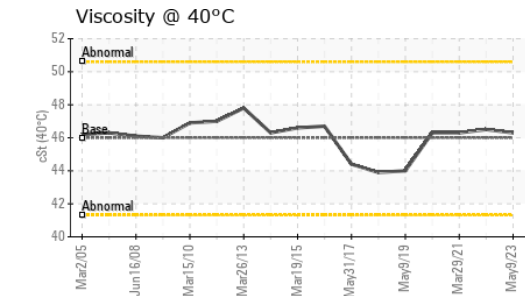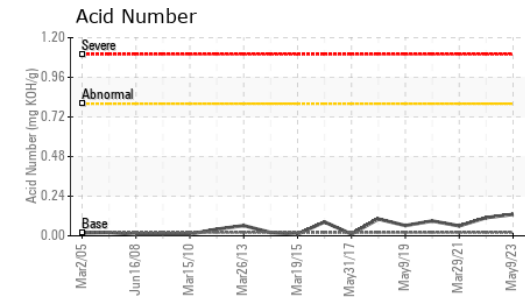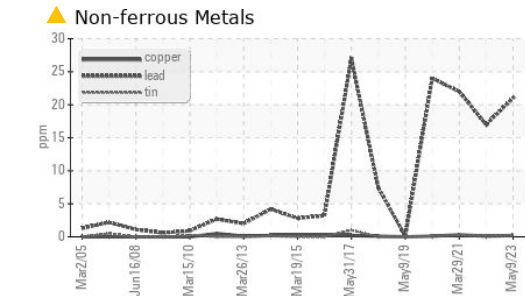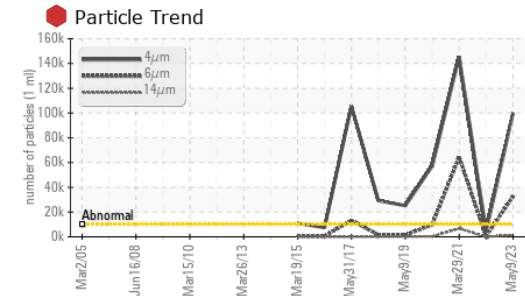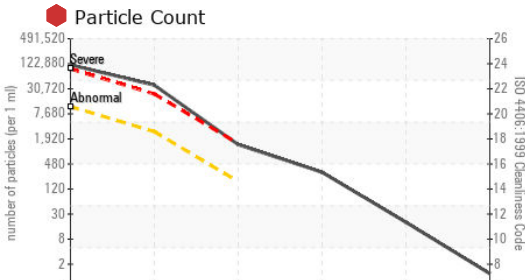

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0806461 **Received** : 23 May 2023
Lab Number : 02558994 **Diagnosed** : 24 May 2023
Unique Number : 5580034 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PrtCount, TAN Man)

Ontario Power Generation
 KENORA PRODUCTION CENTRE, 200-60 FOURTEENTH ST. N.
 KENORA, ON
 CA P9N 4M9
 Contact: Josh Robinson
 josh.robinson@opg.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	99877	4623	145563
Particles >6µm	ASTM D7647	>2500	32593	277	64479
Particles >14µm	ASTM D7647	>160	1228	3	6630
Particles >21µm	ASTM D7647	>40	267	1	1555
Particles >38µm	ASTM D7647	>10	17	0	90
Particles >71µm	ASTM D7647	>3	1	0	5
Oil Cleanliness	ISO 4406 (c)	>20/18/14	24/22/17	19/15/9	24/23/20

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.02	0.13	0.11	0.06

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar Visual*	NONE	LIGHT	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>2	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	46	46.3	46.5	46.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

