




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**LSGS DAM**  
 Machine Id  
**SLUICE GATE 1**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA ENDURATEX EP 320 (40 LTR)**

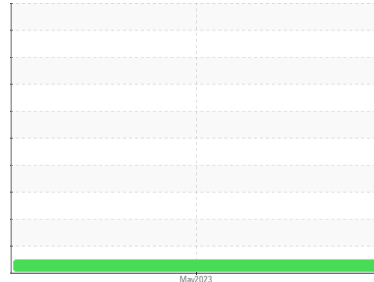

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0801016</b>	---	---
Sample Date	Client Info		<b>18 May 2023</b>	---	---
Machine Age	yrs	Client Info	<b>25</b>	---	---
Oil Age	yrs	Client Info	<b>2</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >200	<b>2</b>	---	---
Chromium	ppm	ASTM D5185(m) >15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185(m) >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m) >200	<b>0</b>	---	---
Tin	ppm	ASTM D5185(m) >25	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m) >5	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 55	<b>14</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>1</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>8</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 240	<b>449</b>	---	---
Zinc	ppm	ASTM D5185(m) 1	<b>8</b>	---	---
Sulfur	ppm	ASTM D5185(m) 13700	<b>5000</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.4	<b>1.03</b>	---	---



# OIL ANALYSIS REPORT

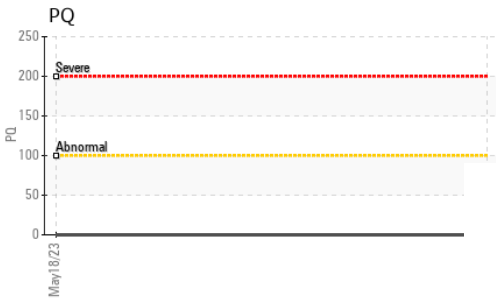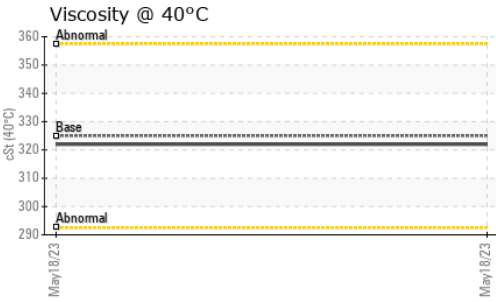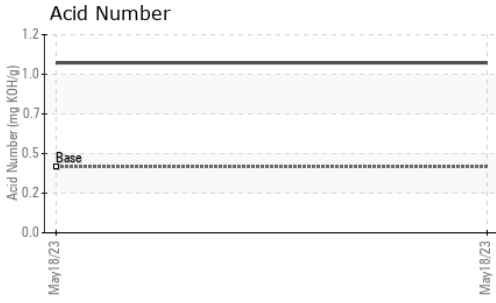

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---






FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	325	<b>322</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

**Color**

	no image	no image	
<b>Bottom</b>		no image	no image

## GRAPHS

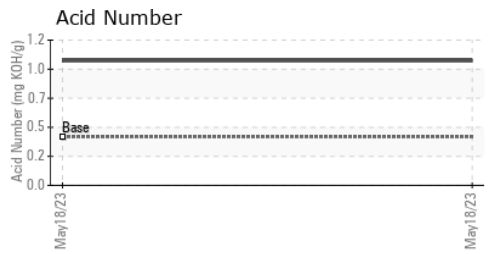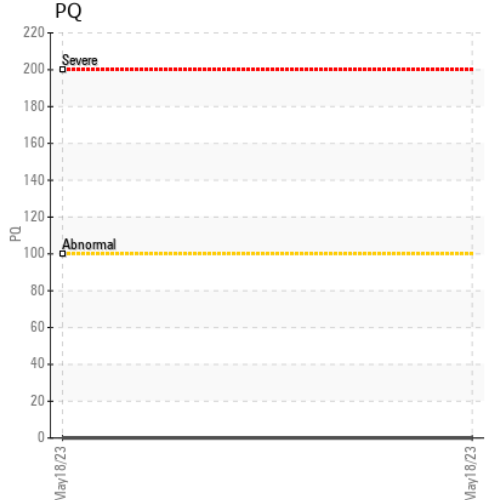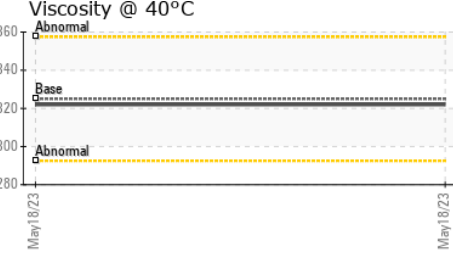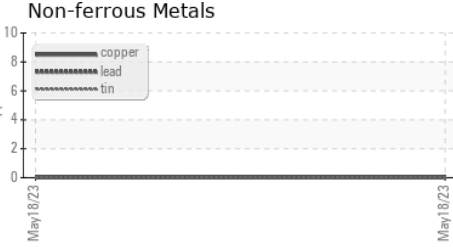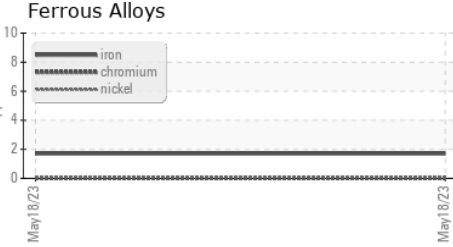

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0801016 **Received** : 29 May 2023  
**Lab Number** : 02560359 **Diagnosed** : 30 May 2023  
**Unique Number** : 5581399 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**PETERBOROUGH UTILITIES INC**  
 1867 ASHBURNHAM DRIVE  
 PETERBOROUGH, ON  
 CA K9L 1P8  
 Contact: Nelson Ross  
 nross@pui.ca  
 T: (705)760-6119  
 F: (705)748-3138

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.