




PROBLEM SUMMARY


Area
Wide Cold Mill/Pickline Line
 Machine Id
#4 SHEAR HYD (WCM029) (S/N 100005075)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 46 (500 GAL)

Sample Rating Trend

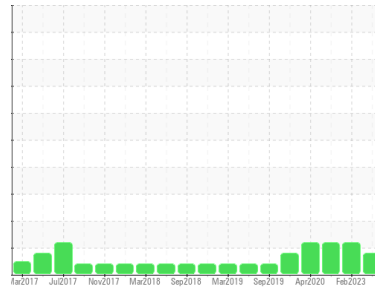

COMPONENT CONDITION SUMMARY

▲ Particle Trend

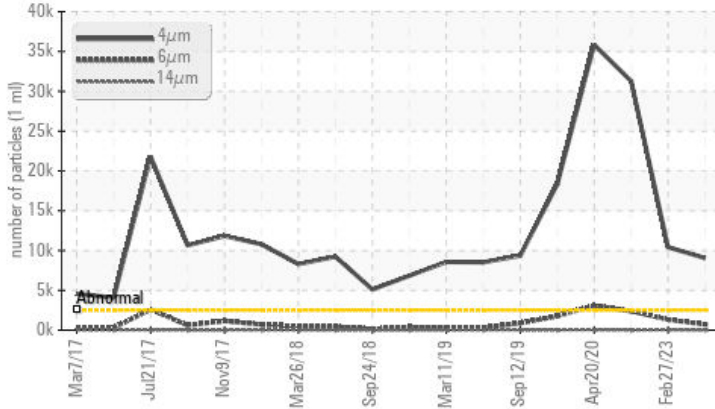

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ABNORMAL	SEVERE
Particles >4µm	ASTM D7647 >2500	▲ 9048	▲ 10427	● 31288
Oil Cleanliness	ISO 4406 (c) >18/17/14	▲ 20/17/11	▲ 21/18/13	● 22/18/12

Customer Id: ALGSSM
 Sample No.: WC0752134
 Lab Number: 02561753
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

27 Feb 2023 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Particles >4µm and oil cleanliness are abnormally high. Particles >6µm are notably high. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



18 Jun 2020 Diag: Wes Davis

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Particles >4µm are severely high. Particles >6µm are notably high. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



20 Apr 2020 Diag: Wes Davis

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Particles >4µm are severely high. Particles >6µm are abnormally high. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

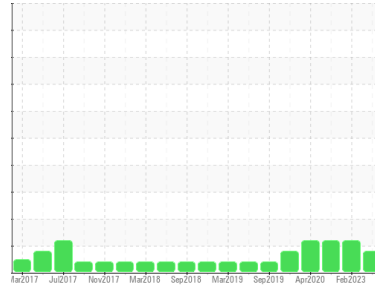

ISO



Area
Wide Cold Mill/Pickline Line
 Machine Id
#4 SHEAR HYD (WCM029) (S/N 100005075)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 46 (500 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0752134	WC0752150	WC0419743
Sample Date	Client Info		04 Jun 2023	27 Feb 2023	18 Jun 2020
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<1	<1
Chromium	ppm	ASTM D5185(m)	>20	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	<1
Titanium	ppm	ASTM D5185(m)		0	<1
Silver	ppm	ASTM D5185(m)		0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1
Lead	ppm	ASTM D5185(m)	>20	0	0
Copper	ppm	ASTM D5185(m)	>20	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0
Antimony	ppm	ASTM D5185(m)		0	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	0	<1
Barium	ppm	ASTM D5185(m)	5	0	0
Molybdenum	ppm	ASTM D5185(m)	5	0	0
Manganese	ppm	ASTM D5185(m)		0	0
Magnesium	ppm	ASTM D5185(m)	25	2	<1
Calcium	ppm	ASTM D5185(m)	200	62	61
Phosphorus	ppm	ASTM D5185(m)	300	284	284
Zinc	ppm	ASTM D5185(m)	370	315	312
Sulfur	ppm	ASTM D5185(m)	2500	746	742
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	<1
Sodium	ppm	ASTM D5185(m)		0	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 9048	▲ 10427	● 31288
Particles >6µm	ASTM D7647	>1300	703	▲ 1321	▲ 2378
Particles >14µm	ASTM D7647	>160	14	49	22
Particles >21µm	ASTM D7647	>40	4	14	6
Particles >38µm	ASTM D7647	>10	1	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>18/17/14	▲ 20/17/11	▲ 21/18/13	● 22/18/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.57	0.29	0.32
					0.25




OIL ANALYSIS REPORT


Particle Trend

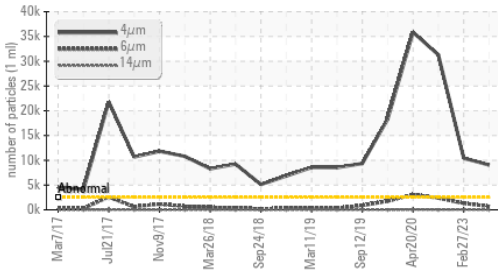


Particle Trend

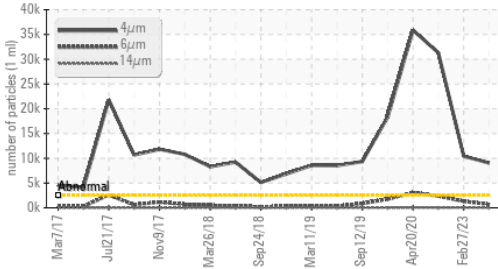

Acid Number

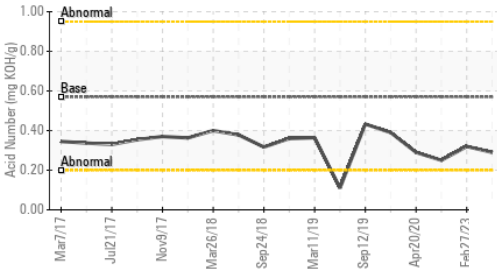


Viscosity @ 40°C

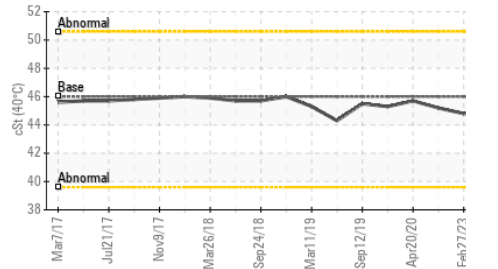

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	44.8	45.2

SAMPLE IMAGES

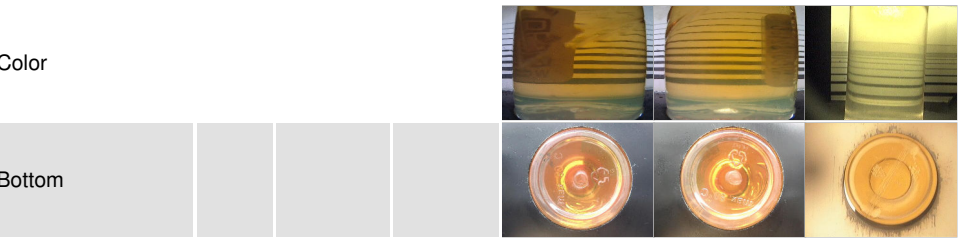


GRAPHS


Ferrous Alloys

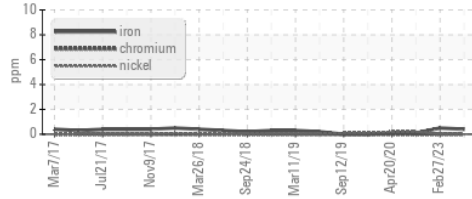


Non-ferrous Metals

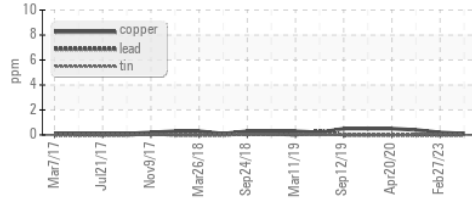


Viscosity @ 40°C

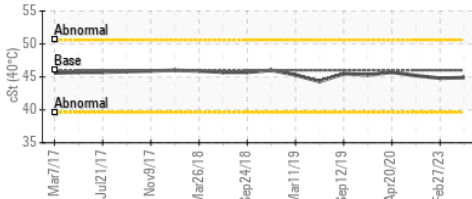

Particle Count

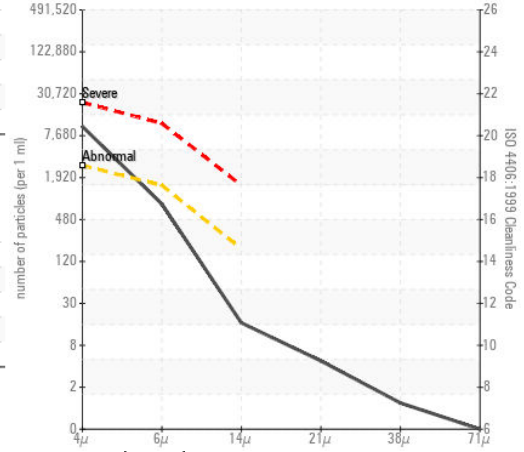

Acid Number

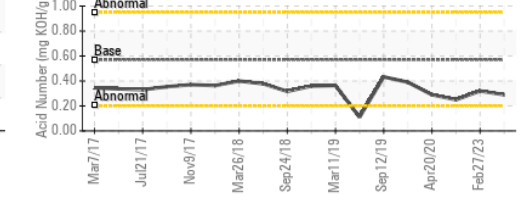

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **ALGOMA STEEL INC. - STORES DEPT.**
Sample No. : WC0752134 **Received** : 05 Jun 2023 301 WALLACE TERRACE
Lab Number : 02561753 **Diagnosed** : 06 Jun 2023 SAULT STE MARIE, ON
Unique Number : 5590794 **Diagnostician** : Wes Davis CA P6C 1K8
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Algoma Reliability
 algomareliability@algoma.com
 T: (705)206-1059
 F: (705)945-3585