


OIL ANALYSIS REPORT

SST1 CAT ARM (S/N L0111-1)

Component Transformer Oil

ESSO VOLTESSO 35 (1848 LTR)





E330 VOLTE330 33 (1040 LTN)				Aug2020	Sep.2022		
DIAGNOSIS	SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Recommendation	Sample Number		Client Info		WC0645951	WC0475716	
Resample at the next service interval to monitor.	Sample Date		Client Info		23 Sep 2022	19 Aug 2020	
Wear	Machine Age	hrs	Client Info		0	0	
{not applicable}	Oil Age	hrs	Client Info		0	0	
Contamination	Oil Changed		Client Info		N/A	N/A	
The system cleanliness is acceptable for your target	Sample Status				NORMAL	NORMAL	
ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is	CONTAMINANTS		method	limit/base	current	history1	history2
acceptable.	Water	%	ASTM D6304*	>0.0035	0.002	0.002	
Fluid Condition	ppm Water	ppm	ASTM D6304*	>35	16.4	0	
The AN level is acceptable for this fluid. The condition of the transformer oil is suitable for further	FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
service.	Particles >4µm		ASTM D7647	>5000	1024	3596	
	Particles >6µm		ASTM D7647	>1300	271	827	
	Particles >14µm		ASTM D7647	>160	34	92	
	Particles >21µm		ASTM D7647	>40	14	27	
	Particles >38µm		ASTM D7647	>10	2	2	
	Particles >71µm		ASTM D7647	>3	0	0	
	Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/12	19/17/14	
	FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	Acid Number (AN)	mg KOH/g	ASTM D974*	0.01	0.01	0.02	
	VISUAL		method	limit/base	current	history1	history2
	White Metal	scalar	Visual*	NONE	NONE	NONE	
	Yellow Metal	scalar	Visual*	NONE	NONE	NONE	
	Precipitate	scalar	Visual*	NONE	NONE	NONE	
	Silt	scalar	Visual*	NONE	NONE	NONE	
	Debris	scalar	Visual*	NONE	NONE	NONE	
	Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	
	Appearance	scalar	Visual*	NORML	NORML	NORML	
	Odor	scalar	Visual*	NORML	NORML	NORML	
	FLUID PROPERTI	IES	method	limit/base	current	history1	history2
	Specific Gravity		ASTM D4052(e)	.877	0.863	0.858	
	Dielectric Breakdown	kV	ASTM D3612(e)*		40	47	
	Interfacial Tension	mN/m	ASTM D971(e)*		34.78	36.09	
	ASTM Color	scalar	ASTM D1500(e)	0.5	L1.0	>0.5	
	SAMPLE IMAGES		method	limit/base	current	history1	history2

Color


Bottom

no image

no image



OIL ANALYSIS REPORT

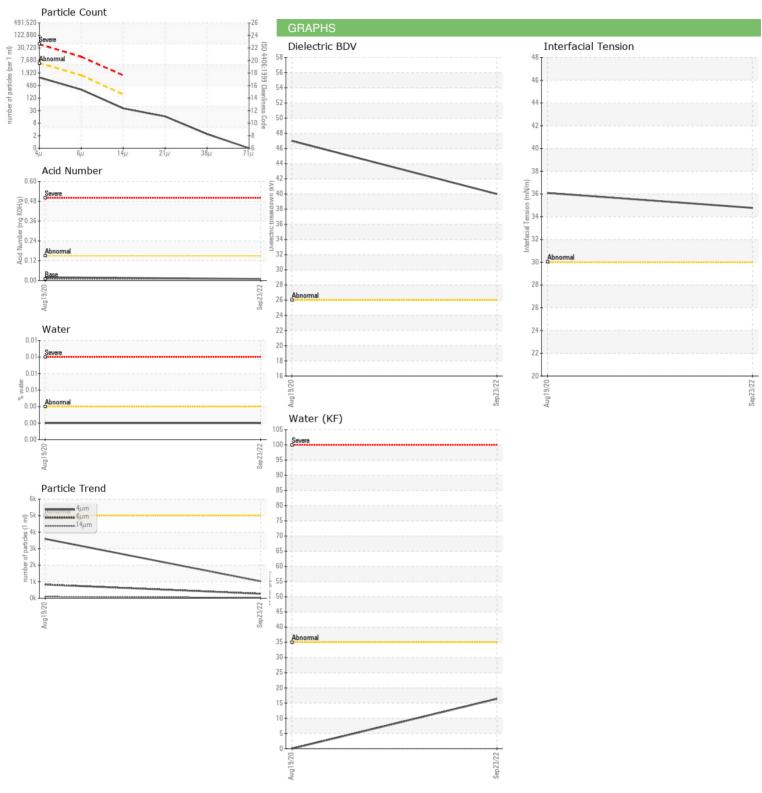



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number Unique Number : 5591048

: WC0645951 : 02562007

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 NEWFOUNDLAND & LABRADOR HYDRO Received : 05 Jun 2023 Diagnosed

: 21 Jul 2023 Diagnostician : Bill Quesnel Test Package : TRF 1 (Additional Tests: PrtCount)

BAY D'ESPOIR WHSE,, 1 CAMP BOGGY RD., PO BOX 100 MILLTOWN, BAY D'ESPOIR, NL CA A0H 1W0

Contact: Matthew Lambert matthewlambert@nlh.nl.ca T: (709)882-3126

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied. F: (709)882-3161