




OIL ANALYSIS REPORT

Sample Rating Trend

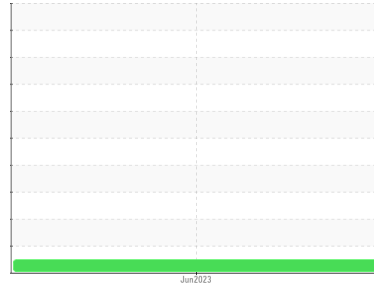

NORMAL



Machine Id
BLOWER #1
 Component
Roller Bearing
 Fluid
HYPERSYN 150 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
--------------------	--	--------	------------	---------	-----------	-----------

Sample Number	Client Info			WC0820470	---	---
Sample Date	Client Info			18 Jun 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

WEAR METALS		method	limit/base	current	history 1	history 2
-------------	--	--------	------------	---------	-----------	-----------

PQ		ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m)	>20	2	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>20	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)		0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>20	0	---	---
Copper	ppm	ASTM D5185(m)	>20	0	---	---
Tin	ppm	ASTM D5185(m)	>20	0	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES		method	limit/base	current	history 1	history 2
-----------	--	--------	------------	---------	-----------	-----------

Boron	ppm	ASTM D5185(m)		2	---	---
Barium	ppm	ASTM D5185(m)		0	---	---
Molybdenum	ppm	ASTM D5185(m)		0	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		0	---	---
Calcium	ppm	ASTM D5185(m)		3	---	---
Phosphorus	ppm	ASTM D5185(m)		670	---	---
Zinc	ppm	ASTM D5185(m)		2	---	---
Sulfur	ppm	ASTM D5185(m)		1681	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
--------------	--	--------	------------	---------	-----------	-----------




Silicon	ppm	ASTM D5185(m)	>15	0	---	---
Sodium	ppm	ASTM D5185(m)		0	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---

FLUID DEGRADATION		method	limit/base	current	history 1	history 2
-------------------	--	--------	------------	---------	-----------	-----------

Acid Number (AN)	mg KOH/g	ASTM D974*		0.34	---	---
------------------	----------	------------	--	-------------	-----	-----



OIL ANALYSIS REPORT

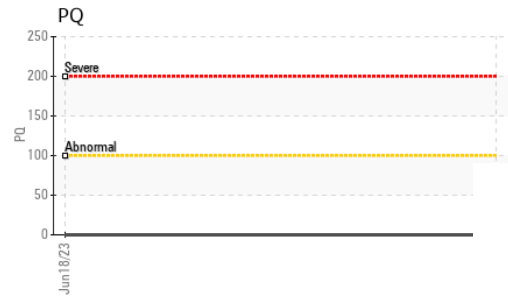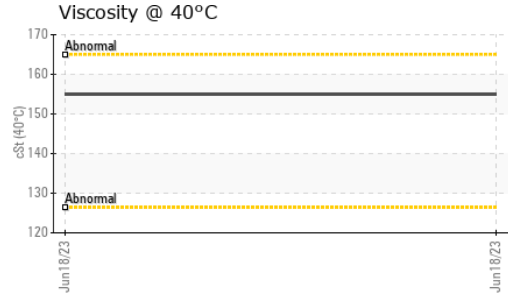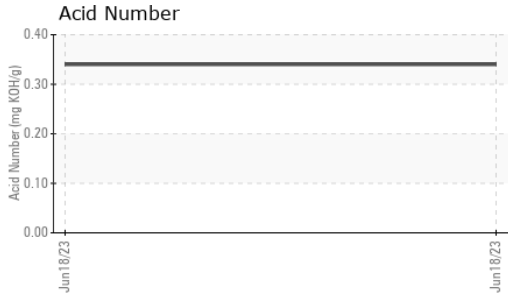







VISUAL	method	limit/base	current	history 1	history 2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history 1	history 2
Visc @ 40°C	cSt	ASTM D7279(m)	155	---	---

SAMPLE IMAGES	method	limit/base	current	history 1	history 2
---------------	--------	------------	---------	-----------	-----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

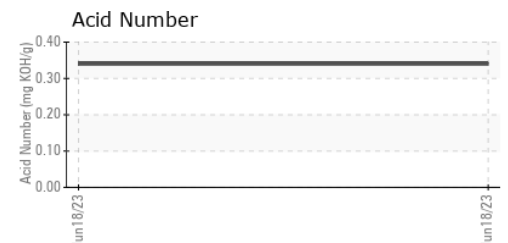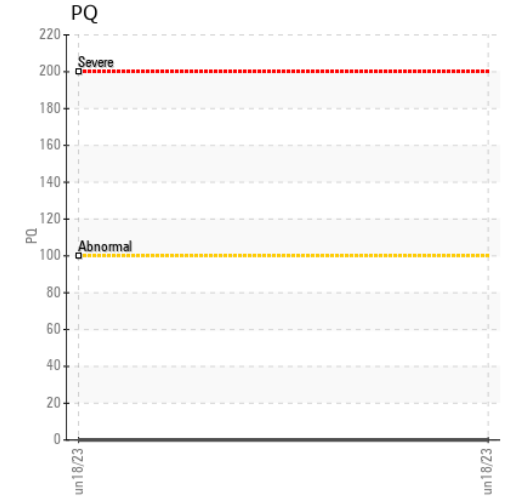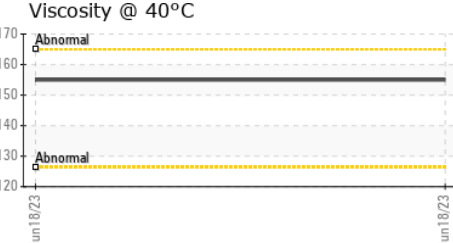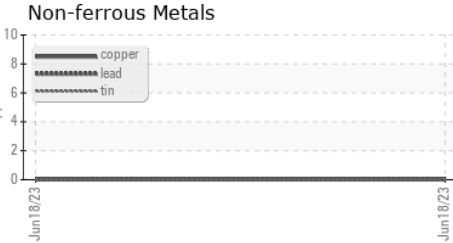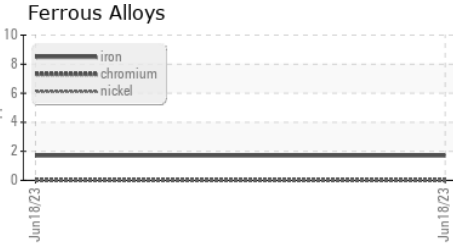

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Hexion Canada Inc. - EDMONTON PLANT
Sample No. : WC0820470 **Received** : 19 Jun 2023 12621 - 156th Street NW
Lab Number : 02564985 **Diagnosed** : 19 Jun 2023 Edmonton, AB
Unique Number : 5594026 **Diagnostician** : Kevin Marson CA T5V 1E1
Test Package : IND 2 (Additional Tests: TAN Man) Contact: Justin Woodward
justin.woodward@hexion.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (780)447-8469
 F: