




# OIL ANALYSIS REPORT

Sample Rating Trend

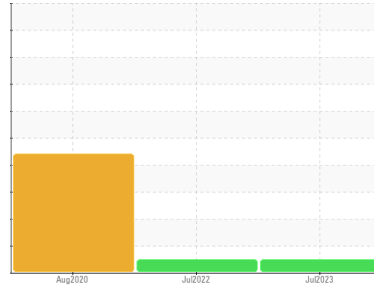

**NORMAL**



Machine Id  
**KOHLER M0671**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0764048</b>	WC0709822	WC0442692
Sample Date	Client Info		<b>17 Jul 2023</b>	20 Jul 2022	13 Aug 2020
Machine Age	hrs	Client Info	<b>33</b>	23	13
Oil Age	hrs	Client Info	<b>16</b>	5	13
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	0.0

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	<b>7</b>	7	7
Chromium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185(m) >4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185(m) >3	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185(m) >20	<b>1</b>	1	1
Lead	ppm	ASTM D5185(m) >40	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185(m) >330	<b>2</b>	3	3
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 250	<b>112</b>	106	137
Barium	ppm	ASTM D5185(m) 10	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185(m) 100	<b>&lt;1</b>	<1	<1
Manganese	ppm	ASTM D5185(m)	<b>2</b>	2	2
Magnesium	ppm	ASTM D5185(m) 450	<b>544</b>	537	673
Calcium	ppm	ASTM D5185(m) 3000	<b>1425</b>	1478	1323
Phosphorus	ppm	ASTM D5185(m) 1150	<b>939</b>	887	1012
Zinc	ppm	ASTM D5185(m) 1350	<b>1052</b>	1044	1134
Sulfur	ppm	ASTM D5185(m) 4250	<b>3394</b>	3468	3642
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>12</b>	11	13
Sodium	ppm	ASTM D5185(m) >158	<b>6</b>	5	4
Potassium	ppm	ASTM D5185(m) >20	<b>4</b>	3	3

## INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624* >20	<b>6.5</b>	6.2	6.1
Sulfation	Abs/.1mm	ASTM D7415* >30	<b>19.8</b>	18.1	18.5

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414* >25	<b>14.2</b>	13.0	12.9











# OIL ANALYSIS REPORT

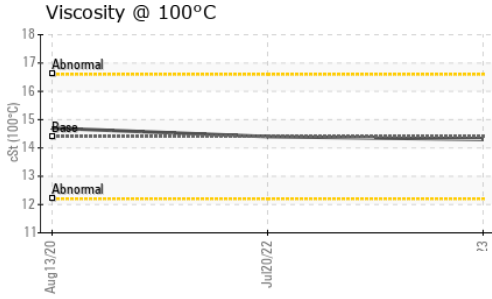

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG ▲ .2%
Free Water	scalar	Visual*		NEG	NEG ▲ .2%

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>14.3</b>	14.4 14.7

## GRAPHS

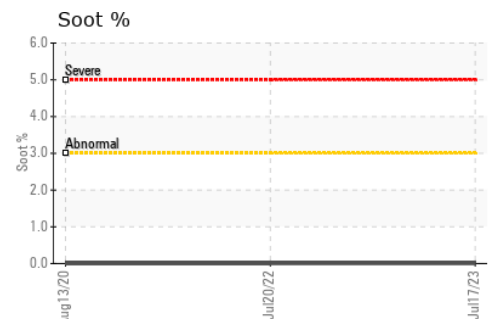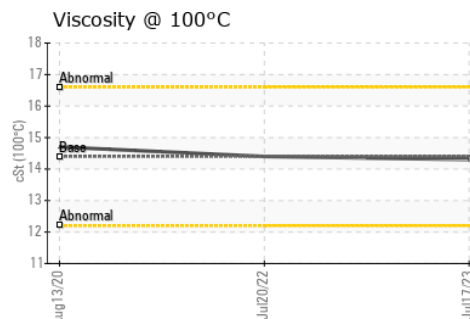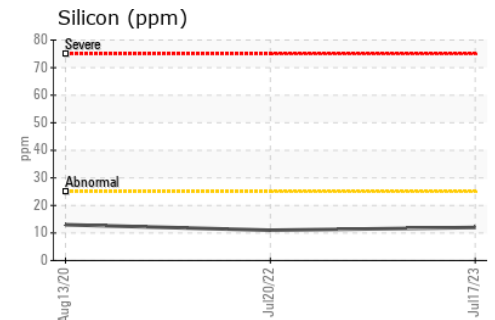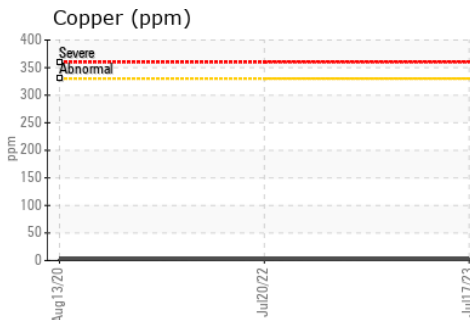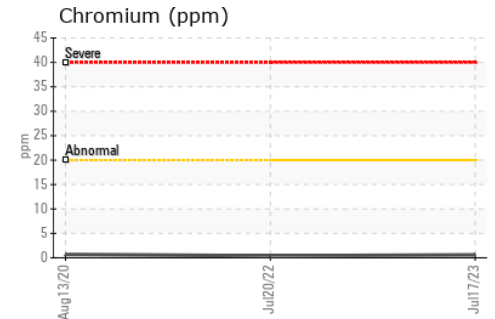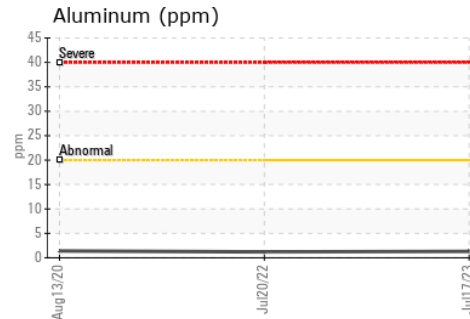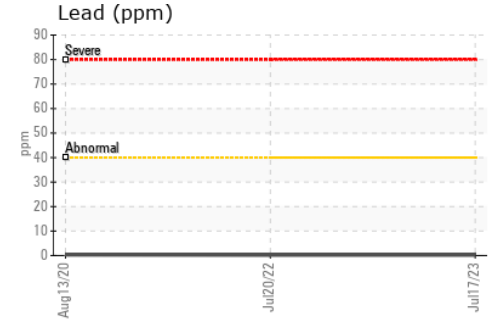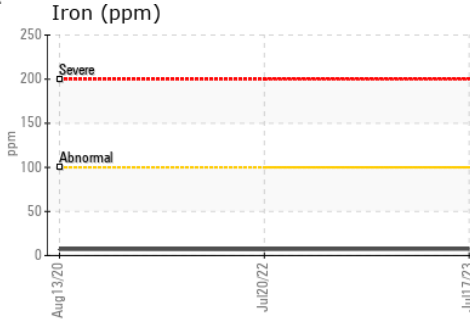

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0764048 **Received** : 10 Aug 2023  
**Lab Number** : 02575058 **Diagnosed** : 10 Aug 2023  
**Unique Number** : 5620109 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

**GENCARE SERVICES LTD.**  
 360 SOVEREIGN ROAD  
 LONDON, ON  
 CA N6M 1A8  
 Contact: Teresa Matthews  
 tmatthews@gencare.com  
 T: (519)659-7118  
 F: (519)451-1707

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.