



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
PERKINS Q0001

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (16 LTR)

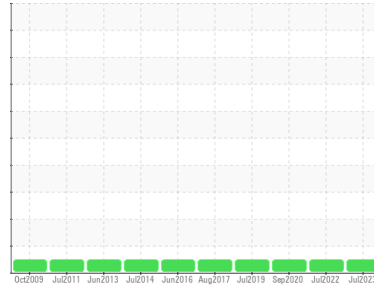

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0764054	WC0709817	WC0442712
Sample Date	Client Info			10 Jul 2023	18 Jul 2022	21 Sep 2020
Machine Age	hrs	Client Info		356	325	214
Oil Age	hrs	Client Info		67	36	42
Oil Changed	Client Info			Not Chngd	Not Chngd	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	<1.0	<1.0
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>250	4	4	5
Chromium	ppm	ASTM D5185(m)	>10	0	0	<1
Nickel	ppm	ASTM D5185(m)	>5	0	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>35	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>100	0	0	0
Copper	ppm	ASTM D5185(m)	>60	1	<1	2
Tin	ppm	ASTM D5185(m)	>5	0	0	0
Antimony	ppm	ASTM D5185(m)		0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	5	5	6
Barium	ppm	ASTM D5185(m)	10	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	100	8	8	36
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	132	135	706
Calcium	ppm	ASTM D5185(m)	3000	2052	2110	1321
Phosphorus	ppm	ASTM D5185(m)	1150	914	849	1011
Zinc	ppm	ASTM D5185(m)	1350	1016	1014	1187
Sulfur	ppm	ASTM D5185(m)	4250	2989	3035	2928
Lithium	ppm	ASTM D5185(m)		<1	<1	<1


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>35	3	3	4
Sodium	ppm	ASTM D5185(m)	>158	2	2	2
Potassium	ppm	ASTM D5185(m)	>20	1	1	1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.7	6.3	6.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	16.5	16.2	15.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	9.9	10.1	13.0











OIL ANALYSIS REPORT

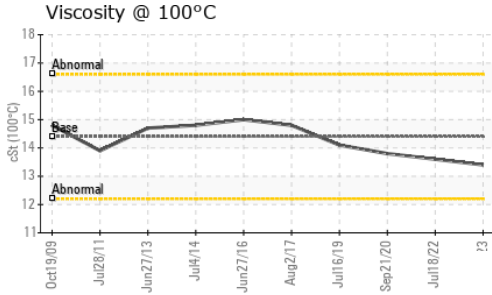

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.4	13.6

GRAPHS

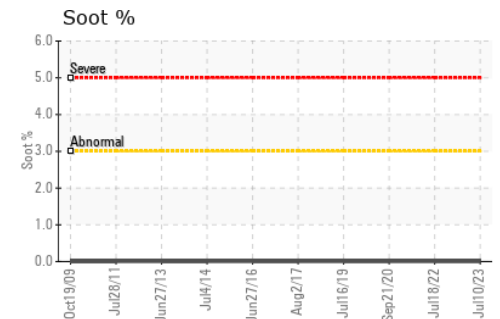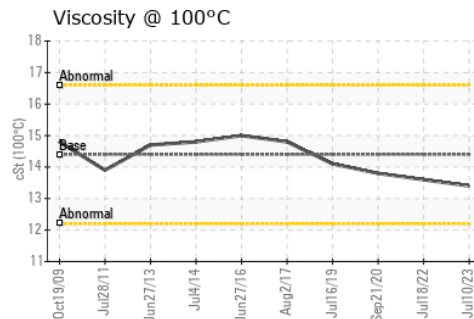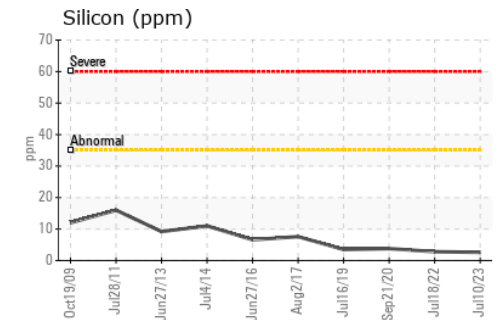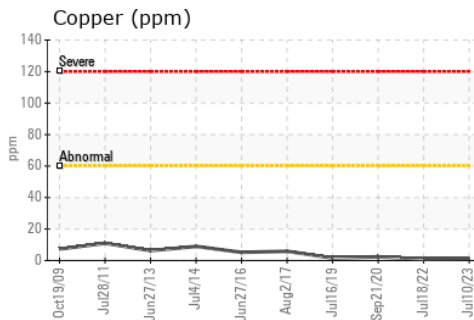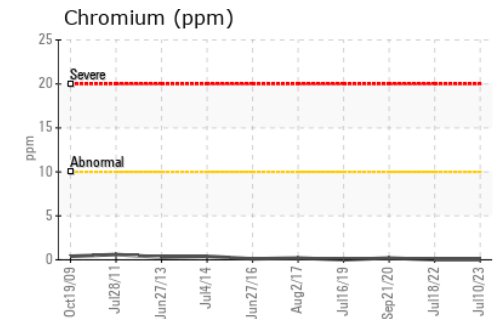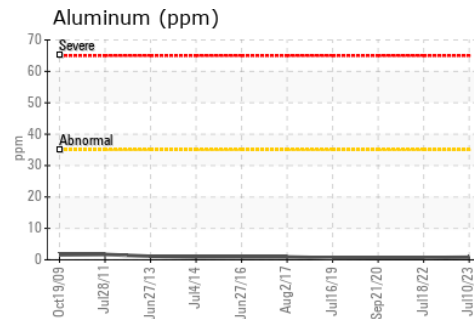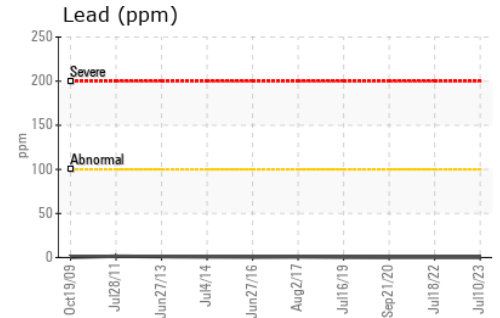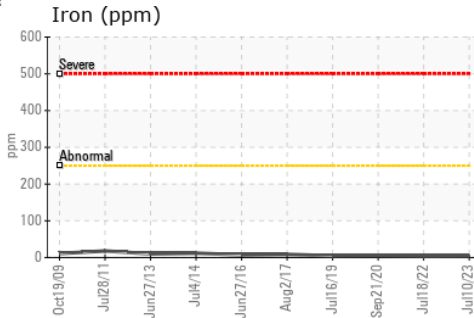

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0764054 **Received** : 10 Aug 2023
Lab Number : 02575110 **Diagnosed** : 10 Aug 2023
Unique Number : 5620161 **Diagnostician** : Wes Davis
Test Package : MOB 1

GENCARE SERVICES LTD.
 360 SOVEREIGN ROAD
 LONDON, ON
 CA N6M 1A8
 Contact: Teresa Matthews
 tmatthews@gencare.com
 T: (519)659-7118
 F: (519)451-1707

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.