




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

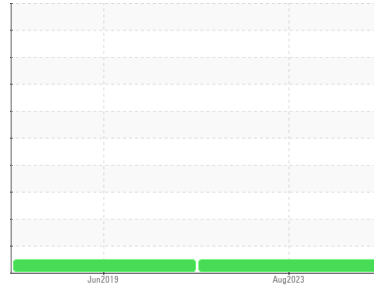

Machine Id  
**T001248 (S/N 16-M-06-1996)**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0832200</b>	WC0348968	---
Sample Date	Client Info			<b>04 Aug 2023</b>	19 Jun 2019	---
Machine Age	hrs	Client Info		<b>6048</b>	2700	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method		>5	<b>&lt;1.0</b>	<1.0	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>6</b>	6	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>1</b>	<1	---
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185(m)	>330	<b>1</b>	9	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	<b>20</b>	94	---
Barium	ppm	ASTM D5185(m)	10	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>67</b>	45	---
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185(m)	450	<b>917</b>	775	---
Calcium	ppm	ASTM D5185(m)	3000	<b>1305</b>	1248	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>1122</b>	954	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1215</b>	1156	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2886</b>	3008	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	3	---
Sodium	ppm	ASTM D5185(m)	>158	<b>&lt;1</b>	2	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.9</b>	5.8	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>19.0</b>	19.7	---



# OIL ANALYSIS REPORT







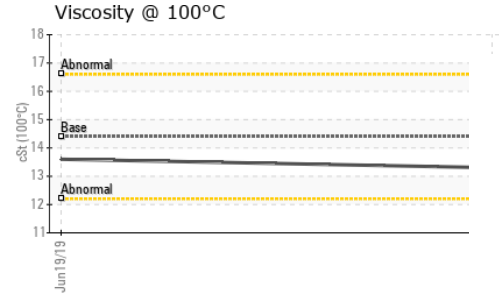
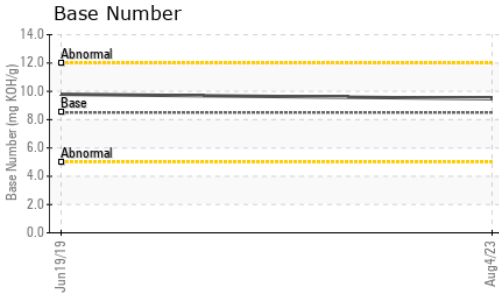


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.5</b>	13.7	---
Base Number (BN)	mg KOH/g	ASTM D2896*	8.5	<b>9.48</b>	9.79	---

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	---
Free Water	scalar	Visual*		<b>NEG</b>	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>13.3</b>	13.6	---

## GRAPHS

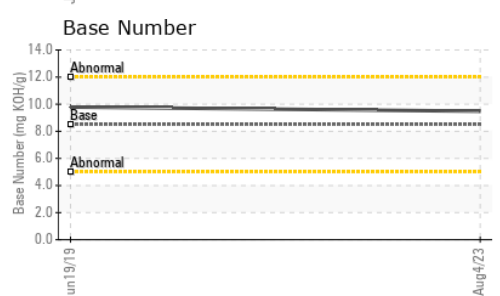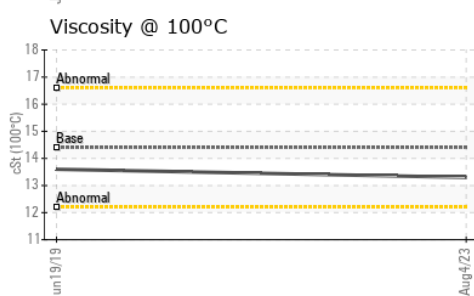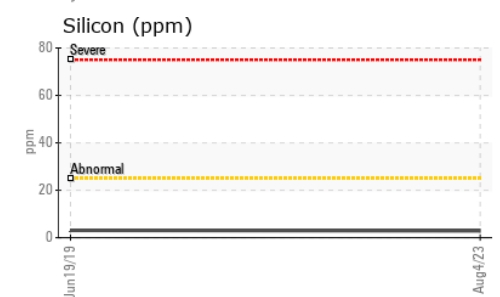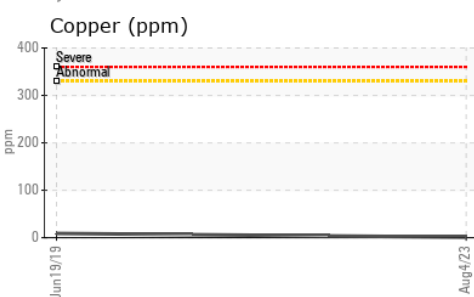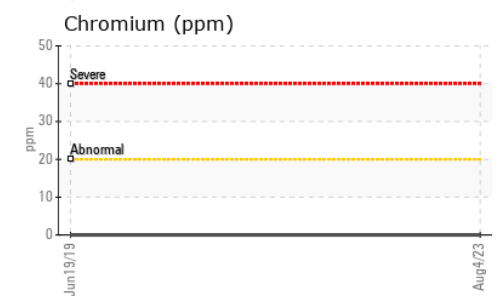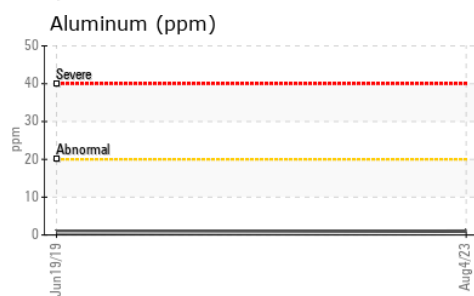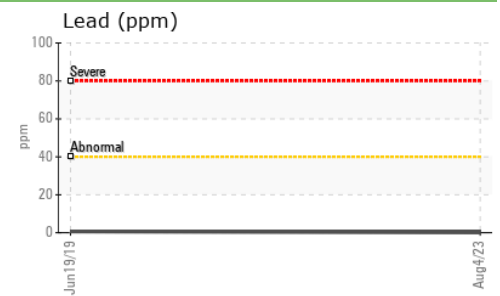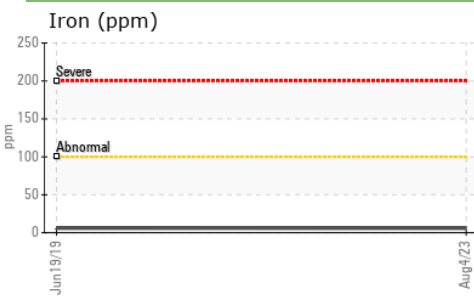

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0832200      **Received** : 11 Aug 2023  
**Lab Number** : **02575300**      **Diagnosed** : 11 Aug 2023  
**Unique Number** : 5620351      **Diagnostician** : Wes Davis  
**Test Package** : MOB 2

**RWF Industries**  
 873 Devonshire Ave.  
 Woodstock, ON  
 CA N4S 8Z4  
 Contact: Tami Arnold  
 tamia@rwfbron.com  
 T:  
 F: (519)421-0028

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.