




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

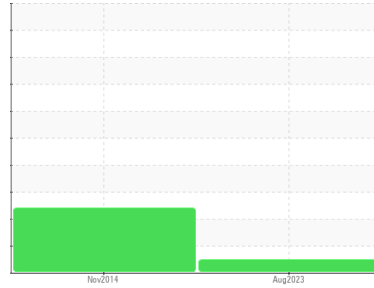

Machine Id
SEW EURODRIVE R92 #1 ELEVATOR

Component
Gearbox

Fluid
MOBIL MOBILGEAR SHC 220 (6 LTR)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0750564	WC925166	---
Sample Date	Client Info			09 Aug 2023	03 Nov 2014	---
Machine Age	hrs	Client Info		0	37527	---
Oil Age	hrs	Client Info		0	15081	---
Oil Changed	Client Info			Not Changed	Not Changed	---
Sample Status				NORMAL	ATTENTION	---




WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		44	58	---
Iron	ppm	ASTM D5185(m)	>200	104	60	---
Chromium	ppm	ASTM D5185(m)	>15	<1	<1	---
Nickel	ppm	ASTM D5185(m)	>15	0	<1	---
Titanium	ppm	ASTM D5185(m)		0	<1	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>25	2	4	---
Lead	ppm	ASTM D5185(m)	>100	0	0	---
Copper	ppm	ASTM D5185(m)	>200	<1	<1	---
Tin	ppm	ASTM D5185(m)	>25	0	0	---
Antimony	ppm	ASTM D5185(m)	>5	0	<1	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
Beryllium	ppm	ASTM D5185(m)		0	0	---
Cadmium	ppm	ASTM D5185(m)		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	3	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		1	<1	---
Magnesium	ppm	ASTM D5185(m)		20	▲ 25	---
Calcium	ppm	ASTM D5185(m)		39	▲ 1002	---
Phosphorus	ppm	ASTM D5185(m)		409	402	---
Zinc	ppm	ASTM D5185(m)		26	<1	---
Sulfur	ppm	ASTM D5185(m)		1772	▲ 1912	---
Lithium	ppm	ASTM D5185(m)		1	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	67	29	---
Sodium	ppm	ASTM D5185(m)		1	0	---
Potassium	ppm	ASTM D5185(m)	>20	<1	3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		1.04	▲ 0.048	---

OIL ANALYSIS REPORT

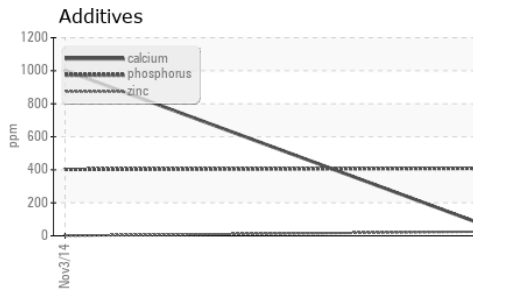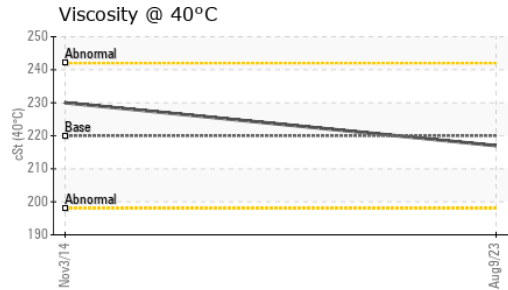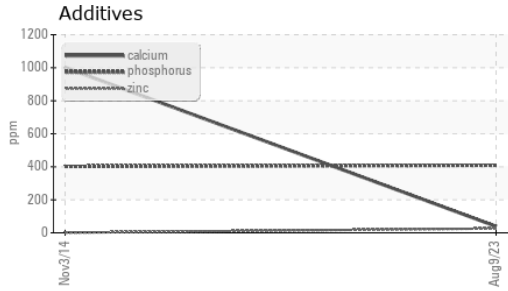





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	VLITE	---
Debris	scalar	Visual*	NONE	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---
Free Water	scalar	Visual*		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	220	217	230	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

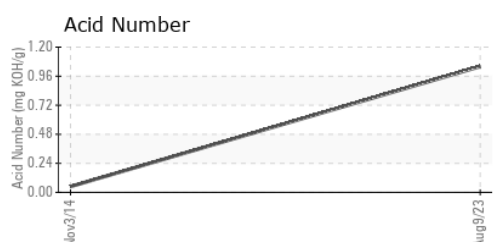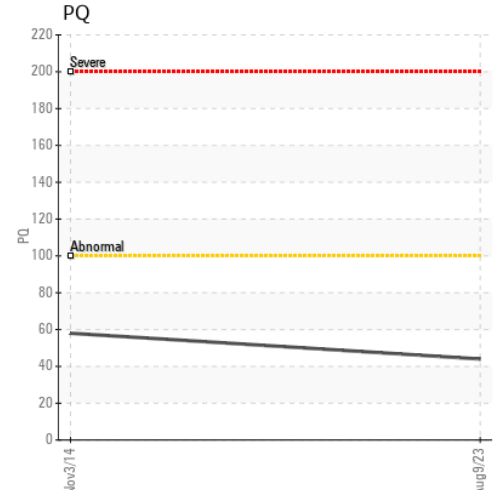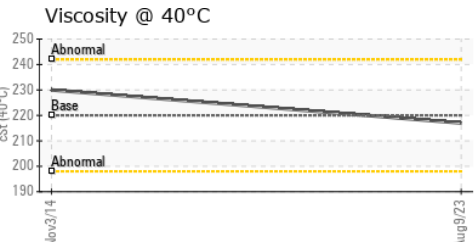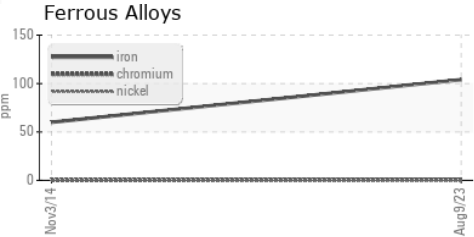

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0750564 **Received** : 11 Aug 2023
Lab Number : **02575498** **Diagnosed** : 12 Aug 2023
Unique Number : 5620549 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

CARMEUSE LIME CANADA LTD.
 BOX 1690., HWY 17 EAST
 BLIND RIVER, ON
 CA P0R 1B0
 Contact: Rejean Baillargeon
 rejean.baillargeon@carmeusena.com
 T: (705)849-2201
 F: (705)849-2355

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.