




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
5TM P1029
Component
New (Unused) Oil
Fluid
NOT GIVEN (--- LTR)

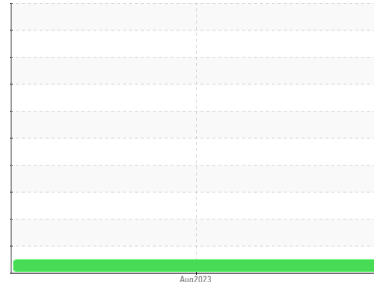

DIAGNOSIS

Recommendation

This is the baseline readout on this new (unused) oil. The fluid is suitable for service. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

{not applicable}

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. There is no indication of any contamination in the new (unused) oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 32 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0848539	---	---
Sample Date	Client Info		11 Aug 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >5	<1	---	---
Chromium	ppm	ASTM D5185(m) >5	0	---	---
Nickel	ppm	ASTM D5185(m) >5	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >5	0	---	---
Aluminum	ppm	ASTM D5185(m) >5	<1	---	---
Lead	ppm	ASTM D5185(m) >5	0	---	---
Copper	ppm	ASTM D5185(m) >5	0	---	---
Tin	ppm	ASTM D5185(m) >5	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	2	---	---
Barium	ppm	ASTM D5185(m)	0	---	---
Molybdenum	ppm	ASTM D5185(m)	<1	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	69	---	---
Calcium	ppm	ASTM D5185(m)	42	---	---
Phosphorus	ppm	ASTM D5185(m)	306	---	---
Zinc	ppm	ASTM D5185(m)	350	---	---
Sulfur	ppm	ASTM D5185(m)	685	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<1	---	---
Sodium	ppm	ASTM D5185(m)	0	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	---	---
Nitration	Abs/cm	ASTM D7624*	1.9	---	---
Sulfation	Abs/.1mm	ASTM D7415*	19.9	---	---



OIL ANALYSIS REPORT

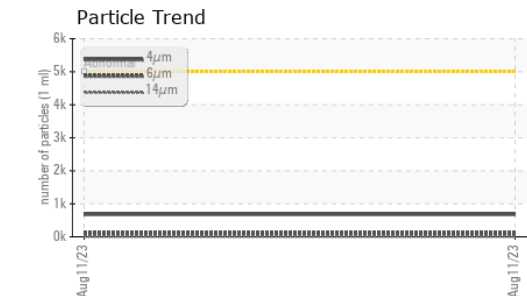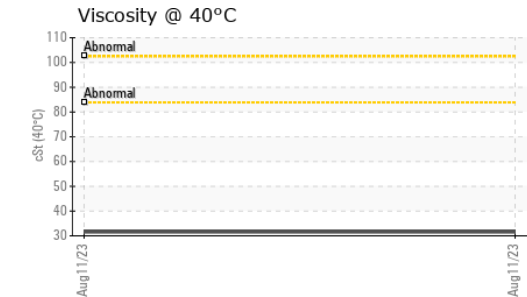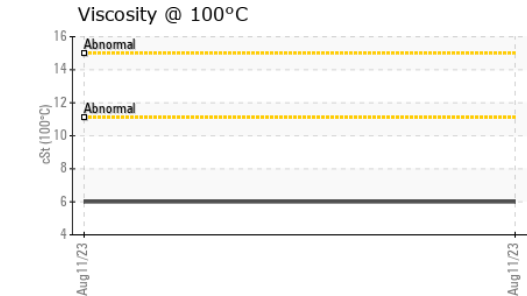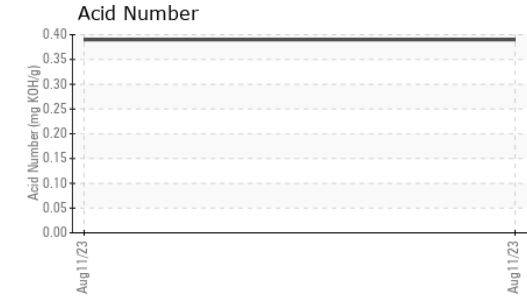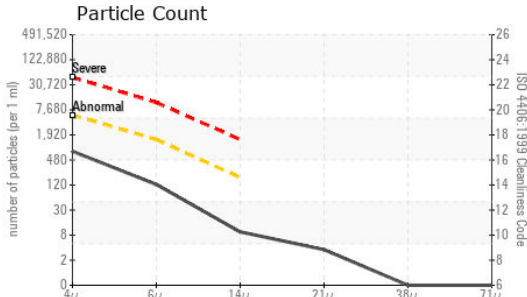

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	681	---	---
Particles >6µm	ASTM D7647	>1300	109	---	---
Particles >14µm	ASTM D7647	>160	8	---	---
Particles >21µm	ASTM D7647	>40	3	---	---
Particles >38µm	ASTM D7647	>10	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	17/14/10	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	11.0	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*	0.39	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	---	---
Precipitate	scalar	Visual*	NONE	---	---
Silt	scalar	Visual*	NONE	---	---
Debris	scalar	Visual*	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	---	---
Appearance	scalar	Visual*	NORML	---	---
Odor	scalar	Visual*	NORML	---	---
Emulsified Water	scalar	Visual*	NEG	---	---
Free Water	scalar	Visual*	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	31.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	6	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	138	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0848539 **Received** : 14 Aug 2023
Lab Number : **02575705** **Diagnosed** : 15 Aug 2023
Unique Number : 5620756 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI)

GEISMAR CANADA
 2525 TEDLO STREET, UNIT A
 MISSISSAUGA, ON
 CA L5A 4A8
 Contact: Saddam Suarez
 s.suarez@geismar.com
 T: (416)605-0113
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.