




PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
Site Services - TEMTEMMD
 Machine Id
N/A TM-465-315-501 #2 Allis Chalmers Compressor Motor
 Component
Non-Drive End Bearing
 Fluid
ESSO NUTO H ISO 32 (1000 LTR)

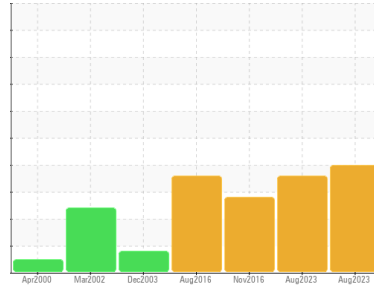

COMPONENT CONDITION SUMMARY

Particle Trend

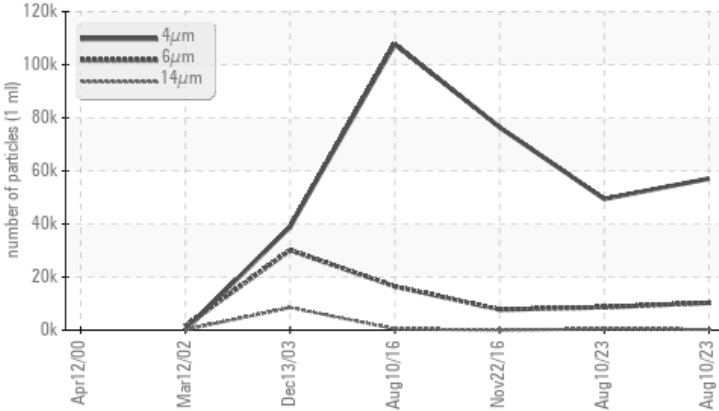

RECOMMENDATION

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE
Particles >6µm	ASTM D7647	>320	8642	10296	7726
Particles >14µm	ASTM D7647	>80	429	244	54
Particles >21µm	ASTM D7647	>20	116	45	5
Particles >38µm	ASTM D7647	>4	10	1	0
Oil Cleanliness	ISO 4406 (c)	>--/15/13	23/20/16	23/21/15	23/20/13

Customer Id: TEMTEMMD
 Sample No.: WC
 Lab Number: 02575713
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Contact Required	---	---	?	Please contact your representative for information regarding the proper sampling kits for your service.
Alert	---	---	?	NOTE: We recommend using IND 3 test kits,
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where contaminants can enter the system.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

ISO



10 Aug 2023 Diag: Kevin Marson

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. All component wear rates are normal. There is a high amount of particulates (2 to 100 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



22 Nov 2016 Diag: Wes Davis

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >6µm are severely high. Oil Cleanliness is severe. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



10 Aug 2016 Diag: Kevin Marson

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >6µm are severely high. Oil Cleanliness is severe. Particles >14µm are abnormally high. Particles >21µm are abnormally high. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

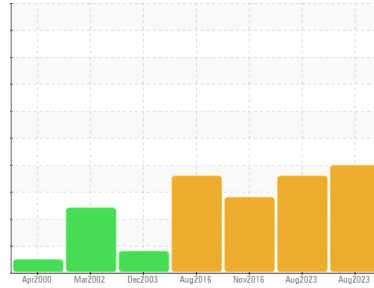

ISO



Area
Site Services - TEMTEMMD
 Machine Id
N/A TM-465-315-501 #2 Allis Chalmers Compressor Motor
 Component
Non-Drive End Bearing
 Fluid
ESSO NUTO H ISO 32 (1000 LTR)

DIAGNOSIS

Recommendation

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates (2 to 100 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC	WC	PP
Sample Date	Client Info	10 Aug 2023	10 Aug 2023	22 Nov 2016
Machine Age	mths Client Info	0	0	0
Oil Age	mths Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		SEVERE	SEVERE	SEVERE

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >20	<1	<1	<1
Chromium	ppm ASTM D5185(m) >20	0	0	0
Nickel	ppm ASTM D5185(m) >20	0	0	0
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	0	0
Aluminum	ppm ASTM D5185(m) >20	<1	<1	0
Lead	ppm ASTM D5185(m) >20	<1	<1	1
Copper	ppm ASTM D5185(m) >20	6	6	10
Tin	ppm ASTM D5185(m) >20	3	2	2
Antimony	ppm ASTM D5185(m)	0	0	<1
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	0	<1	0
Barium	ppm ASTM D5185(m) 0	0	0	0
Molybdenum	ppm ASTM D5185(m) 0	0	0	0
Manganese	ppm ASTM D5185(m)	0	0	0
Magnesium	ppm ASTM D5185(m) 5	0	<1	0
Calcium	ppm ASTM D5185(m) 50	53	57	45
Phosphorus	ppm ASTM D5185(m) 330	356	360	344
Zinc	ppm ASTM D5185(m) 420	439	440	471
Sulfur	ppm ASTM D5185(m) 2700	4480	4487	2275
Lithium	ppm ASTM D5185(m)	<1	<1	<1






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<1	0	<1
Sodium	ppm ASTM D5185(m)	0	<1	<1
Potassium	ppm ASTM D5185(m) >20	<1	<1	0
Water	% ASTM D6304* >2	0.001	0.001	0.000
ppm Water	ppm ASTM D6304*	9.6	10.9	7.1

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	49392	57082	76446
Particles >6µm	ASTM D7647 >320	8642	10296	7726
Particles >14µm	ASTM D7647 >80	429	244	54
Particles >21µm	ASTM D7647 >20	116	45	5
Particles >38µm	ASTM D7647 >4	10	1	0
Particles >71µm	ASTM D7647 >3	1	0	0
Oil Cleanliness	ISO 4406 (c) >--/15/13	23/20/16	23/21/15	23/20/13

OIL ANALYSIS REPORT

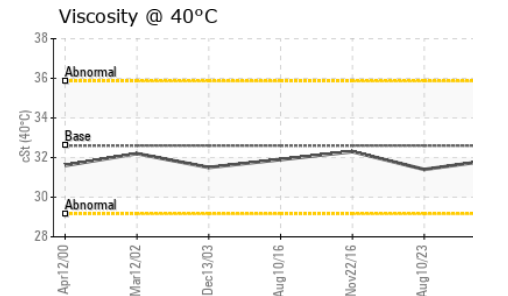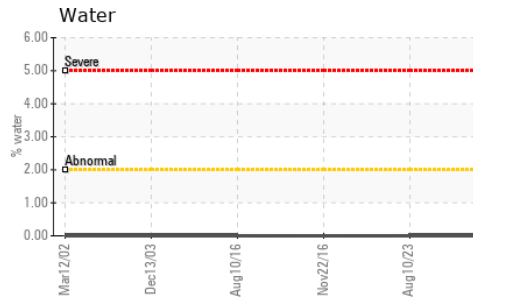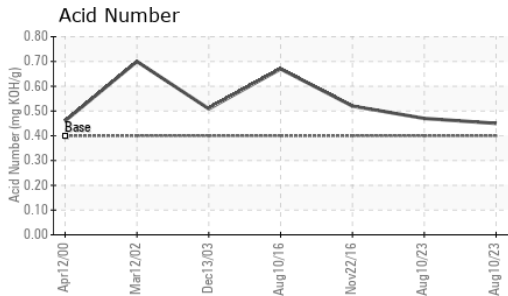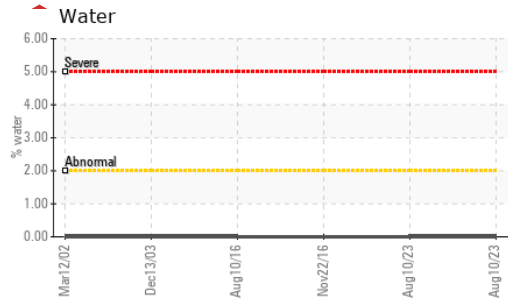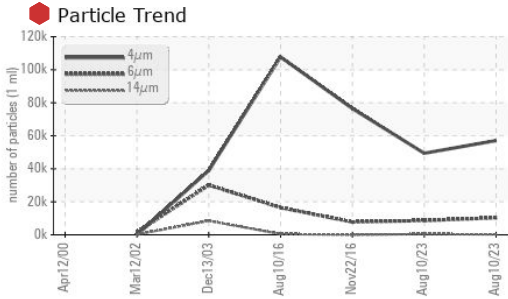


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.40	0.45	0.47	0.52






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	VLITE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	32.6	31.9	31.4	32.3

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

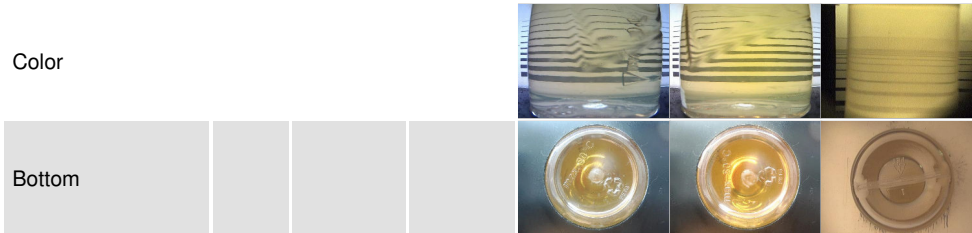

GRAPHS

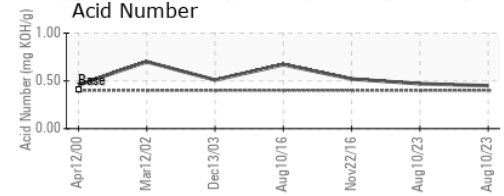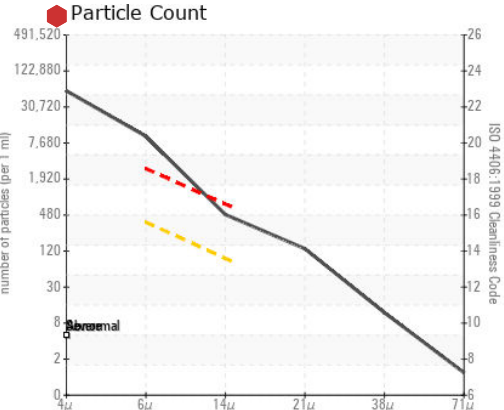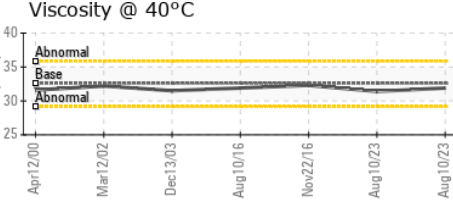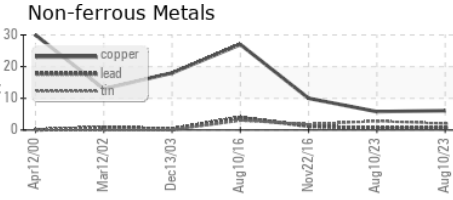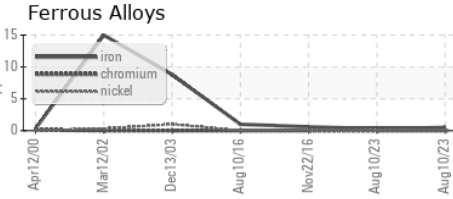

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC
Lab Number : 02575713
Unique Number : 5620764
Test Package : IND 2 (Additional Tests: KF)
Received : 14 Aug 2023
Diagnosed : 15 Aug 2023
Diagnostician : Kevin Marson

Rayonier Advanced Materials
 P.O.Box 6000, 33 Kipawa Road
 Temiscaming, QC
 CA J0Z 3R0
 Contact: Adouniss El Yaqoti
 Adouniss.Elyaqoti@rayonieram.com
 T: (819)627-4931
 F: (819)627-1507

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.