




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

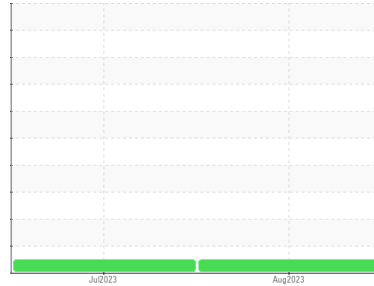

Machine Id  
**PRESS #1 MAIN TANK**  
 Component  
**Hydraulic System**  
 Fluid  
**AW HYDRAULIC OIL ISO 46 (9000 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using Advanced Oil Monitoring (AOM) kits for this system. The AOM test package includes advanced level testing to determine the suitability of turbine and large industrial compressor oils for continued use.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service (unconfirmed).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC</b>	WC	---
Sample Date	Client Info			<b>13 Aug 2023</b>	09 Jul 2023	---
Machine Age	hrs Client Info			<b>0</b>	0	---
Oil Age	hrs Client Info			<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<b>3</b>	2	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185(m)	>20	<b>16</b>	20	---
Tin	ppm	ASTM D5185(m)	>20	<b>0</b>	0	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	<b>&lt;1</b>	<1	---
Barium	ppm	ASTM D5185(m)	5	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185(m)	5	<b>0</b>	0	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185(m)	25	<b>&lt;1</b>	1	---
Calcium	ppm	ASTM D5185(m)	200	<b>64</b>	61	---
Phosphorus	ppm	ASTM D5185(m)	300	<b>355</b>	360	---
Zinc	ppm	ASTM D5185(m)	370	<b>433</b>	424	---
Sulfur	ppm	ASTM D5185(m)	2500	<b>749</b>	740	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>2501</b>	2412	---
Particles >6µm		ASTM D7647	>1300	<b>219</b>	350	---
Particles >14µm		ASTM D7647	>160	<b>9</b>	43	---
Particles >21µm		ASTM D7647	>40	<b>3</b>	13	---
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>19/15/10</b>	18/16/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.57	<b>0.33</b>	0.31	---




# OIL ANALYSIS REPORT

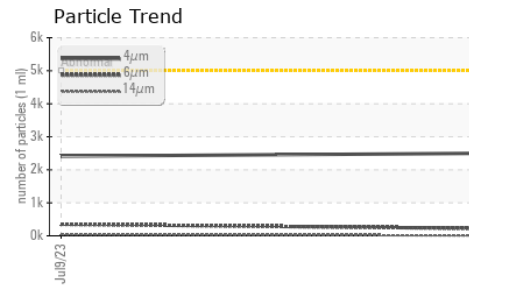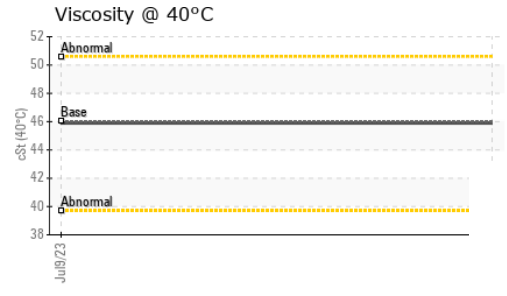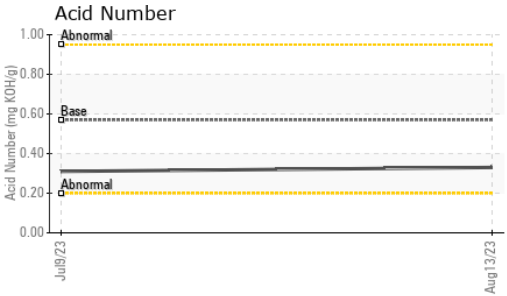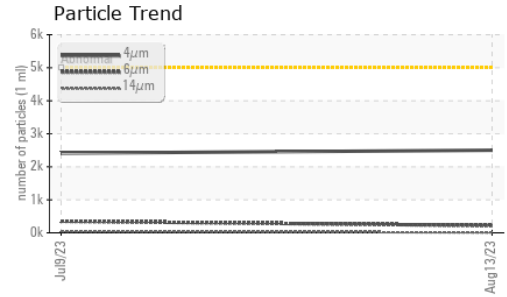






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.05	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	46	<b>45.9</b>	45.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

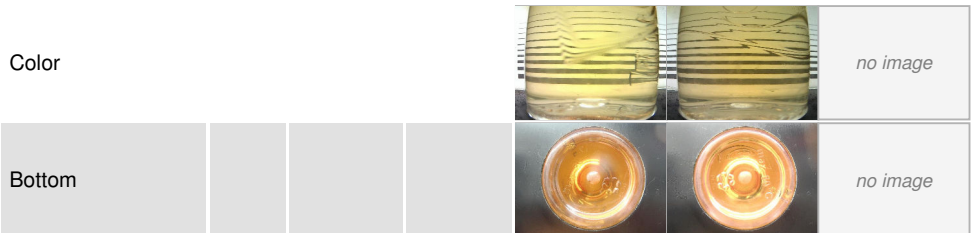

### GRAPHS

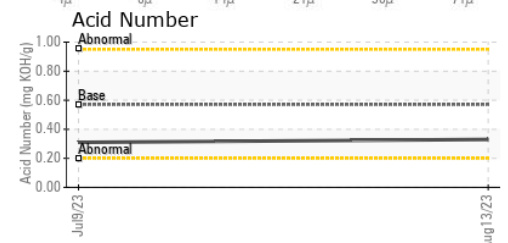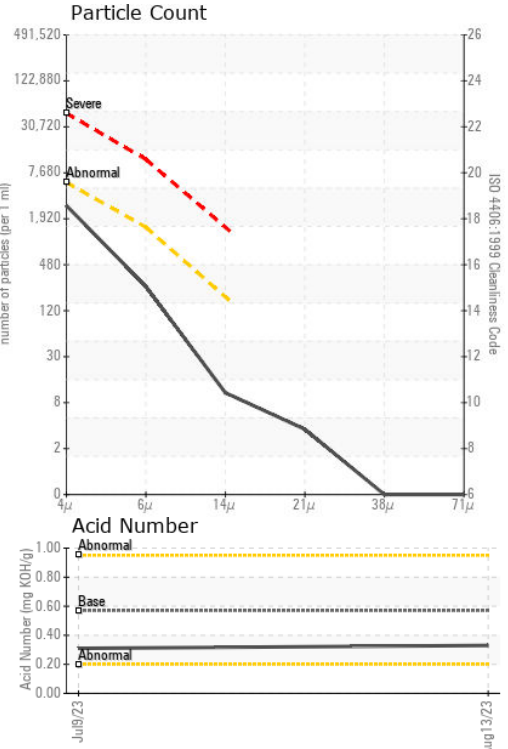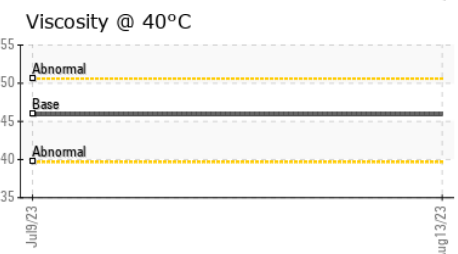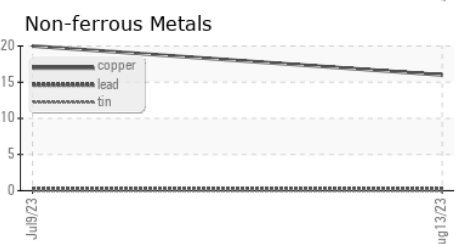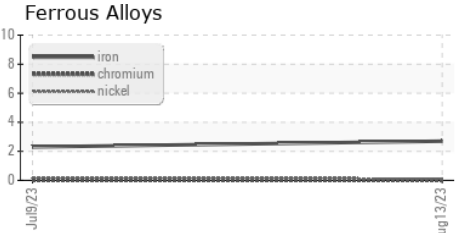

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC  
**Lab Number** : 02575724  
**Unique Number** : 5620775  
**Test Package** : IND 2  
**Received** : 14 Aug 2023  
**Diagnosed** : 15 Aug 2023  
**Diagnostician** : Wes Davis

**Hydro Extrusion North**  
 5675 Kennedy Road  
 Mississauga, ON  
 CA L4Z 2H9  
 Contact: Harsh Murria  
 Harsh.murria@hydro.com  
 T: (819)462-0479  
 F: (866)462-6478

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.