




PROBLEM SUMMARY


Area
Caster/Basement
 Machine Id
Cooper Airmist Compressor #2
 Component
Air Compressor
 Fluid
PETRO CANADA HYDREX AW 46 (90 GAL)

Sample Rating Trend

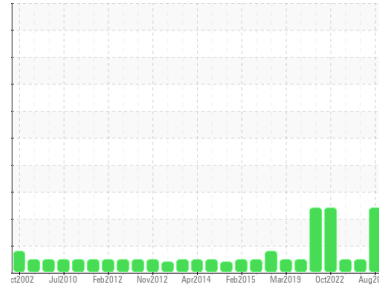

COMPONENT CONDITION SUMMARY

Additives

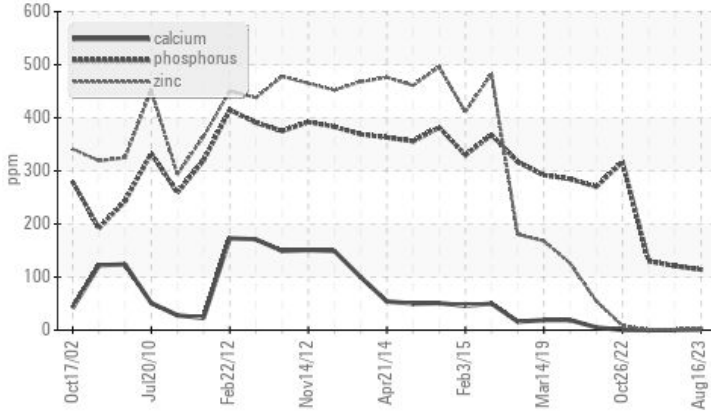

RECOMMENDATION

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Appearance	scalar	Visual*	NORML	▲ WGOIL	NORML	NORML
Free Water	scalar	Visual*		▲ 1%	NEG	NEG

Customer Id: LEWBOSC
 Sample No.: WC0850099
 Lab Number: 02576177
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.
Check Water Access	---	---	?	We advise that you check for the source of water entry.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS

30 May 2023 Diag: Bill Quesnel

NORMAL



Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Feb 2023 Diag: Kevin Marson

NORMAL



Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



26 Oct 2022 Diag: Kevin Marson

ADDITIVES



We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






OIL ANALYSIS REPORT

Sample Rating Trend

WATER



Area
Caster/Baseament
 Machine Id
Cooper Airmist Compressor #2
 Component
Air Compressor
 Fluid
PETRO CANADA HYDREX AW 46 (90 GAL)

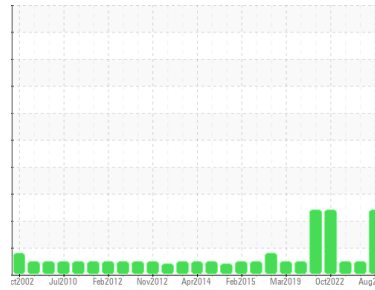

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Free water present. The system cleanliness is acceptable for your target ISO 4406 cleanliness code.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0850099	WC0824351	WC0796839
Sample Date	Client Info		16 Aug 2023	30 May 2023	28 Feb 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>99999	0	0	0
Iron	ppm	ASTM D5185(m)	>50	0	<1
Chromium	ppm	ASTM D5185(m)	>4	0	0
Nickel	ppm	ASTM D5185(m)	>4	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0
Silver	ppm	ASTM D5185(m)		0	0
Aluminum	ppm	ASTM D5185(m)	>10	<1	0
Lead	ppm	ASTM D5185(m)	>20	0	0
Copper	ppm	ASTM D5185(m)	>40	<1	<1
Tin	ppm	ASTM D5185(m)	>5	0	0
Antimony	ppm	ASTM D5185(m)		0	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	0
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1	<1
Calcium	ppm	ASTM D5185(m)	50	1	0
Phosphorus	ppm	ASTM D5185(m)	330	114	121
Zinc	ppm	ASTM D5185(m)	430	4	1
Sulfur	ppm	ASTM D5185(m)	760	338	402
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	0	0
Sodium	ppm	ASTM D5185(m)		<1	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1
Water	%	ASTM D6304*	>0.6	0.009	0.00
ppm Water	ppm	ASTM D6304*	>6000	92.1	0.00

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	4846	6876	4525
Particles >6µm	ASTM D7647	>2500	1417	1117	1258
Particles >14µm	ASTM D7647	>320	117	26	104
Particles >21µm	ASTM D7647	>80	26	7	25
Particles >38µm	ASTM D7647	>20	0	0	1
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/18/14	20/17/12	19/17/14



OIL ANALYSIS REPORT

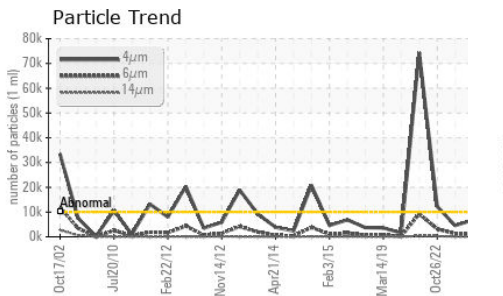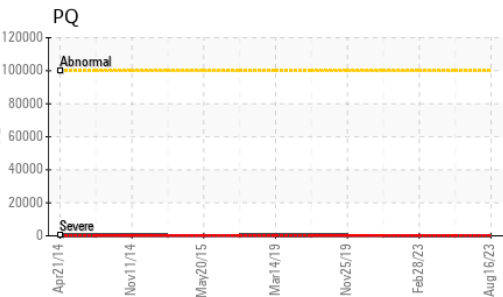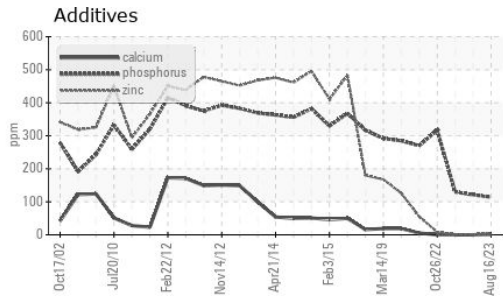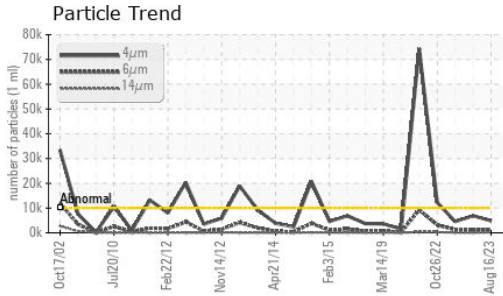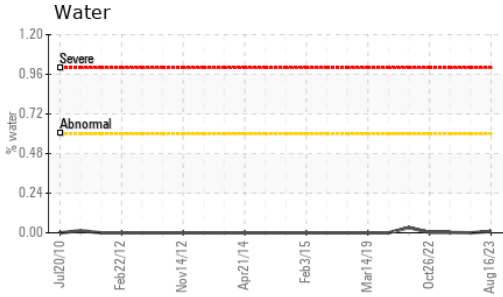


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.70	0.24	0.30	0.29






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	▲ WGOIL	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	.2%	NEG	NEG
Free Water	scalar	Visual*		▲ 1%	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46.4	46.5	46.3	46.3

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

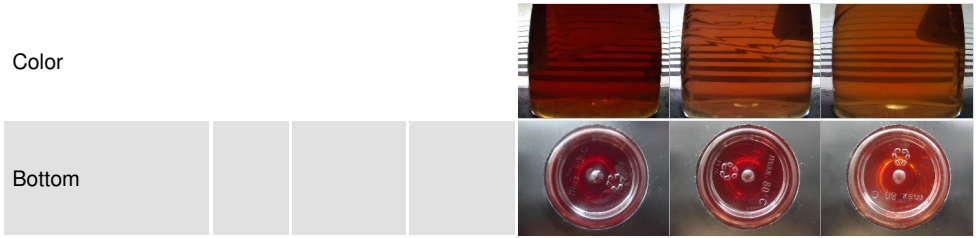

GRAPHS

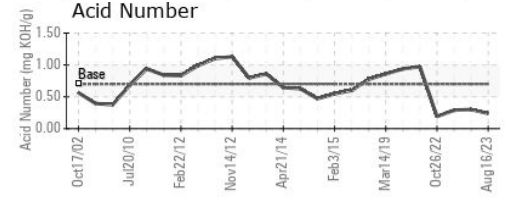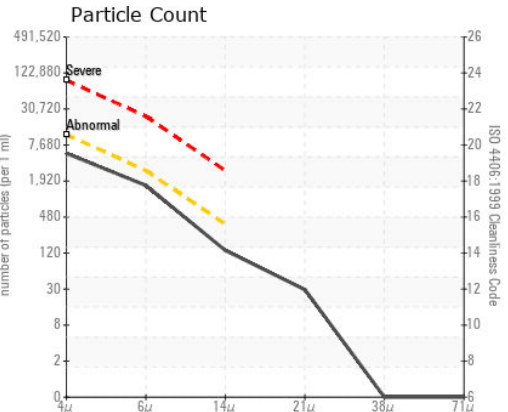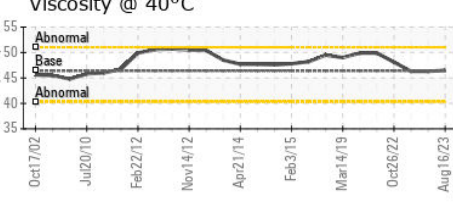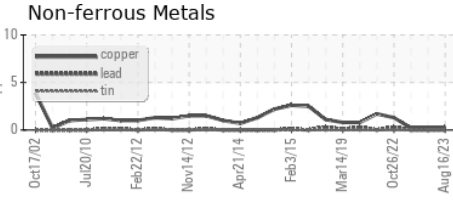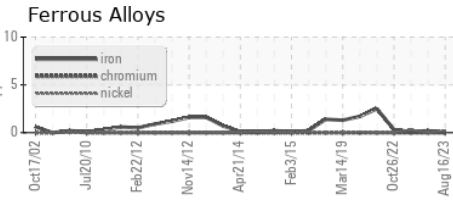

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **STELCO - BOSC - Basic Oxygen Slab Caster**
Sample No. : WC0850099 **Received** : 16 Aug 2023 2330 Regional Road #3, Door: BOSC8
Lab Number : **02576177** **Diagnosed** : 17 Aug 2023 NANTICOKE, ON
Unique Number : 5629237 **Diagnostician** : Kevin Marson CA N0A 1L0
Test Package : IND 2 (Additional Tests: KF, PQ)
 Contact: Tom Walden
 Thomas.Walden@stelco.com
 T: (519)587-4541
 F: (519)587-7702

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.