


OIL ANALYSIS REPORT

Sample Rating Trend







BLOWER #6 (S/N 5979)

Component

Blower

AW HYDRAULIC OIL ISO 46 (300 LTR)

וט	$\Delta(\exists \Gamma$	VO)	S	8
D1/		40	Ų.	

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2023	Jui2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0840705	PP	
Sample Date		Client Info		24 Jul 2023	10 May 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	0	0	
Chromium	ppm	ASTM D5185(m)	>20	0	0	
Nickel	ppm	ASTM D5185(m)	>20	0	0	
Titanium	ppm	ASTM D5185(m)		0	0	
Silver	ppm	ASTM D5185(m)		0	0	
Aluminum	ppm	ASTM D5185(m)	>20	0	0	
Lead	ppm	ASTM D5185(m)	>20	0	0	
Copper	ppm	ASTM D5185(m)		<1	0	
Tin	ppm	ASTM D5185(m)	>20	0	0	
Antimony	ppm	ASTM D5185(m)	7 = 0	0	<1	
Vanadium	ppm	ASTM D5185(m)		0	0	
Beryllium	ppm	ASTM D5185(m)		0	0	
Cadmium	ppm	ASTM D5185(m)		0	0	
	рріп		15 14-/1	-		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	0	<1	
Barium	ppm	ASTM D5185(m)		0	0	
Molybdenum	ppm	ASTM D5185(m)	5	0	0	
Manganese	ppm	ASTM D5185(m)		0	0	
Magnesium	ppm	ASTM D5185(m)	25	1	1	
Calcium	ppm	ASTM D5185(m)		52	53	
Phosphorus	ppm	ASTM D5185(m)	300	372	379	
Zinc	ppm	ASTM D5185(m)	370	445	433	
Sulfur	ppm	ASTM D5185(m)	2500	911	942	
Lithium	ppm	ASTM D5185(m)		<1	<1	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	1	3	
Sodium	ppm	ASTM D5185(m)		0	0	
Potassium	ppm	ASTM D5185(m)	>20	<1	0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	561	585	
Particles >6μm		ASTM D7647	>640	110	177	
Particles >14μm		ASTM D7647	>80	12	15	
Particles >21µm		ASTM D7647	>20	4	5	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>18/16/13	16/14/11	16/15/11	
FLUID DEGRADA	ATION_	method	limit/base	current	history1	history2
A stal Niversity - 17 (ANI)		AOTA DOZ 11	0.57	0.00	0.07	

0.32



OIL ANALYSIS REPORT

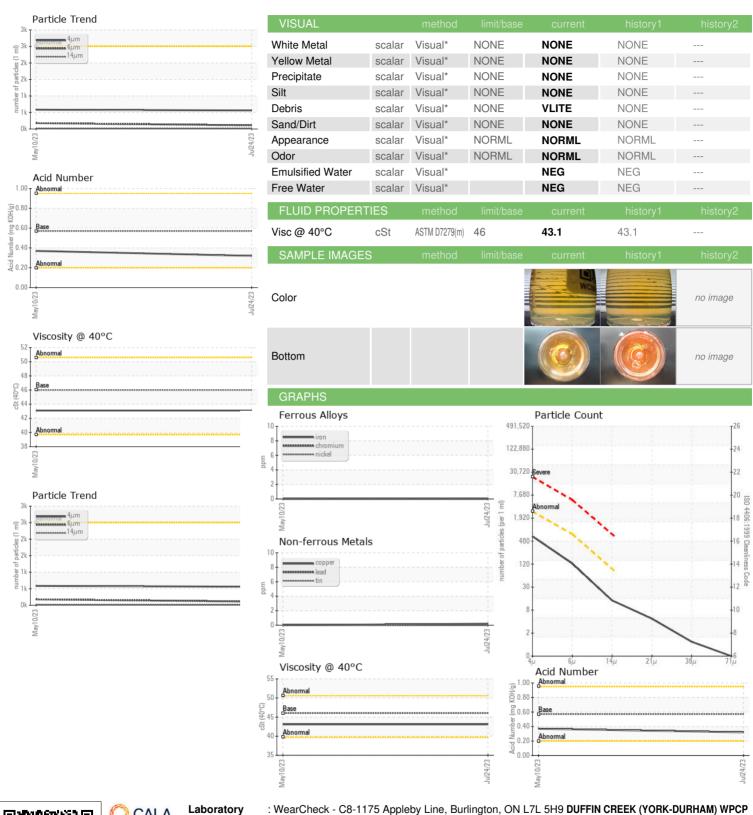



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number **Unique Number**

Test Package

: WC0840705

: 02576782 : 5629842 : IND 2

Received Diagnosed

: 22 Aug 2023 : Wes Davis Diagnostician

: 18 Aug 2023

901 MCKAY ROAD PICKERING, ON **CA L1W 3A3** Contact: Al Roffey

F: (905)686-3956

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

AL.ROFFEY@REGION.DURHAM.ON.CA T: (905)683-9109

Validity of results and interpretation are based on the sample and information as supplied.