




PROBLEM SUMMARY

Sample Rating Trend

WEAR


Area
Kingsbridge SP-13584
Machine Id
T15 (S/N 21765)

Component
Wind Turbine Gearbox
Fluid
CASTROL OPTIGEAR SYNTHETIC CT 320 (360 LTR)

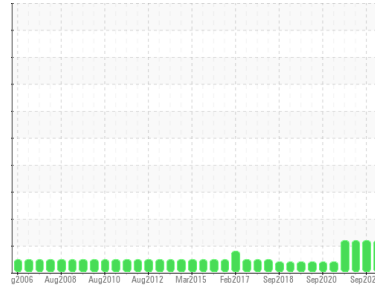


COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

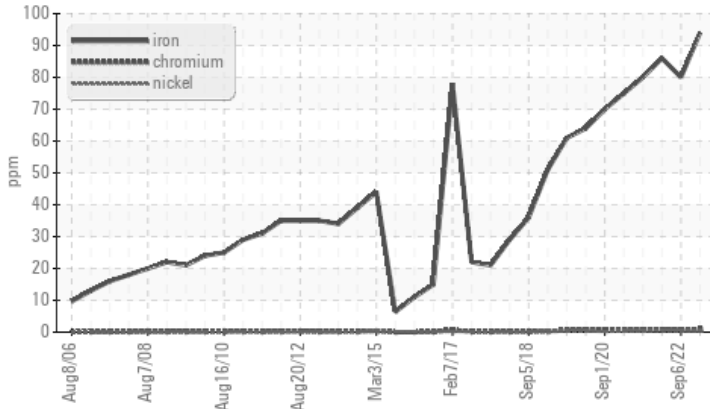

▲ Additives

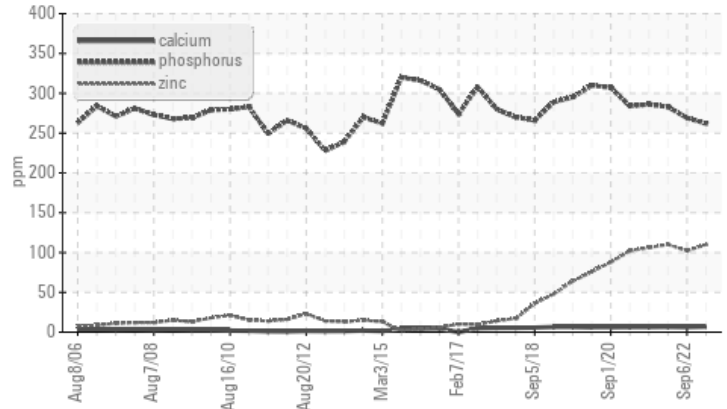

RECOMMENDATION

Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Iron	ppm	ASTM D5185(m)	>75	▲ 94	▲ 80
Zinc	ppm	ASTM D5185(m)		▲ 110	▲ 102
					▲ 86
					▲ 110

Customer Id: VESTAS
Sample No.: WC0783092
Lab Number: 02576922
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

HISTORICAL DIAGNOSIS

06 Sep 2022 Diag: Bill Quesnel

WEAR



Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



14 Feb 2022 Diag: Kevin Marson

WEAR



The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition. Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Zinc ppm levels are abnormally high. The AN level is acceptable for this fluid.

view report



07 Sep 2021 Diag: Bill Quesnel

WEAR



The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition. Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Zinc ppm levels are abnormally high. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

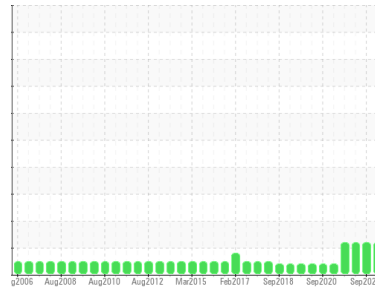

WEAR



Area
Kingsbridge SP-13584
 Machine Id
T15 (S/N 21765)

Component
Wind Turbine Gearbox
 Fluid
CASTROL OPTIGEAR SYNTHETIC CT 320 (360 LTR)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition.

Wear

Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0783092	WC0305830	WC0305801
Sample Date	Client Info		26 Jul 2023	06 Sep 2022	14 Feb 2022
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>50	0	0	0
Iron	ppm	ASTM D5185(m)	>75	▲ 94	▲ 80
Chromium	ppm	ASTM D5185(m)	>5	1	<1
Nickel	ppm	ASTM D5185(m)	>10	<1	<1
Titanium	ppm	ASTM D5185(m)	>10	0	0
Silver	ppm	ASTM D5185(m)		0	0
Aluminum	ppm	ASTM D5185(m)	>10	<1	<1
Lead	ppm	ASTM D5185(m)	>15	2	2
Copper	ppm	ASTM D5185(m)	>10	<1	0
Tin	ppm	ASTM D5185(m)	>10	0	0
Antimony	ppm	ASTM D5185(m)	>5	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1
Barium	ppm	ASTM D5185(m)		0	0
Molybdenum	ppm	ASTM D5185(m)		<1	<1
Manganese	ppm	ASTM D5185(m)		2	2
Magnesium	ppm	ASTM D5185(m)		1	1
Calcium	ppm	ASTM D5185(m)		7	6
Phosphorus	ppm	ASTM D5185(m)		262	269
Zinc	ppm	ASTM D5185(m)		▲ 110	▲ 102
Sulfur	ppm	ASTM D5185(m)		5002	4931
Lithium	ppm	ASTM D5185(m)		<1	<1


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>40	4	4
Sodium	ppm	ASTM D5185(m)	>30	9	8
Potassium	ppm	ASTM D5185(m)	>20	<1	<1
Water	%	ASTM D6304*	>0.02	0.008	0.012
ppm Water	ppm	ASTM D6304*	>200	89.6	123.7





INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	0
Nitration	Abs/cm	ASTM D7624*		3.1	3.0
Sulfation	Abs/.1mm	ASTM D7415*		13.5	12.6

▲ Ferrous Alloys

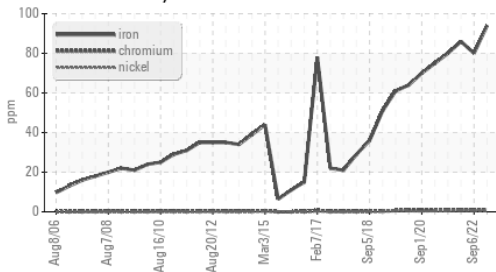

▲ Additives

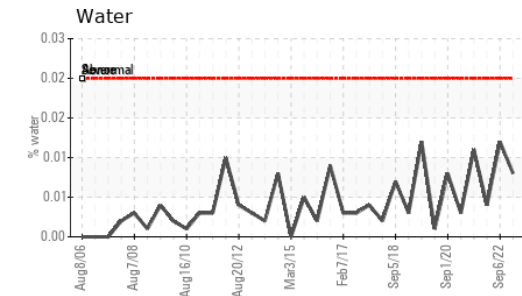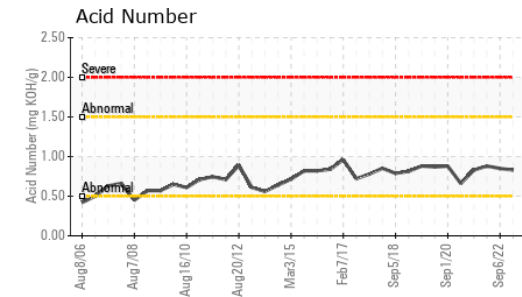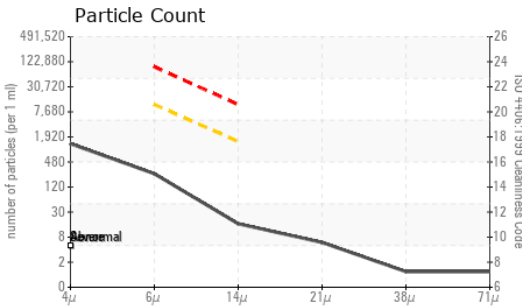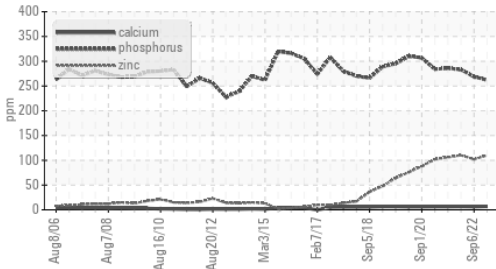

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.
Sample No. : WC0783092 **Received** : 18 Aug 2023
Lab Number : 02576922 **Diagnosed** : 21 Aug 2023
Unique Number : 5629982 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1157	3462	5539
Particles >6µm	ASTM D7647	>10000	221	325	573
Particles >14µm	ASTM D7647	>1300	14	7	42
Particles >21µm	ASTM D7647	>320	5	3	13
Particles >38µm	ASTM D7647	>80	1	0	1
Particles >71µm	ASTM D7647	>20	1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	17/15/11	19/16/10	20/16/13

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*		8.2	8.2	6.7
Acid Number (AN)	mg KOH/g ASTM D974*		0.83	0.85	0.88

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.02	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	335	336	337	344
Visc @ 100°C	cSt ASTM D7279(m)	35	35.1	35.3	35.0
Viscosity Index (VI)	Scale ASTM D2270*	148	149	149	145

SAMPLE IMAGES

