




OIL ANALYSIS REPORT

Sample Rating Trend

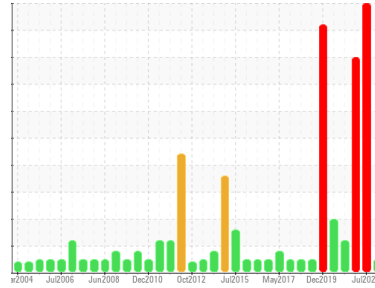

NORMAL



Area
Port Albert SP-00515
 Machine Id
13921 PAD 1 (S/N 48196)

Component
Wind Turbine Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (180 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0783110	WC0632692	WC0546185
Sample Date	Client Info		28 Jun 2023	08 Jul 2022	15 Nov 2021
Machine Age	yrs	Client Info	0	0	0
Oil Age	yrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>50	0	0	0
Iron	ppm	ASTM D5185(m)	>75	28	32
Chromium	ppm	ASTM D5185(m)	>5	<1	<1
Nickel	ppm	ASTM D5185(m)	>10	0	<1
Titanium	ppm	ASTM D5185(m)	>10	0	0
Silver	ppm	ASTM D5185(m)		0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	0
Lead	ppm	ASTM D5185(m)	>15	0	0
Copper	ppm	ASTM D5185(m)	>5	<1	<1
Tin	ppm	ASTM D5185(m)	>10	0	<1
Antimony	ppm	ASTM D5185(m)	>5	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1
Barium	ppm	ASTM D5185(m)		0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)		<1	<1
Magnesium	ppm	ASTM D5185(m)		0	0
Calcium	ppm	ASTM D5185(m)	0	<1	<1
Phosphorus	ppm	ASTM D5185(m)	485	371	328
Zinc	ppm	ASTM D5185(m)	0	19	16
Sulfur	ppm	ASTM D5185(m)		3793	3827
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>40	4	3
Sodium	ppm	ASTM D5185(m)	>10	2	1
Potassium	ppm	ASTM D5185(m)	>20	<1	<1
Water	%	ASTM D6304*	>0.02	0.008	0.010
ppm Water	ppm	ASTM D6304*	>200	80.0	105.1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	0
Nitration	Abs/cm	ASTM D7624*		2.2	2.3
Sulfation	Abs/1mm	ASTM D7415*		49.2	31.5



OIL ANALYSIS REPORT

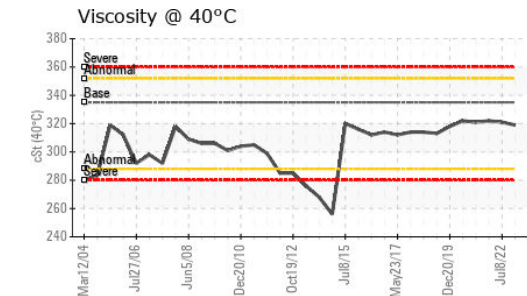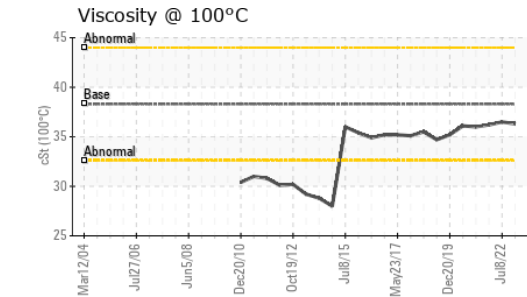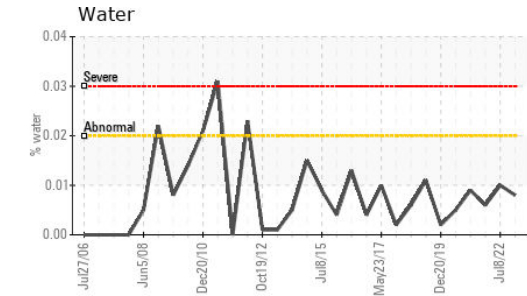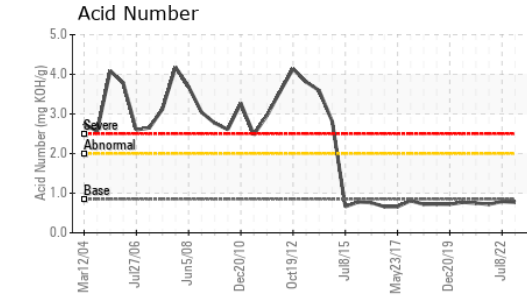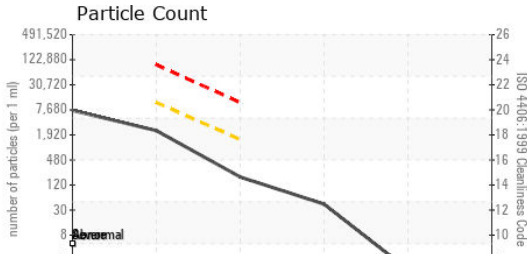

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		6486	28103	17122
Particles >6µm	ASTM D7647	>10000	2131	9756	5639
Particles >14µm	ASTM D7647	>1300	165	1020	520
Particles >21µm	ASTM D7647	>320	37	267	133
Particles >38µm	ASTM D7647	>80	1	8	8
Particles >71µm	ASTM D7647	>20	1	1	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	20/18/15	22/20/17	21/20/16

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	55.0	31.6	13.5
Acid Number (AN)	mg KOH/g	ASTM D974*	0.77	0.79	0.72

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	LIGHT	MODER	MODER
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	NEG	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	319	321	322
Visc @ 100°C	cSt	ASTM D7279(m)	36.3	36.5	36.2
Viscosity Index (VI)	Scale	ASTM D2270*	161	161	159

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter			no image		



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.
Sample No. : WC0783110 **Received** : 18 Aug 2023 1417 NW Everett Street
Lab Number : **02576926** **Diagnosed** : 21 Aug 2023 Portland, OR
Unique Number : 5629986 **Diagnostician** : Kevin Marson US 97209
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, PrtCount, TAN Man, VI) Contact: Nicole Philippi
 To discuss this sample report, contact Customer Service at 1-800-268-2131. NiPhi@vestas.com
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (503)327-7683
 Validity of results and interpretation are based on the sample and information as supplied. F: (503)327-0247