




# PROBLEM SUMMARY

Sample Rating Trend

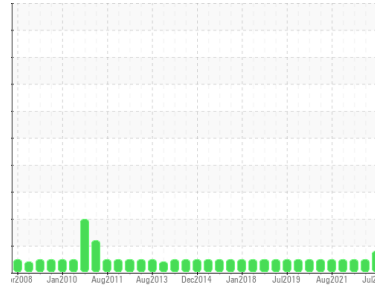

**WEAR**




Area  
**Ravenswood SP-24224**  
Machine Id  
**T5 (S/N 23963)**

Component  
**Wind Turbine Gearbox**  
Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (280 LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Non-ferrous Metals

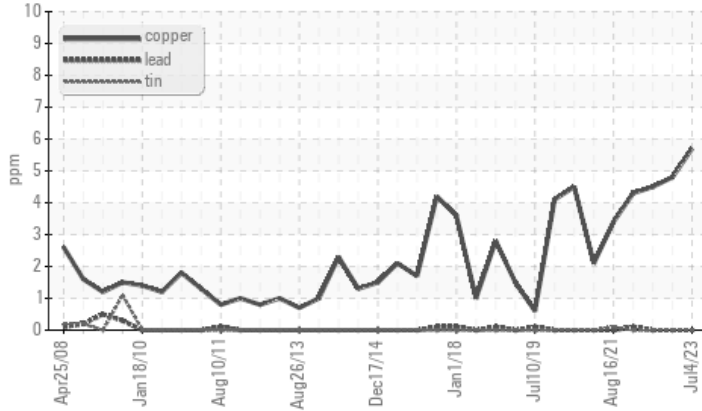

## RECOMMENDATION

We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	NORMAL	NORMAL
Copper	ppm ASTM D5185(m) >5	▲ 6	5	4

Customer Id: VESTAS  
Sample No.: WC0783106  
Lab Number: 02576928  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1  
(289)291-4641 x4641  
[Bill.Quesnel@wearcheck.com](mailto:Bill.Quesnel@wearcheck.com)

To change component or sample information:  
Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

10 Jan 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Jun 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Feb 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

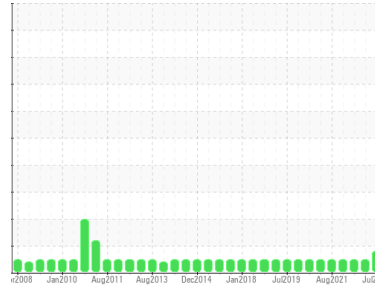

**WEAR**



Area  
**Ravenswood SP-24224**  
 Machine Id  
**T5 (S/N 23963)**

Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (280 LTR)**

## DIAGNOSIS

### Recommendation

We recommend an early resample to monitor this condition.

### Wear

Copper ppm levels are abnormal. Bearing and/or bushing wear is indicated.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0783106</b>	WC0783078	WC0632678
Sample Date	Client Info		<b>04 Jul 2023</b>	10 Jan 2023	22 Jun 2022
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>50	<b>0</b>	0	0	
Iron	ppm	ASTM D5185(m)	>75	<b>10</b>	10	9
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m)	>5	<b>▲ 6</b>	5	4
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<b>1</b>	<1	<1
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	3	0
Phosphorus	ppm	ASTM D5185(m)	485	<b>349</b>	376	340
Zinc	ppm	ASTM D5185(m)	0	<b>22</b>	12	12
Sulfur	ppm	ASTM D5185(m)		<b>3547</b>	3729	3663
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>40	<b>6</b>	6	6
Sodium	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304*	>0.02	<b>0.010</b>	0.007	0.012
ppm Water	ppm	ASTM D6304*	>200	<b>104.4</b>	76.0	128.3


## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*		<b>2.3</b>	2.1	2.2
Sulfation	Abs/.1mm	ASTM D7415*		<b>48.0</b>	47.5	37.6



# OIL ANALYSIS REPORT

## Non-ferrous Metals

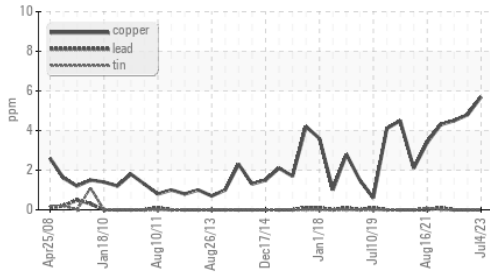


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2290</b>	1919	2708
Particles >6µm	ASTM D7647	>10000	<b>622</b>	396	441
Particles >14µm	ASTM D7647	>1300	<b>60</b>	15	33
Particles >21µm	ASTM D7647	>320	<b>20</b>	3	11
Particles >38µm	ASTM D7647	>80	<b>3</b>	0	2
Particles >71µm	ASTM D7647	>20	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	<b>18/16/13</b>	18/16/11	19/16/12

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	<b>54.3</b>	55.3	38.4
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.94</b>	0.94	0.88


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	NEG	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	335	<b>315</b>	317
Visc @ 100°C	cSt	ASTM D7279(m)	38.3	<b>35.9</b>	36.0
Viscosity Index (VI)	Scale	ASTM D2270*	164	<b>161</b>	160


## SAMPLE IMAGES

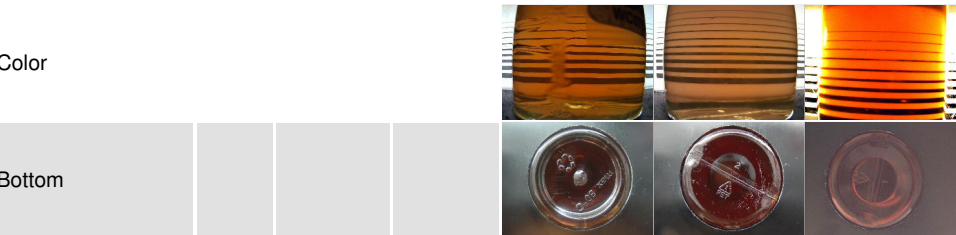


## Particle Count

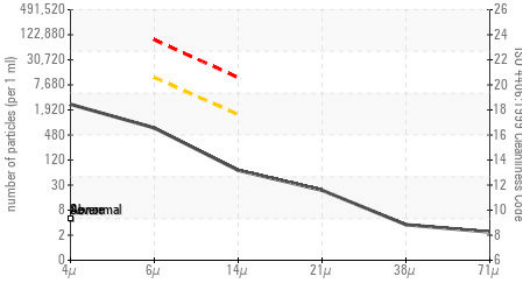


## Acid Number

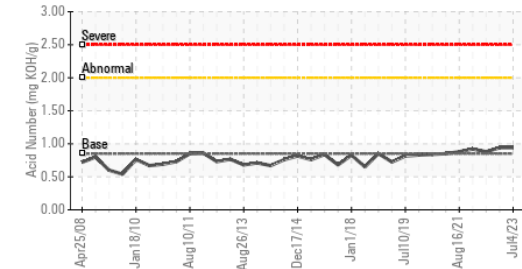

## Water

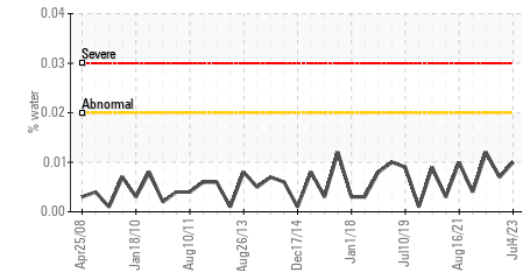

## Viscosity @ 100°C

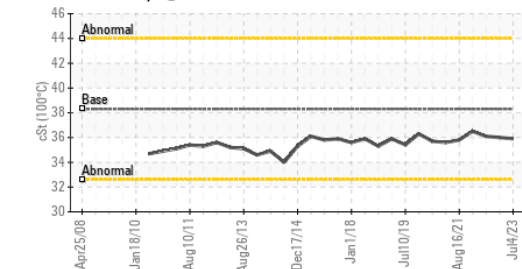

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.  
**Sample No.** : WC0783106  
**Lab Number** : **02576928**  
**Unique Number** : 5629988  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI )

**Received** : 18 Aug 2023  
**Diagnosed** : 23 Aug 2023  
**Diagnostician** : Bill Quesnel

1417 NW Everett Street  
Portland, OR  
US 97209  
Contact: Nicole Philippi  
NiPhi@vestas.com  
T: (503)327-7683  
F: (503)327-0247

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
Validity of results and interpretation are based on the sample and information as supplied.