




PROBLEM SUMMARY

Sample Rating Trend


ADDITIVES

Area
Capital Power PDN - SC011776
 Machine Id
T401 (S/N 00021HLKZA)
 Component
Wind Turbine Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (395 LTR)

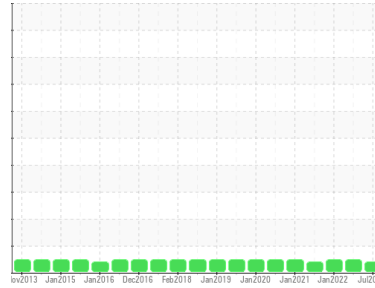

COMPONENT CONDITION SUMMARY

▲ Additives

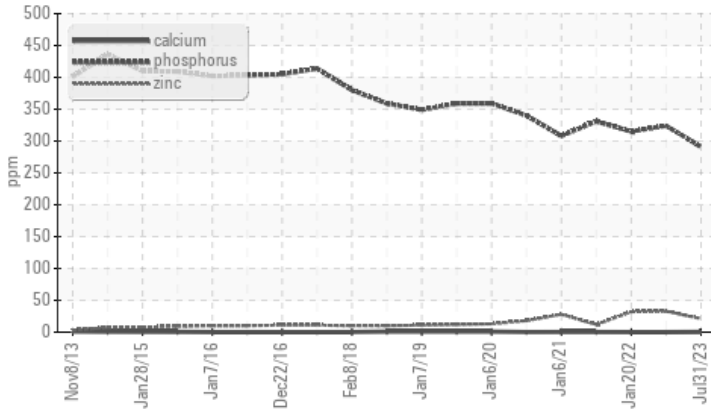

RECOMMENDATION

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Phosphorus	ppm	ASTM D5185(m)	485	▲ 291	324	315

Customer Id: VESTAS
 Sample No.: WC0824660
 Lab Number: 02576935
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

HISTORICAL DIAGNOSIS

03 Jan 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



20 Jan 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Jul 2021 Diag: Bill Quesnel

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >6µm are abnormally high. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






OIL ANALYSIS REPORT

Sample Rating Trend

ADDITIVES

Area
Capital Power PDN - SC011776
 Machine Id
T401 (S/N 00021HLKZA)
 Component
Wind Turbine Gearbox
 Fluid
MOBIL MOBILGEAR SHC XMP 320 (395 LTR)

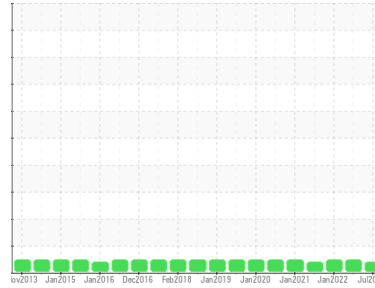

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0824660	WC0768683	WC0651081
Sample Date	Client Info		31 Jul 2023	03 Jan 2023	20 Jan 2022
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>50	0	0	0
Iron	ppm	ASTM D5185(m)	>75	39	39
Chromium	ppm	ASTM D5185(m)	>5	<1	<1
Nickel	ppm	ASTM D5185(m)	>10	0	0
Titanium	ppm	ASTM D5185(m)	>10	0	0
Silver	ppm	ASTM D5185(m)		0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	0
Lead	ppm	ASTM D5185(m)	>3	0	0
Copper	ppm	ASTM D5185(m)	>5	4	3
Tin	ppm	ASTM D5185(m)	>3	0	0
Antimony	ppm	ASTM D5185(m)	>3	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0
Beryllium	ppm	ASTM D5185(m)		0	0
Cadmium	ppm	ASTM D5185(m)		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1
Barium	ppm	ASTM D5185(m)		0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	<1
Manganese	ppm	ASTM D5185(m)		0	<1
Magnesium	ppm	ASTM D5185(m)		<1	0
Calcium	ppm	ASTM D5185(m)	0	<1	0
Phosphorus	ppm	ASTM D5185(m)	485	▲ 291	324
Zinc	ppm	ASTM D5185(m)	0	21	33
Sulfur	ppm	ASTM D5185(m)		3550	3838
Lithium	ppm	ASTM D5185(m)		<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>40	7	4
Sodium	ppm	ASTM D5185(m)	>10	1	1
Potassium	ppm	ASTM D5185(m)	>20	<1	0
Water	%	ASTM D6304*	>0.02	0.007	0.003
ppm Water	ppm	ASTM D6304*	>200	76.0	36.7


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	0
Nitration	Abs/cm	ASTM D7624*		2.4	2.4
Sulfation	Abs/.1mm	ASTM D7415*		49.9	27.2




OIL ANALYSIS REPORT


Additives

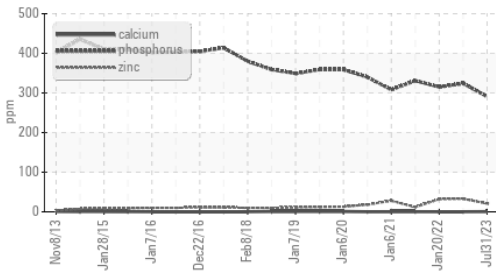


Particle Count

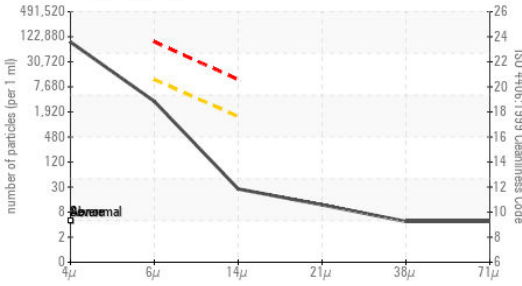


Acid Number

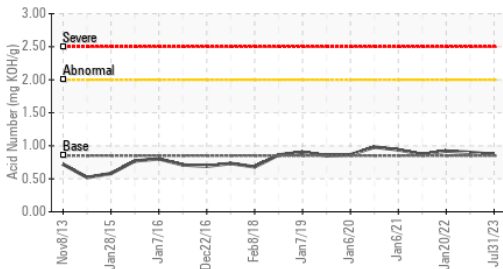

Water

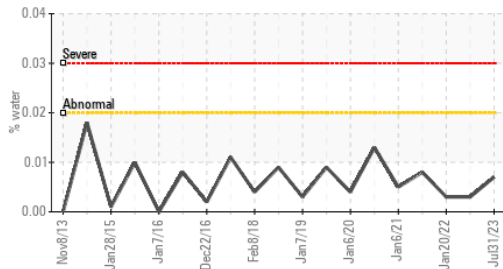

Viscosity @ 100°C

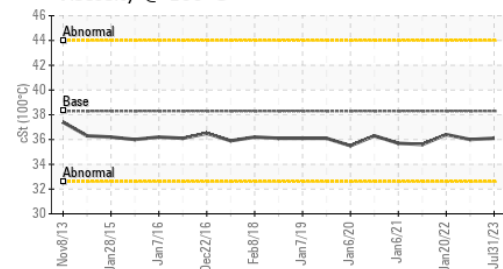


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		79187	1133	488
Particles >6µm	ASTM D7647	>10000	3009	166	54
Particles >14µm	ASTM D7647	>1300	24	11	2
Particles >21µm	ASTM D7647	>320	10	4	0
Particles >38µm	ASTM D7647	>80	4	0	0
Particles >71µm	ASTM D7647	>20	4	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	23/19/12	17/15/11	16/13/9

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*		57.6	24.3	57.6
Acid Number (AN)	mg KOH/g ASTM D974*	0.85	0.87	0.90	0.92

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.02	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	335	320	322	324
Visc @ 100°C	cSt ASTM D7279(m)	38.3	36.1	36.0	36.4
Viscosity Index (VI)	Scale ASTM D2270*	164	159	158	159

SAMPLE IMAGES

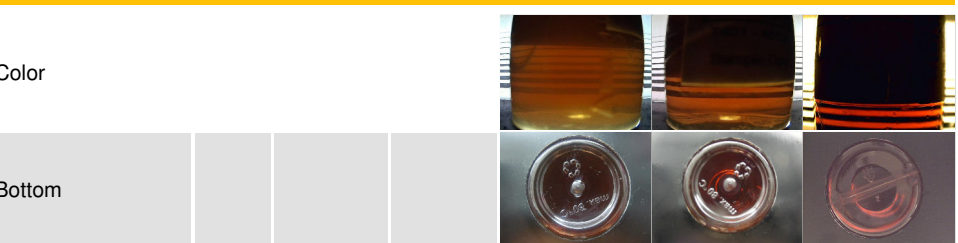

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.
Sample No. : WC0824660 **Received** : 18 Aug 2023
Lab Number : **02576935** **Diagnosed** : 23 Aug 2023
Unique Number : 5629995 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

1417 NW Everett Street
 Portland, OR
 US 97209
 Contact: Nicole Philippi
 NiPhi@vestas.com
 T: (503)327-7683
 F: (503)327-0247