




# OIL ANALYSIS REPORT

Sample Rating Trend

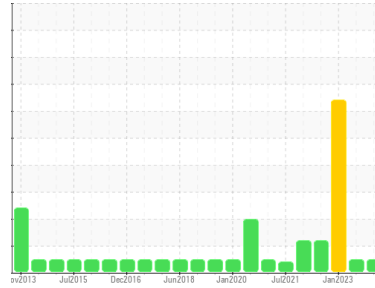

**NORMAL**



Area  
**Capital Power PDN - SC011776**  
 Machine Id  
**T502 (S/N 0001ZL87PY)**

Component  
**Wind Turbine Gearbox**  
 Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (395 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0824675</b>	WC0824659	WC0768693
Sample Date	Client Info		<b>11 Aug 2023</b>	11 Aug 2023	05 Jan 2023
Machine Age	days	Client Info	<b>0</b>	0	0
Oil Age	days	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	SEVERE

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184*	>50	<b>0</b>	0	0	
Iron	ppm	ASTM D5185(m)	>75	<b>17</b>	16	39
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185(m)	>3	<b>0</b>	0	<1
Copper	ppm	ASTM D5185(m)	>5	<b>3</b>	2	12
Tin	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	>3	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Calcium	ppm	ASTM D5185(m)	0	<b>1</b>	1	0
Phosphorus	ppm	ASTM D5185(m)	485	<b>334</b>	328	274
Zinc	ppm	ASTM D5185(m)	0	<b>6</b>	5	10
Sulfur	ppm	ASTM D5185(m)		<b>5036</b>	5077	3586
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>40	<b>4</b>	4	1
Sodium	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304*	>0.02	<b>0.007</b>	0.006	0.005
ppm Water	ppm	ASTM D6304*	>200	<b>75.2</b>	64.5	53.0

## INFRA-RED


	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*		<b>2.9</b>	2.9	2.2
Sulfation	Abs/.1mm	ASTM D7415*		<b>14.4</b>	13.9	32.2




# OIL ANALYSIS REPORT

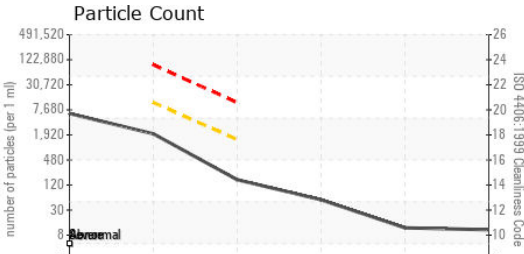


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5470</b>	4085	771
Particles >6µm	ASTM D7647	>10000	<b>1788</b>	1400	99
Particles >14µm	ASTM D7647	>1300	<b>142</b>	120	6
Particles >21µm	ASTM D7647	>320	<b>47</b>	39	2
Particles >38µm	ASTM D7647	>80	<b>10</b>	13	0
Particles >71µm	ASTM D7647	>20	<b>9</b>	12	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	<b>20/18/14</b>	19/18/14	17/14/10

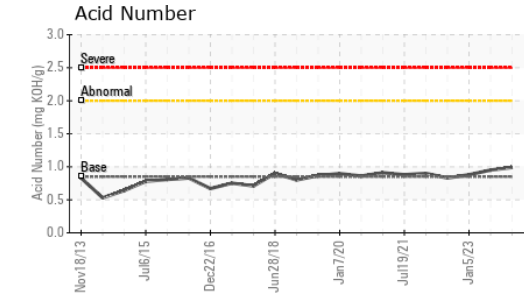


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	<b>9.0</b>	8.2	28.9
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.99</b>	0.95	0.88

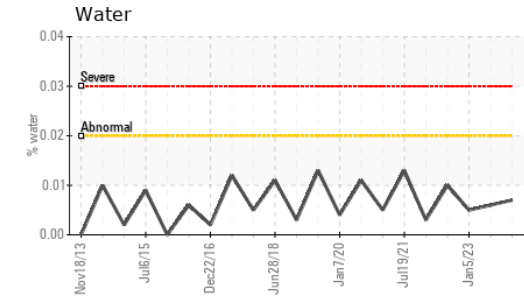

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.02	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

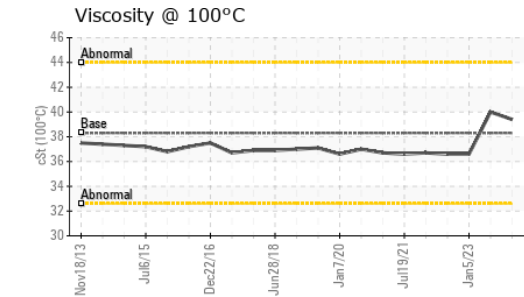

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	<b>335</b>	336	332
Visc @ 100°C	cSt	ASTM D7279(m)	<b>39.4</b>	40.0	36.6
Viscosity Index (VI)	Scale	ASTM D2270*	<b>169</b>	171	157

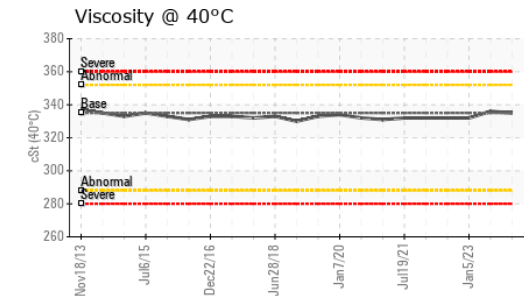

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **Vestas American Wind Technology Inc.**  
**Sample No.** : WC0824675 **Received** : 18 Aug 2023  
**Lab Number** : **02576944** **Diagnosed** : 21 Aug 2023  
**Unique Number** : 5630004 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI )

1417 NW Everett Street  
 Portland, OR  
 US 97209  
 Contact: Adam Meyer  
 admey@vestas.com  
 T: (519)983-0374  
 F: (503)327-2001

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.