




# PROBLEM SUMMARY



Sample Rating Trend

ADDITIVES

Area  
**Kingsbridge SP-13584**  
 Machine Id  
**T13 (S/N 21762)**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**CHEVRON PINNACLE WM 320 (280 LTR)**

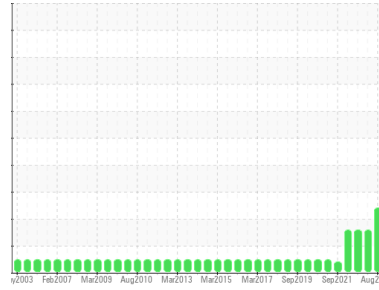

## COMPONENT CONDITION SUMMARY

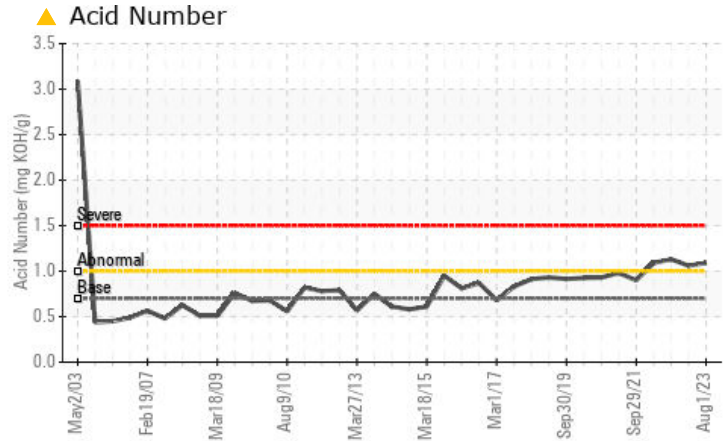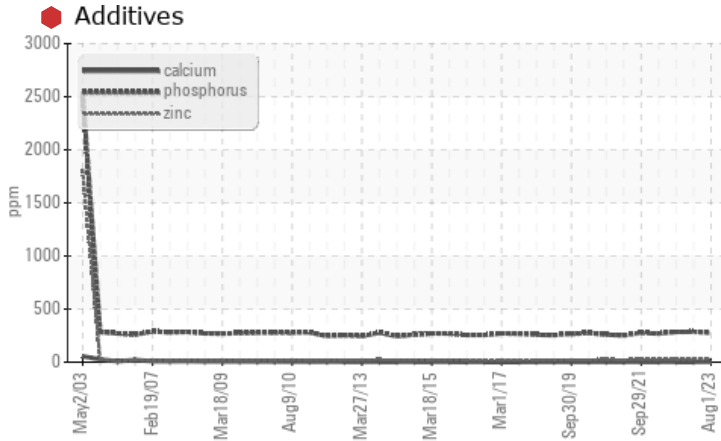

## RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	ABNORMAL	ABNORMAL
Zinc	ppm	ASTM D5185(m)	0	31	24	23
Acid Number (AN)	mg KOH/g	ASTM D974*	0.7	1.09	1.06	1.13

Customer Id: VESTAS  
 Sample No.: WC0783148  
 Lab Number: 02576950  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1  
 (289)291-4641 x4641  
[Bill.Quesnel@wearcheck.com](mailto:Bill.Quesnel@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

## HISTORICAL DIAGNOSIS

### 19 Apr 2023 Diag: Kevin Marson

#### DEGRADATION



We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is above the recommended limit. Additive levels indicate the addition of a different brand, or type of oil. The oil is no longer serviceable.

view report



### 15 Sep 2022 Diag: Bill Quesnel

#### DEGRADATION



We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is above the recommended limit. Additive levels indicate the addition of a different brand, or type of oil. The oil is no longer serviceable.

view report



### 21 Mar 2022 Diag: Kevin Marson

#### DEGRADATION



The oil is near the end of its useful service life, recommend schedule an oil change. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Additive levels indicate the addition of a different brand, or type of oil. The AN level is slightly above the recommended limit. The oil is no longer serviceable.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

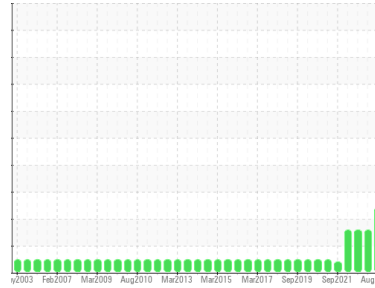

## ADDITIVES



Area  
**Kingsbridge SP-13584**  
 Machine ID  
**T13 (S/N 21762)**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**CHEVRON PINNACLE WM 320 (280 LTR)**

### DIAGNOSIS

#### Recommendation

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Fluid Condition

The AN level is above the recommended limit. Additive levels indicate the addition of a different brand, or type of oil. The oil is no longer serviceable.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0783148</b>	WC0783070	WC0305820
Sample Date	Client Info		<b>01 Aug 2023</b>	19 Apr 2023	15 Sep 2022
Machine Age	yrs	Client Info	<b>0</b>	0	0
Oil Age	yrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>SEVERE</b>	ABNORMAL	ABNORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>50	<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >75	<b>40</b>	39	38
Chromium	ppm	ASTM D5185(m) >5	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m) >10	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185(m) >15	<b>2</b>	2	2
Copper	ppm	ASTM D5185(m) >10	<b>2</b>	1	1
Tin	ppm	ASTM D5185(m) >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m) >5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185(m) 300	<b>274</b>	286	285
Zinc	ppm	ASTM D5185(m) 0	<b>31</b>	24	23
Sulfur	ppm	ASTM D5185(m) 8000	<b>6579</b>	6746	6697
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

### CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >10	<b>3</b>	2	2
Sodium	ppm	ASTM D5185(m) >10	<b>5</b>	5	5
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	1
Water	%	ASTM D6304* >0.02	<b>0.007</b>	0.004	0.006
ppm Water	ppm	ASTM D6304* >200	<b>76.4</b>	41.0	67.4

### INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	<b>2.1</b>	1.9	2.0
Sulfation	Abs/.1mm	ASTM D7415*	<b>28.2</b>	27.6	27.5

# OIL ANALYSIS REPORT


## Additives

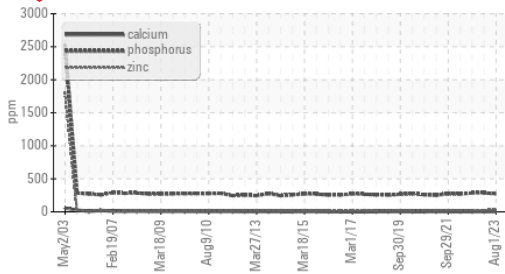


## Acid Number

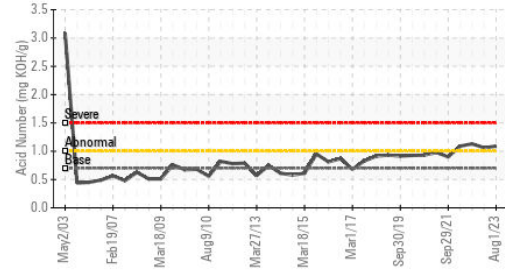


## Particle Count

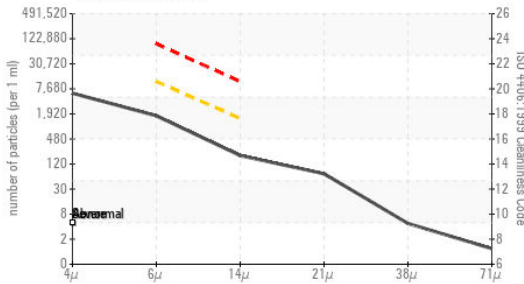

## Water

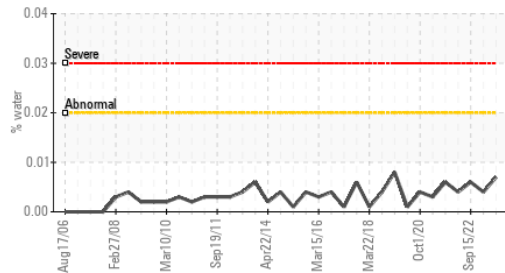

## Viscosity @ 100°C

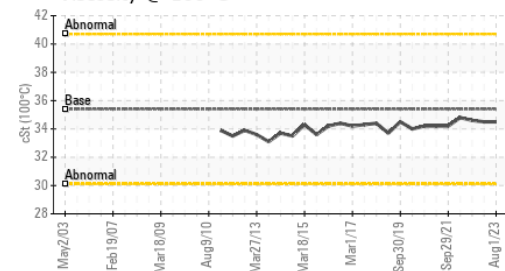


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5262</b>	219	396
Particles >6µm	ASTM D7647	>10000	<b>1517</b>	73	104
Particles >14µm	ASTM D7647	>1300	<b>169</b>	6	7
Particles >21µm	ASTM D7647	>320	<b>62</b>	2	2
Particles >38µm	ASTM D7647	>80	<b>4</b>	0	0
Particles >71µm	ASTM D7647	>20	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/20/17	<b>20/18/15</b>	15/13/10	16/14/10

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		<b>28.6</b>	28.5	28.7
Acid Number (AN)	mg KOH/g ASTM D974*	0.7	<b>▲ 1.09</b>	▲ 1.06	▲ 1.13

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>VLITE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>0.02	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	319	<b>310</b>	313	311
Visc @ 100°C	cSt ASTM D7279(m)	35.4	<b>34.5</b>	34.5	34.6
Viscosity Index (VI)	Scale ASTM D2270*	156	<b>156</b>	154	156

## SAMPLE IMAGES

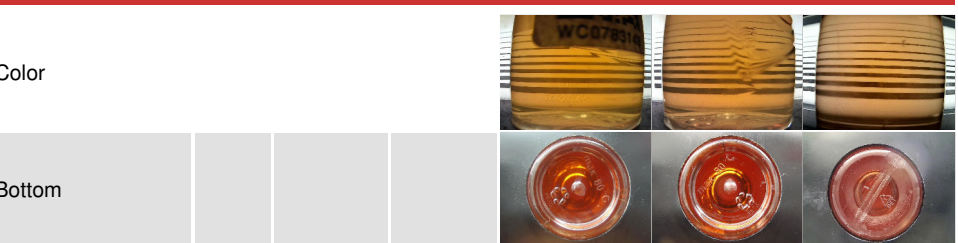

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Vestas American Wind Technology Inc.  
**Sample No.** : WC0783148 **Received** : 18 Aug 2023  
**Lab Number** : **02576950** **Diagnosed** : 23 Aug 2023  
**Unique Number** : 5630010 **Diagnostician** : Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KF, KV100, PQ, TAN Man, VI )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

1417 NW Everett Street  
 Portland, OR  
 US 97209  
 Contact: Nicole Philippi  
 NiPhi@vestas.com  
 T: (503)327-7683  
 F: (503)327-0247