




PROBLEM SUMMARY

Sample Rating Trend

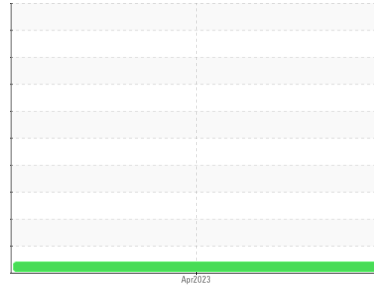


VISCOSITY



Machine Id
MONORAIL CRANE

Component
South Gearbox
Fluid
SAE 80W90 (--- GAL)

COMPONENT CONDITION SUMMARY

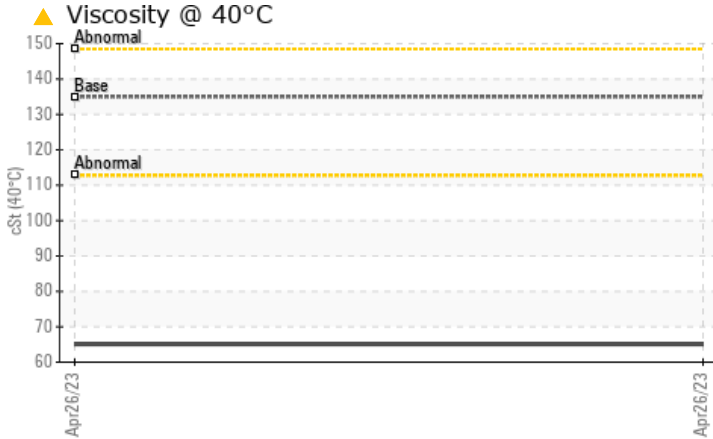

RECOMMENDATION

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	135	▲ 65.1	---	---

Customer Id: ONTNEW
 Sample No.: WC0750959
 Lab Number: 02576972
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Alert	---	---	?	Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

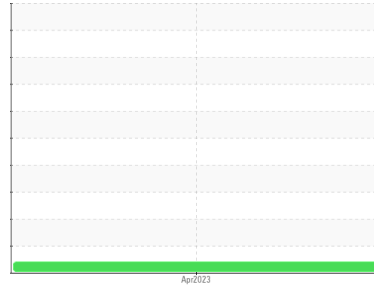

VISCOSITY



Machine Id
MONORAIL CRANE

Component
South Gearbox
Fluid
SAE 80W90 (--- GAL)

DIAGNOSIS

Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 68 range, advise investigate. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0750959	---	---
Sample Date	Client Info	26 Apr 2023	---	---
Machine Age	yrs Client Info	0	---	---
Oil Age	yrs Client Info	1	---	---
Oil Changed	Client Info	Not Chngd	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	---	---
Iron	ppm ASTM D5185(m) >200	31	---	---
Chromium	ppm ASTM D5185(m) >15	<1	---	---
Nickel	ppm ASTM D5185(m) >15	<1	---	---
Titanium	ppm ASTM D5185(m)	0	---	---
Silver	ppm ASTM D5185(m)	0	---	---
Aluminum	ppm ASTM D5185(m) >25	<1	---	---
Lead	ppm ASTM D5185(m) >100	31	---	---
Copper	ppm ASTM D5185(m) >200	26	---	---
Tin	ppm ASTM D5185(m) >25	0	---	---
Antimony	ppm ASTM D5185(m) >5	0	---	---
Vanadium	ppm ASTM D5185(m)	0	---	---
Beryllium	ppm ASTM D5185(m)	0	---	---
Cadmium	ppm ASTM D5185(m)	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 200	<1	---	---
Barium	ppm ASTM D5185(m) 0	0	---	---
Molybdenum	ppm ASTM D5185(m) 0	0	---	---
Manganese	ppm ASTM D5185(m)	<1	---	---
Magnesium	ppm ASTM D5185(m) 0	6	---	---
Calcium	ppm ASTM D5185(m) 20	16	---	---
Phosphorus	ppm ASTM D5185(m) 1000	238	---	---
Zinc	ppm ASTM D5185(m) 20	202	---	---
Sulfur	ppm ASTM D5185(m) 22000	3263	---	---
Lithium	ppm ASTM D5185(m)	<1	---	---

CONTAMINANTS




method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >50	2	---	---
Sodium	ppm ASTM D5185(m) >50	<1	---	---
Potassium	ppm ASTM D5185(m) >20	<1	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.36	---	---



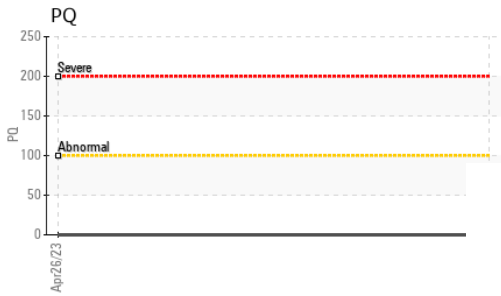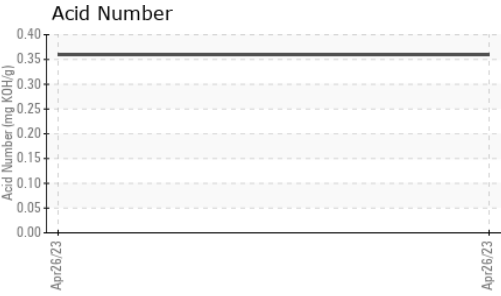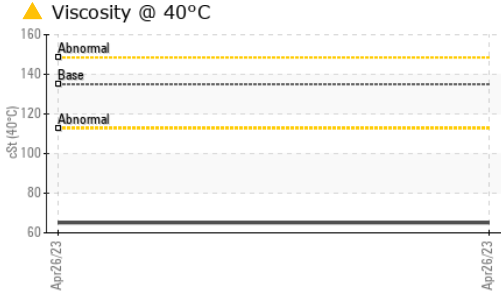

OIL ANALYSIS REPORT








VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	LIGHT	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	135 ▲ 65.1	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

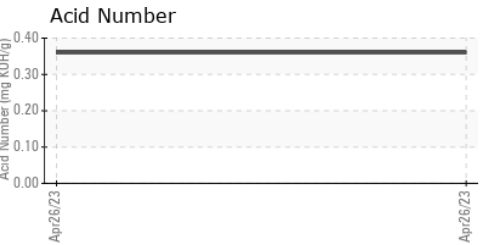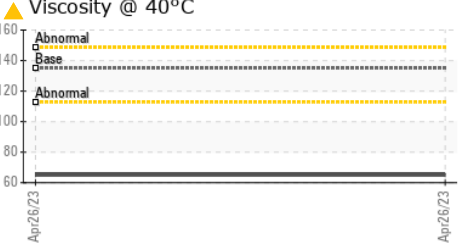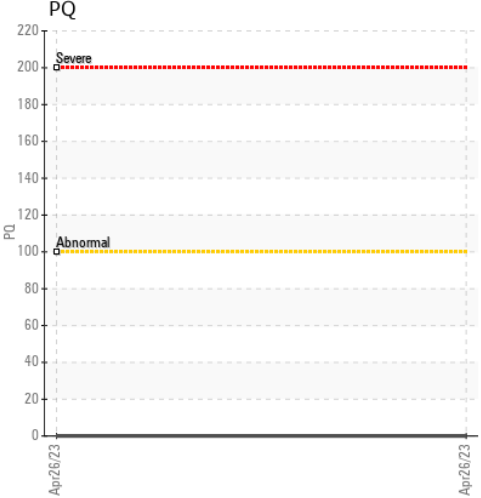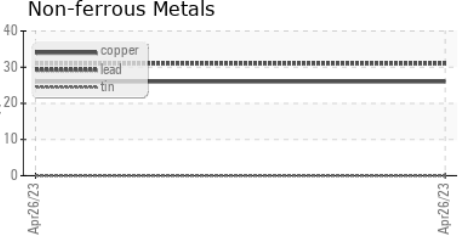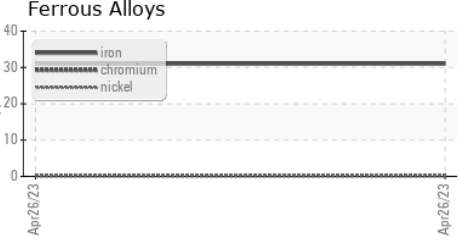

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0750959 **Received** : 18 Aug 2023
Lab Number : 02576972 **Diagnosed** : 22 Aug 2023
Unique Number : 5630032 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

Ontario Power Generation
 DYMOND WORK CENTRE, R.R. # 1, HWY #65 W
 NEW LISKEARD, ON
 CA P0J 1P0
 Contact: Aaron Brammer
 aaron.brammer@opg.com
 T: (705)648-6106
 F: (705)647-7613

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.