




OIL ANALYSIS REPORT

Sample Rating Trend

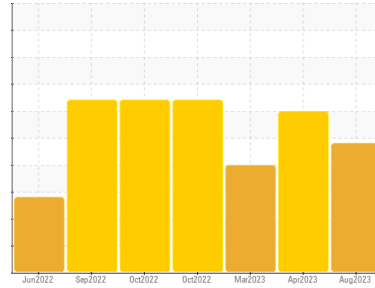

GLYCOL



Area
BRUCE B/0B/54300
Machine Id
0B-54300-EPG2-E2
Component
Diesel Engine
Fluid
SHELL ROTELLA T4 15W40 (7 GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of the coolant leak. We recommend that you drain the oil from the component if this has not already been done. We advise that you flush the component thoroughly before re-filling with oil. We recommend an early resample to monitor this condition. Please note that this is a corrected copy for diagnostic comment updates.

Wear

All component wear rates are normal.

Contamination

Test for glycol is positive. There is a moderate amount of fuel present in the oil. There is a light concentration of glycol present in the oil. The water content is negligible. Tests confirm the presence of fuel in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0642786	WC0642775	WC0642770
Sample Date	Client Info		11 Aug 2023	26 Apr 2023	28 Mar 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>100	3	2	5
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	<1
Silver	ppm	ASTM D5185(m)	>3	<1	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	<1	<1	2
Copper	ppm	ASTM D5185(m)	>330	1	<1	6
Tin	ppm	ASTM D5185(m)	>15	<1	0	1
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		193	168	164
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		<1	<1	<1
Manganese	ppm	ASTM D5185(m)		0	0	<1
Magnesium	ppm	ASTM D5185(m)		13	11	11
Calcium	ppm	ASTM D5185(m)		2024	2027	2028
Phosphorus	ppm	ASTM D5185(m)		982	941	937
Zinc	ppm	ASTM D5185(m)		1033	1000	966
Sulfur	ppm	ASTM D5185(m)		2851	2751	2799
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	16	▲ 25	▲ 36
Sodium	ppm	ASTM D5185(m)		2	2	2
Potassium	ppm	ASTM D5185(m)	>20	▲ 6	▲ 6	5
Fuel	%	ASTM D7593*	>5	▲ 5.6	▲ 4	● 11.2
Water	%	ASTM D6304*	>0.2	0.044	---	---
ppm Water	ppm	ASTM D6304*	>2000	440.0	---	---
Glycol	%	ASTM D7922*		▲ 0.019	▲ 0.01	NEG

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.0	4.7	5.3
Sulfation	Abs/1mm	ASTM D7415*	>30	21.1	20.1	22.6



OIL ANALYSIS REPORT

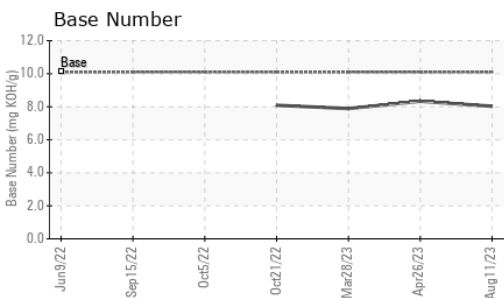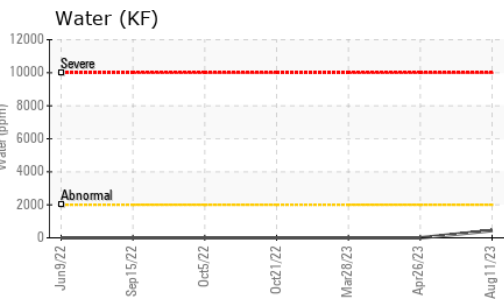
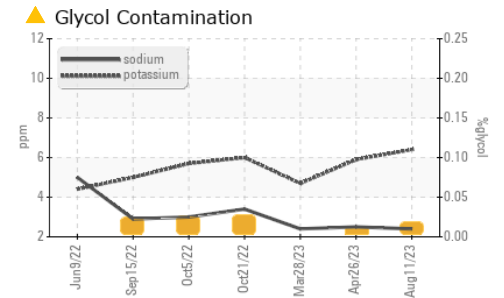
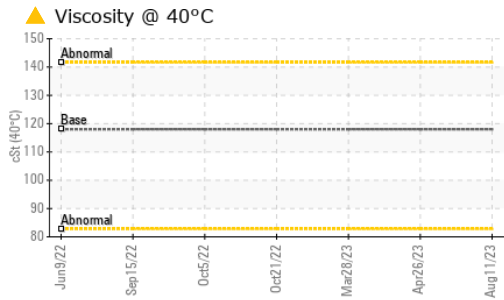
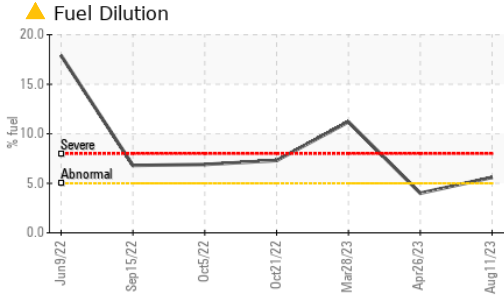


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	15.5	15.6	15.3
Acid Number (AN)	mg KOH/g	ASTM D974*		2.13	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*	10.1	8.03	8.33	7.89

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	VLITE
Yellow Metal	scalar	Visual*	NONE	NONE	---	NONE
Precipitate	scalar	Visual*	NONE	VLITE	---	NONE
Silt	scalar	Visual*	NONE	NONE	---	NONE
Debris	scalar	Visual*	NONE	NONE	---	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	---	NONE
Appearance	scalar	Visual*	NORML	NORML	---	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	118	▲ 86.5	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15	12.6	13.5	▲ 10.7
Viscosity Index (VI)	Scale	ASTM D2270*	133	142	---	---

GRAPHS

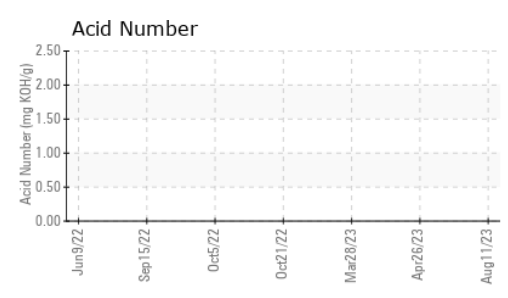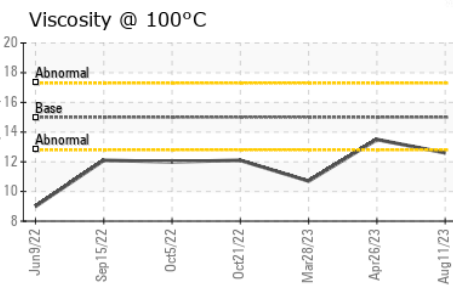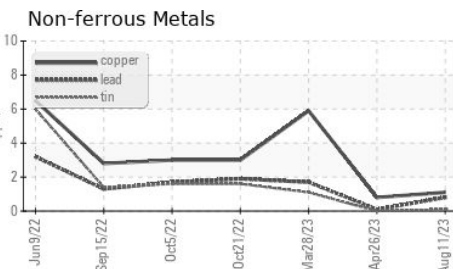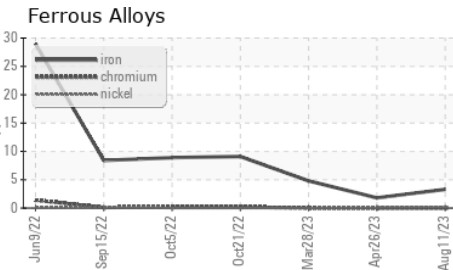

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0642786
Lab Number : 02577093
Unique Number : 5630153
Test Package : MOB 2 (Additional Tests: FUELDILUTION, Glycol, KF, KV40, PercentFuel, PftCount, Tan Auto, TAN MaContact: Bradley Mangotich

Bruce Power - Bruce A PdM
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615
 Tiverton, ON
 CA N0G 2T0
 Contact: Bradley Mangotich
 bradley.mangotich@brucepower.com
 T: (519)361-2673
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.