

PROBLEM SUMMARY

BRUCE B/5/43230


Machine Id
5-43230-P4-P IB Brg Drn

Inboard Bearing

ESSO NUTO H ISO 46 (--- GAL)



COMPONENT CONDITION SUMMARY

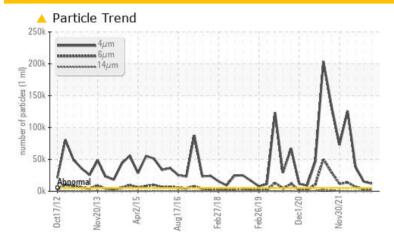

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL		
Particles >4µm	ASTM D7647	>5000	<u> </u>	<u>▲</u> 15293	<u></u> 38431		
Particles >6µm	ASTM D7647	>1300	2305	▲ 3018	<u>^</u> 7012		
Oil Cleanliness	ISO 4406 (c)	>19/17/15	<u>^</u> 21/18/14	<u>\</u> 21/19/15	<u>22/20/15</u>		

Customer Id: BRUTIV Sample No.: WC0791591 Lab Number: 02577206 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Kevin Marson +1 (289)291-4644 x4644 Kevin.Marson@wearcheck.com

To change component or sample information: Gloria Gonzalez +1 (289)291-4643 x4643 gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.
Resample			?	We recommend an early resample to monitor this condition.
Information Required			?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS

18 May 2023 Diag: Kevin Marson



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.



01 Nov 2022 Diag: Kevin Marson



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Particles >4µm are abnormally high. Particles >6µm and oil cleanliness are abnormally high. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.





12 Jul 2022 Diag: Kevin Marson
Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper ppm levels are severe. Lead and tin ppm levels are abnormal. Bearing wear is indicated. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Particles >6um are severely high. Particles >4um and oil cleanliness are severely high. Silicon ppm levels are abnormally high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.






OIL ANALYSIS REPORT

BRUCE B/5/43230 5-43230-P4-P IB Brg Drn

Inboard Bearing

ESSO NUTO H ISO 46 (--- GAL)





DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal. The directreading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.


Oil Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0791591	WC0744588	WC0711402
Sample Date		Client Info		08 Aug 2023	18 May 2023	01 Nov 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>10	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	>5	0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>5	<1	0	0
Lead	ppm	ASTM D5185(m)	>5	<1	1	<1
Copper	ppm	ASTM D5185(m)	>5	2	3	2
Tin	ppm	ASTM D5185(m)	>5	<1	<1	1
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	5	<1	<1	<1
Calcium	ppm	ASTM D5185(m)	50	53	53	53
Phosphorus	ppm	ASTM D5185(m)	330	376	368	367
Zinc	ppm	ASTM D5185(m)	410	441	422	428
Sulfur	ppm	ASTM D5185(m)	2700	5688	5635	5773
Lithium	ppm	ASTM D5185(m)		<1	<1	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>5	3	4	2
Sodium	ppm	ASTM D5185(m)		0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	<1	0
Water	%	ASTM D6304*	>0.005	0.00	0.002	0.001
ppm Water	ppm	ASTM D6304*	>50	0.00	16.3	8.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<u></u> 12008	▲ 15293	△ 38431
Particles >6µm		ASTM D7647	>1300	△ 2305	▲ 3018	▲ 7012
Particles >14µm		ASTM D7647	>320	127	163	203
Particles >21μm		ASTM D7647	>80	25	36	26
Particles >38µm		ASTM D7647	>20	1	4	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/15	△ 21/18/14	△ 21/19/15	△ 22/20/15
On Oleaniness		100 4400 (0)	/10/11/10			



OIL ANALYSIS REPORT

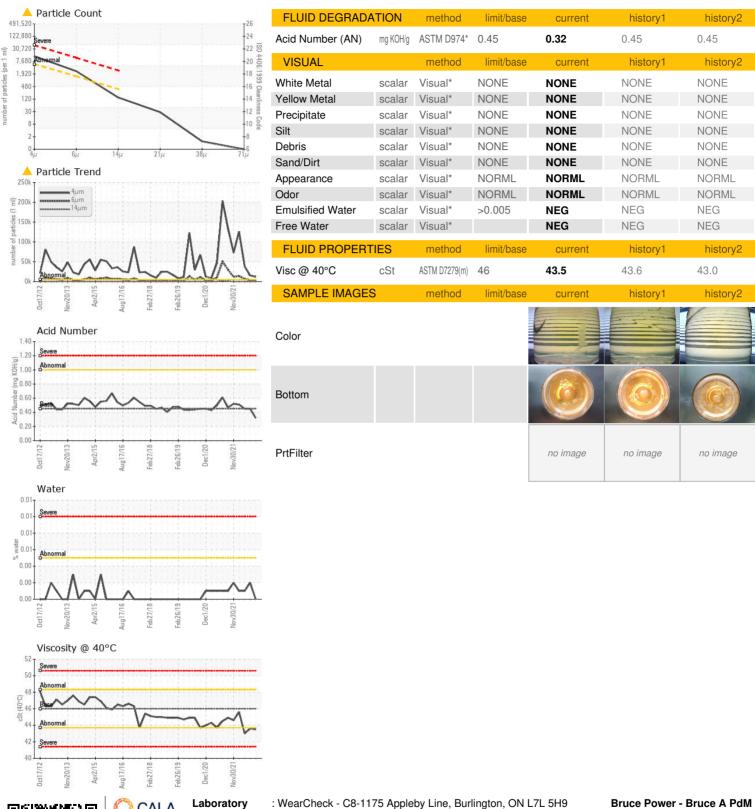



CALA ISO 17025:2017 Accredited

Laboratory Sample No. Lab Number **Unique Number**

: WC0791591

: 5630266

Received : 02577206 Diagnosed

: 21 Aug 2023 : 23 Aug 2023

Diagnostician : Kevin Marson

Bruce Power - Bruce A PdM P.O.Box 1540, 177 Tie Road,, RM-222 U2 Column 2N11 615

Tiverton, ON **CA NOG 2T0**

Test Package : IND 2 (Additional Tests: A-FERR, DR-FERR, FILTERPATCH) To discuss this sample report, contact Customer Service at 1-800-268-2131.

Contact: Pierre Adouki pierre.adouki@brucepower.com

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

T: (519)361-2673 F:

Contact/Location: Pierre Adouki - BRUTIV




FERROGRAPHY REPORT


BRUCE B/5/43230 Machine Id 5-43230-P4-P IB Brg Drn

Component
Inboard Bearing

ESSO NUTO H ISO 46 (--- GAL)








DR-FERROGRAP	НҮ	method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		1.2	2.1	6.1
Small Particles		DR-Ferr*		0.6	2.0	5.3
Total Particles		DR-Ferr*	>	1.8	4.1	11.4
Large Particles Percentage	%	DR-Ferr*		33.3	2.4	7
Severity Index		DR-Ferr*		1	0	5
FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		2	2	2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1		1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	1	1

WEAR

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.



This page left intentionally blank