




# FUEL REPORT

Sample Rating Trend

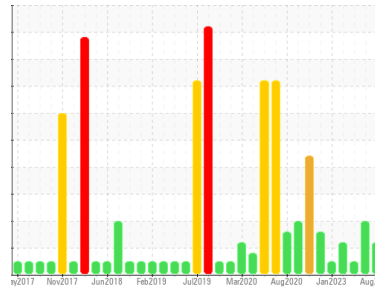

ISO



Area  
**A21**  
Machine Id  
**ADT911215 TANK RAW DIESEL NE PEDESTAL CRANE**  
Component  
**Diesel Fuel**  
Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (260000 LTR)**

## DIAGNOSIS

### Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Corrosion

{not applicable}

### Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

### Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PP13899605</b>	PP13878485	PP13857616
Sample Date	Client Info	<b>06 Aug 2023</b>	10 Jul 2023	07 May 2023
Machine Age	hrs	<b>0</b>	0	0
Sample Status		<b>ATTENTION</b>	ABNORMAL	NORMAL

## PHYSICAL PROPERTIES

method	limit/base	current	history1	history2		
Specific Gravity	ASTM D1298*	0.839	<b>0.837</b>	0.837	0.837	
Fuel Color	text	Visual Screen*	Yellow	<b>Yellow</b>	Yellow	
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	<b>2.6</b>	2.7	2.7
Pensky-Martens Flash Point	°C	ASTM D7215*	52	<b>62.4</b>	62.4	62.3

## SULFUR CONTENT

method	limit/base	current	history1	history2		
Sulfur	ppm	ASTM D5185(m)	10	<b>6</b>	7	5

## DISTILLATION

method	limit/base	current	history1	history2		
Initial Boiling Point	°C	ASTM D2887*	165	<b>173</b>	173	173
5% Distillation Point	°C	ASTM D2887*		<b>195</b>	195	195
10% Distill Point	°C	ASTM D2887*	201	<b>207</b>	206	206
15% Distillation Point	°C	ASTM D2887*		<b>215</b>	215	214
20% Distill Point	°C	ASTM D2887*	216	<b>224</b>	223	222
30% Distill Point	°C	ASTM D2887*	230	<b>240</b>	239	238
40% Distill Point	°C	ASTM D2887*	243	<b>253</b>	252	252
50% Distill Point	°C	ASTM D2887*	255	<b>266</b>	265	265
60% Distill Point	°C	ASTM D2887*	267	<b>280</b>	279	279
70% Distill Point	°C	ASTM D2887*	280	<b>294</b>	294	294
80% Distill Point	°C	ASTM D2887*	295	<b>310</b>	309	309
85% Distillation Point	°C	ASTM D2887*		<b>320</b>	320	320
90% Distill Point	°C	ASTM D2887*	310	<b>331</b>	331	331
95% Distillation Point	°C	ASTM D2887*		<b>349</b>	349	349
Final Boiling Point	°C	ASTM D2887*	341	<b>364</b>	369	372

## IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	<b>37</b>	37	37
Cetane Index	ASTM D4737*	<40.0	<b>51</b>	51	50

## CONTAMINANTS






method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)	<1.0	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)	<0.1	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185(m)	<0.1	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304*	<0.05	<b>0.002</b>	0.003	0.003
ppm Water	ppm	ASTM D6304*	<500	<b>20.2</b>	29.2	32.7

## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	<b>▲ 4057</b>	▲ 2875	947
Particles >6µm	ASTM D7647	>640	<b>▲ 1203</b>	▲ 700	274
Particles >14µm	ASTM D7647	>80	<b>77</b>	▲ 114	23
Particles >21µm	ASTM D7647	>20	<b>12</b>	▲ 43	6
Particles >38µm	ASTM D7647	>4	<b>0</b>	3	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>▲ 19/17/13</b>	▲ 19/17/14	17/15/12




# FUEL REPORT

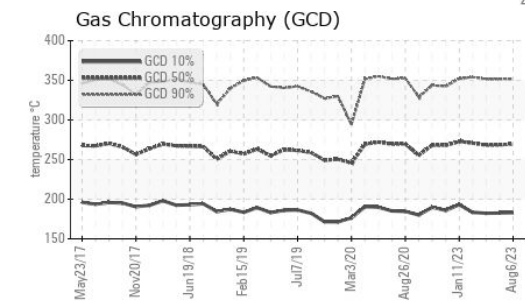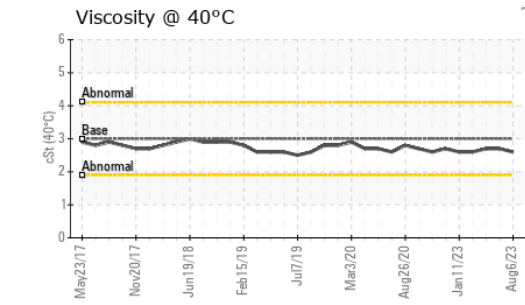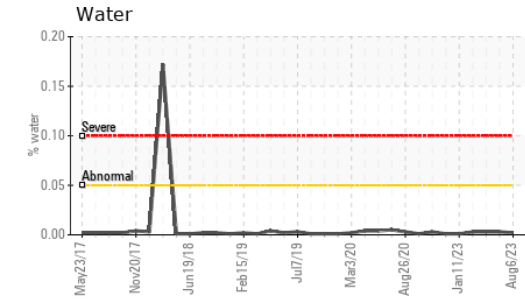
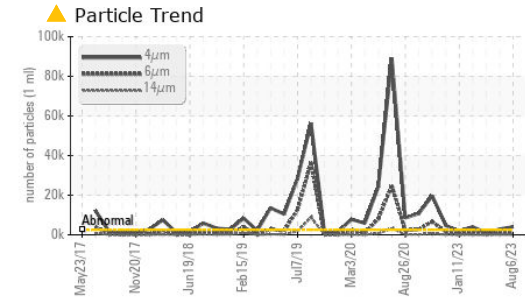
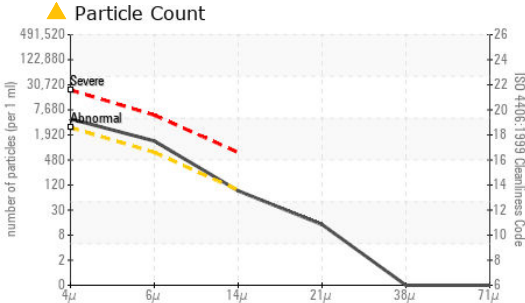


HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	0
Nickel	ppm	ASTM D5185(m)	<0.1	0	0
Lead	ppm	ASTM D5185(m)	<0.1	0	0
Vanadium	ppm	ASTM D5185(m)	<0.1	0	0
Iron	ppm	ASTM D5185(m)	<1	<1	<1
Calcium	ppm	ASTM D5185(m)	<0.1	0	<1
Magnesium	ppm	ASTM D5185(m)	<0.1	0	0
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	0
Zinc	ppm	ASTM D5185(m)	<0.1	0	<1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

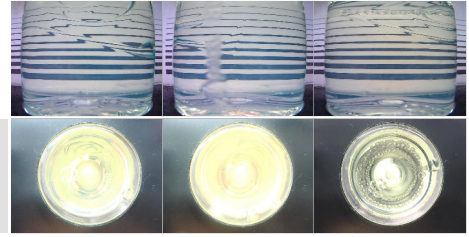

## GRAPHS

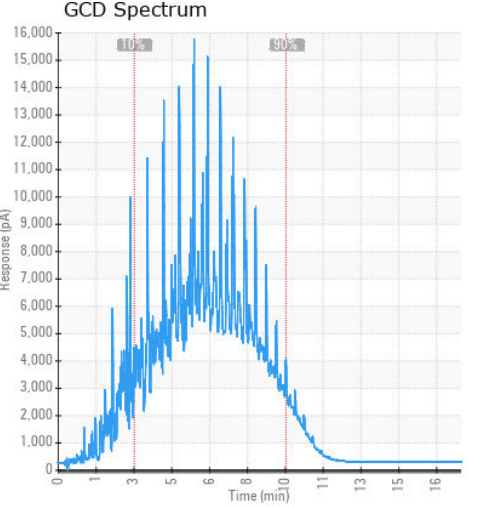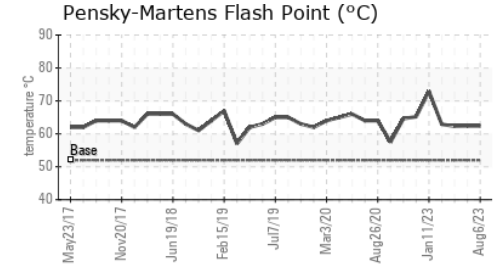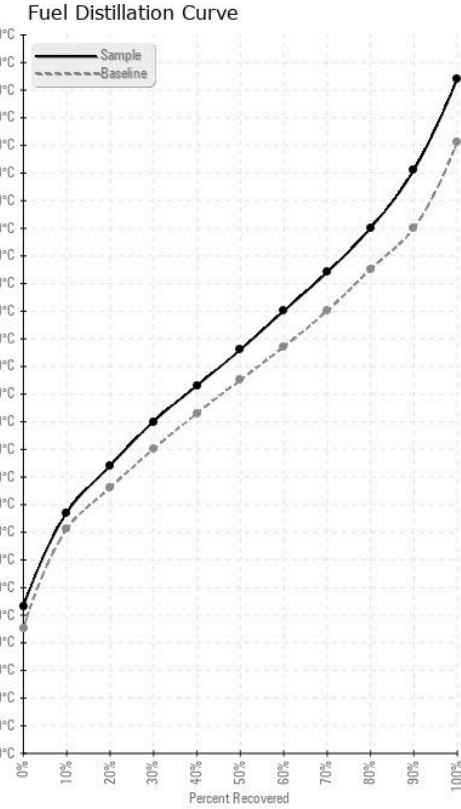

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PP13899605 **Received** : 21 Aug 2023  
**Lab Number** : 02577278 **Diagnosed** : 22 Aug 2023  
**Unique Number** : 5630338 **Diagnostician** : Kevin Marson  
**Test Package** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )

**ExxonMobil Canada East Ltd.**  
 Hebron-Materials and Repair Coordin, Suite 1000, 100 New Gow  
 St. John's, NL  
 CA A1C 6K3  
 Contact: Liam Maher  
 liam.m.maher@exxonmobil.com  
 T: (709)273-3729  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.