




OIL ANALYSIS REPORT

Sample Rating Trend

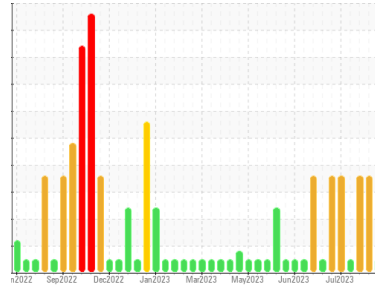

NORMAL



Machine Id
LIDM04BE (S/N GZJ00279)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (540 LTR)

DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

Le résultat pour le BN indique que la réserve d'alcalinité est acceptable pour l'huile. Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0817898	WC0817944	WC0817933
Sample Date	Client Info		21 Aug 2023	15 Aug 2023	07 Aug 2023
Machine Age	hrs	Client Info	45920	45864	45713
Oil Age	hrs	Client Info	50	636	485
Oil Changed	Client Info		Not Changed	Changed	Not Changed
Sample Status			NORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>15	2	8	4
Chromium	ppm	ASTM D5185(m)	>4	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	<1	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>5	0	0	0
Aluminum	ppm	ASTM D5185(m)	>6	2	3	3
Lead	ppm	ASTM D5185(m)	>9	0	2	2
Copper	ppm	ASTM D5185(m)	>6	<1	2	2
Tin	ppm	ASTM D5185(m)	>4	<1	2	2
Antimony	ppm	ASTM D5185(m)		<1	4	3
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		6	7	7
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		4	5	4
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		13	15	16
Calcium	ppm	ASTM D5185(m)		1706	1893	1892
Phosphorus	ppm	ASTM D5185(m)		286	284	284
Zinc	ppm	ASTM D5185(m)		285	328	331
Sulfur	ppm	ASTM D5185(m)		1740	2809	2822
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS




	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>181	26	118	110
Sodium	ppm	ASTM D5185(m)		<1	1	1
Potassium	ppm	ASTM D5185(m)	>20	2	2	2

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.1	6.4	6.1
Sulfation	Abs./1mm	ASTM D7415*	>30	17.6	26.4	25.5



OIL ANALYSIS REPORT






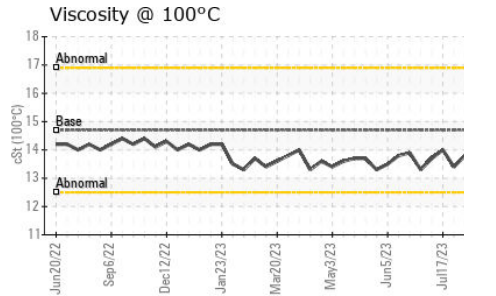
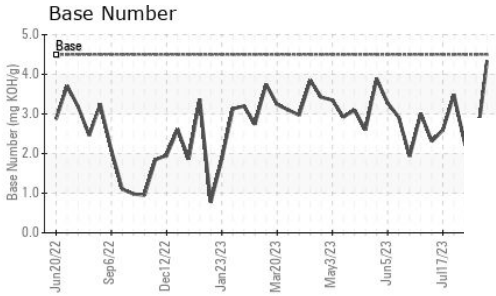
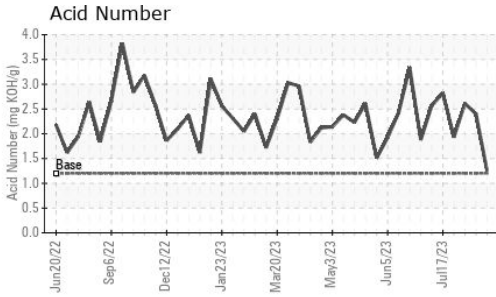


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	8.3	16.1	16.3
Acid Number (AN)	mg KOH/g	ASTM D974*	1.2	1.25	▲ 2.40	▲ 2.61
Base Number (BN)	mg KOH/g	ASTM D2896*	4.5	4.34	▲ 2.16	▲ 2.23
i-pH	Scale 0-14	ASTM D7946*	<4.5	6.08	▲ 4.31	▲ 3.93

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.7	13.3	13.8	13.8

GRAPHS

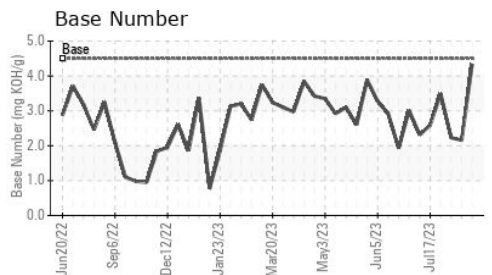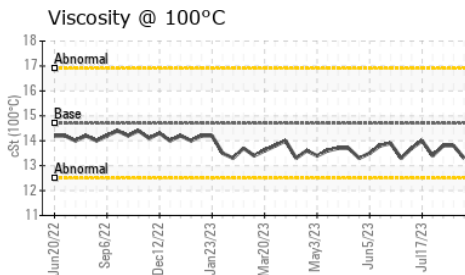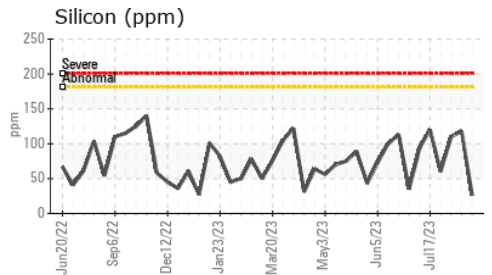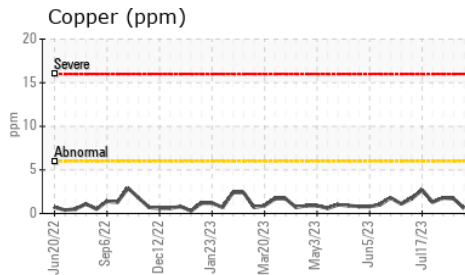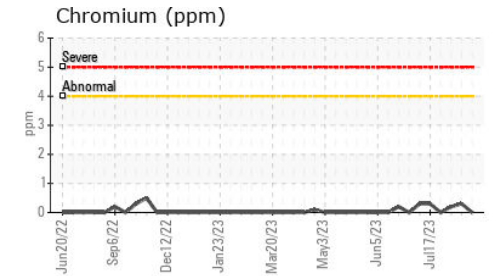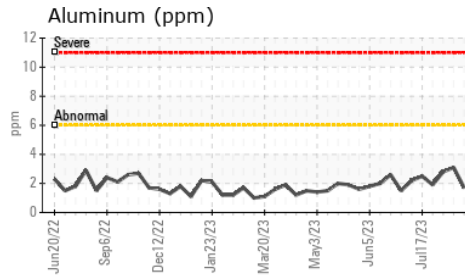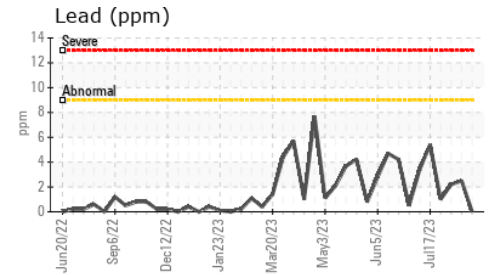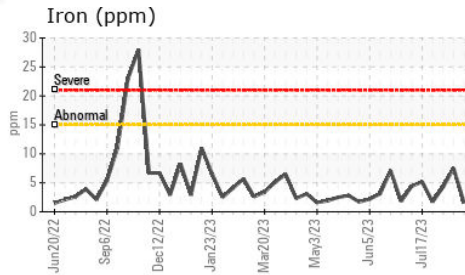

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0817898 **Received** : 22 Aug 2023
Lab Number : 02577439 **Diagnosed** : 23 Aug 2023
Unique Number : 5630499 **Diagnostician** : Kevin Marson
Test Package : MOB 2 (Additional Tests: i-pH, TAN Auto, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

EDL NA Recips-Lydia
 6985 CHEMIN DES SOURCES
 LACHUTE, QC
 CA J8H 2C5
 Contact: Eloi Legault
 eloi.legault@energydi.com
 T: (450)526-4001
 F: