




PROBLEM SUMMARY


Area
System 56 - Hazardous Drains [13884889]
 Machine Id
Z-5601A Centrifuge Gearbox Lube Oil
 Component
Gearbox
 Fluid
GEAR OIL ISO 320 (13 LTR)

Sample Rating Trend

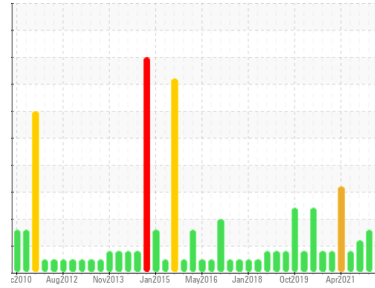

COMPONENT CONDITION SUMMARY

▲ Particle Trend

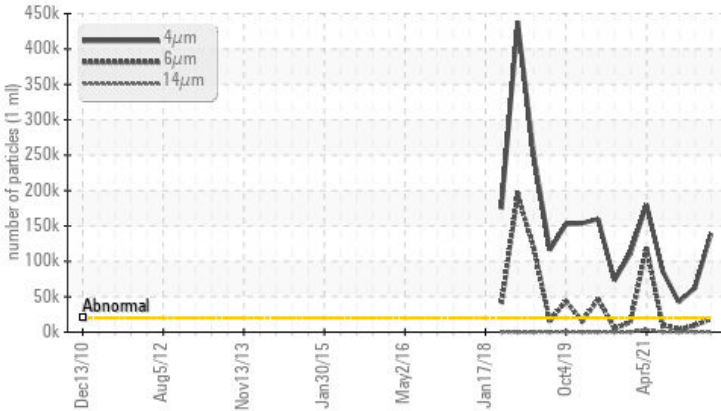

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>20000	▲ 138831	▲ 62449	▲ 42770
Particles >6µm	ASTM D7647	>5000	▲ 18584	▲ 9425	4042
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/21/15	▲ 23/20/15	▲ 23/19/14

Customer Id: HIBSTJ
 Sample No.: PP
 Lab Number: 02577585
 Test Package: MAR 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

11 Mar 2023 Diag: Kevin Marson

VISCOSITY



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Particles >4µm and oil cleanliness are abnormally high. Particles >6µm are notably high. The water content is negligible. Viscosity of sample indicates oil is within ISO 320 range, advise investigate. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



29 Dec 2022 Diag: Kevin Marson

VISCOSITY



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm and oil cleanliness are abnormally high. The water content is negligible. Viscosity of sample indicates oil is within ISO 320 range, advise investigate. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



24 Apr 2022 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are abnormally high. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

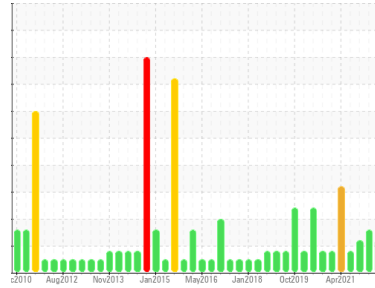

ISO



Area
System 56 - Hazardous Drains [13884889]
 Machine Id
Z-5601A Centrifuge Gearbox Lube Oil
 Component
Gearbox
 Fluid
GEAR OIL ISO 320 (13 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP	PP	PP
Sample Date	Client Info	08 Aug 2023	11 Mar 2023	29 Dec 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >150	57	21	20
Chromium	ppm	ASTM D5185(m) >10	<1	<1	<1
Nickel	ppm	ASTM D5185(m) >10	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >5	1	<1	<1
Lead	ppm	ASTM D5185(m) >65	3	2	1
Copper	ppm	ASTM D5185(m) >80	59	42	39
Tin	ppm	ASTM D5185(m) >8	2	2	2
Antimony	ppm	ASTM D5185(m) >5	0	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) 50	4	8	3
Barium	ppm	ASTM D5185(m) 15	<1	0	0
Molybdenum	ppm	ASTM D5185(m) 15	0	0	0
Manganese	ppm	ASTM D5185(m)	1	<1	<1
Magnesium	ppm	ASTM D5185(m) 50	4	3	<1
Calcium	ppm	ASTM D5185(m) 50	17	14	14
Phosphorus	ppm	ASTM D5185(m) 350	223	268	244
Zinc	ppm	ASTM D5185(m) 100	63	26	20
Sulfur	ppm	ASTM D5185(m) 12500	5124	5764	5650
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >20	4	2	2
Sodium	ppm	ASTM D5185(m)	24	2	2
Potassium	ppm	ASTM D5185(m) >20	2	<1	<1
Water	%	ASTM D6304* >0.2	0.008	0.008	0.001
ppm Water	ppm	ASTM D6304* >2000	87.9	83.2	7.3


FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	▲ 138831	▲ 62449	▲ 42770
Particles >6µm	ASTM D7647 >5000	▲ 18584	▲ 9425	4042
Particles >14µm	ASTM D7647 >640	216	268	92
Particles >21µm	ASTM D7647 >160	30	38	18
Particles >38µm	ASTM D7647 >40	1	0	1
Particles >71µm	ASTM D7647 >10	0	0	1
Oil Cleanliness	ISO 4406 (c) >21/19/16	▲ 24/21/15	▲ 23/20/15	▲ 23/19/14




OIL ANALYSIS REPORT


Particle Trend

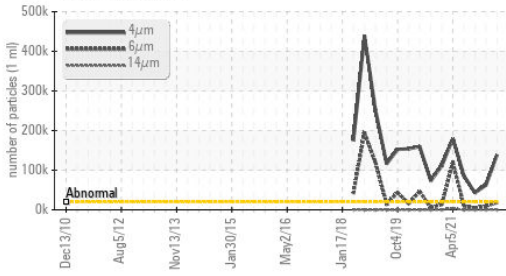


Water

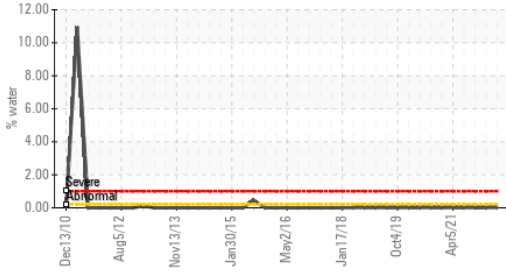


Acid Number

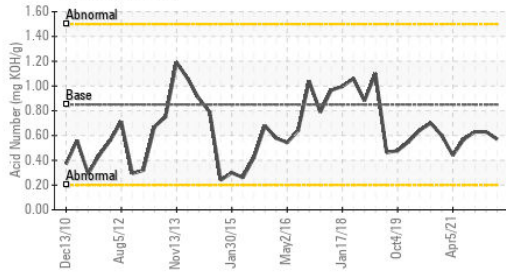

Water

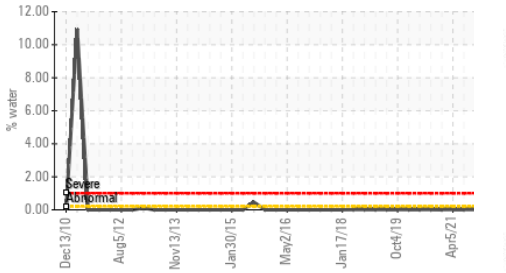

Viscosity @ 40°C

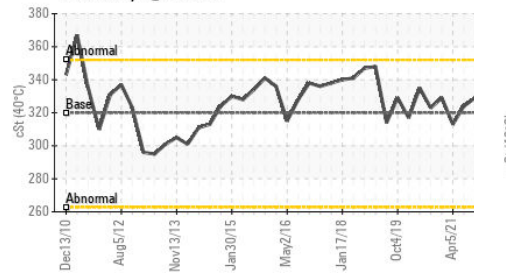


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.85	0.57	0.63	0.63

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	320	327	▲ 330	▲ 329

SAMPLE IMAGES

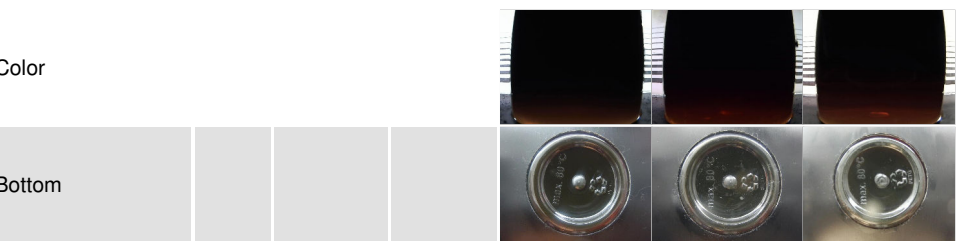


GRAPHS


Ferrous Alloys

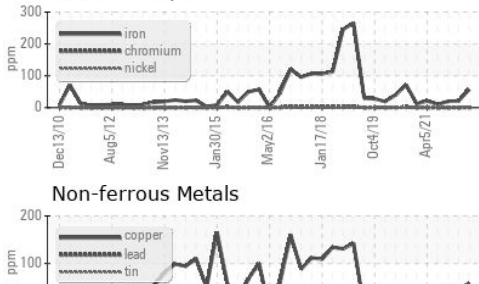


Non-ferrous Metals

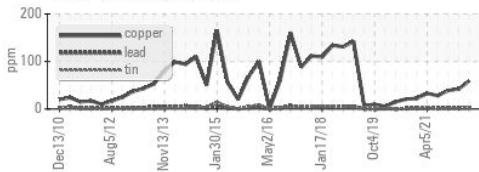


Viscosity @ 40°C

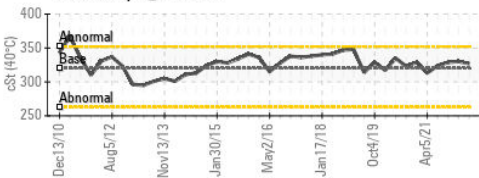

Particle Count

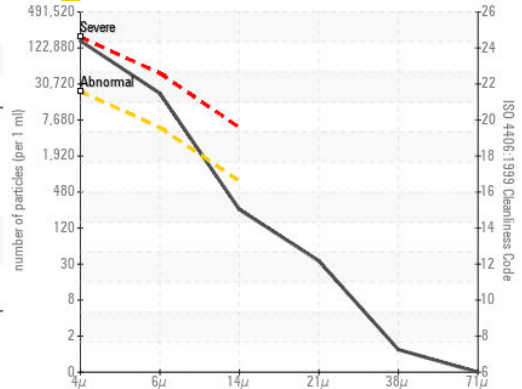

Acid Number

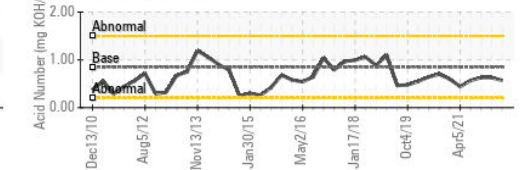

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HIBERNIA MGMT & DEVELOPMENT CO. LTD
Sample No. : PP **Received** : 22 Aug 2023
Lab Number : 02577585 **Diagnosed** : 24 Aug 2023
Unique Number : 5630645 **Diagnostician** : Wes Davis
Test Package : MAR 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

SUITE 1000,, 100 NEW GOWER STREET
 ST.JOHN'S, NL
 CA A1C 6K3
 Contact: Christopher Michelau
 christopher.j.michelau@exxonmobil.com
 T:
 F: (709)722-3766