

COOLANT REPORT

{UNASSIGNED} Machine Id KOHLER Clover Facility 35RZG

Component

Coolant

HYBRID (HOAT) COOLANT (--- GAL)

Sample Rating Trend

NORMAL

DIAGNOSIS

Recommendation

The fluid is suitable for further service. Resample at the next service interval to monitor.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.


Coolant Condition

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.

				Aug 2023		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
	MATION		IIIIIIVDase			
Sample Number		Client Info		WC0849206		
Sample Date		Client Info		10 Aug 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*		1.073		
pH	Scale 0-14	ASTM D1287*		7.75		
Nitrites	ppm	Alcan Test Kit*		520		
Reserve Alkalinity	Scale 0-20	ASTM D1121*		8.0		
Percentage Glycol	%	ASTM D3321*		54.7		
Freezing Point	°C	ASTM D3321*		-45		
Carboxylate						
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		8		
Phosphorus	ppm	ASTM D5185(m)		9		
Boron	ppm	ASTM D5185(m)		940		
Molybdenum	ppm	ASTM D5185(m)		0		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	0		
Aluminum	ppm	ASTM D5185(m)	>10	0		
Copper	ppm	ASTM D5185(m)	>10	5		
Lead	ppm	ASTM D5185(m)	>10	6		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	<1		
Zinc	ppm	ASTM D5185(m)		0		
CARRIER SALTS	;	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		7481		
Potassium	ppm	ASTM D5185(m)		742		
SCALE POTENTI	AL	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D5185(m)	>100	6		
Magnesium	ppm	ASTM D5185(m)	>40	1		
Hardness	mg/L CaCO3	In-house*	<75	19		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		Visual*		Pink		
Coolant Appearance		Visual*	Clear	Clear		
Color				1000	no image	no image
Bottom					no image	no image



COOLANT REPORT

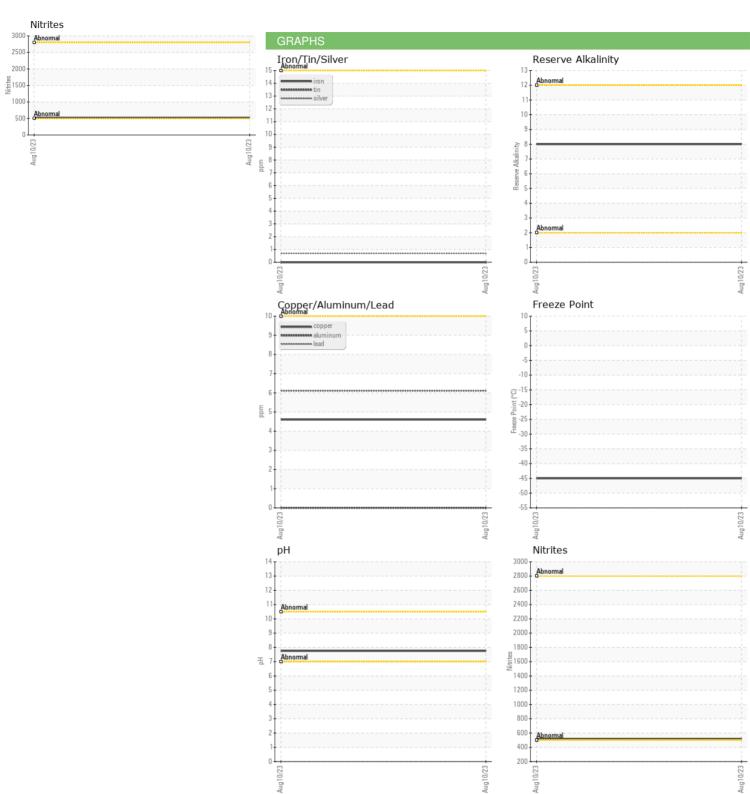



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9

: WC0849206 : 02578264 Unique Number : 5631324

Received Diagnosed

: 24 Aug 2023 : 28 Aug 2023 Diagnostician : Kevin Marson

Test Package : COOL

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

CF Industrial Products Inc.

1928 Road 3 East Kingsville, ON **CA N9Y 2E5**

Contact: Dan Hammond danh@cfgroups.com T: (519)564-2241 F: (519)322-2916