



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**FA6-6G1-TGB**

Component  
**Bearing**

Fluid  
**PETRO CANADA TURBOFLO XL46 (--- GAL)**

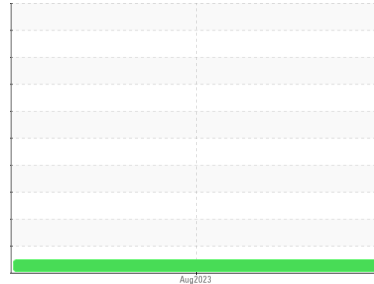

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0785272</b>	---	---
Sample Date	Client Info		<b>16 Aug 2023</b>	---	---
Machine Age	days	Client Info	<b>1456</b>	---	---
Oil Age	days	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m) >20	<b>3</b>	---	---
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185(m)	<b>1</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	<b>14</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>3</b>	---	---
Sulfur	ppm	ASTM D5185(m)	<b>805</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>2356</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>549</b>	---	---
Particles >14µm	ASTM D7647	>160	<b>25</b>	---	---
Particles >21µm	ASTM D7647	>40	<b>3</b>	---	---
Particles >38µm	ASTM D7647	>10	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>18/16/12</b>	---	---



# OIL ANALYSIS REPORT

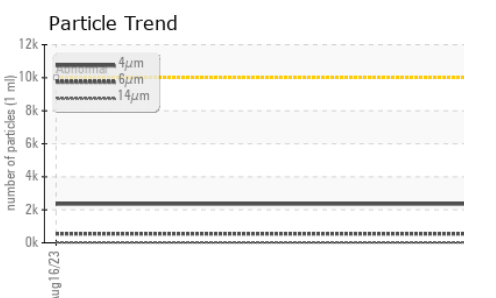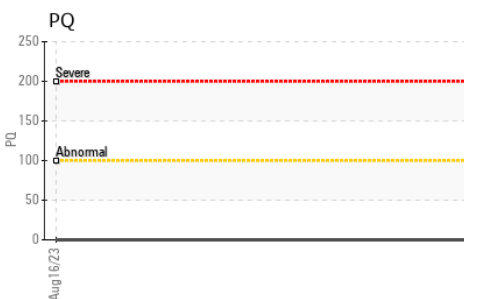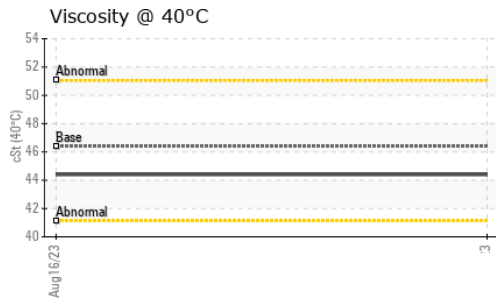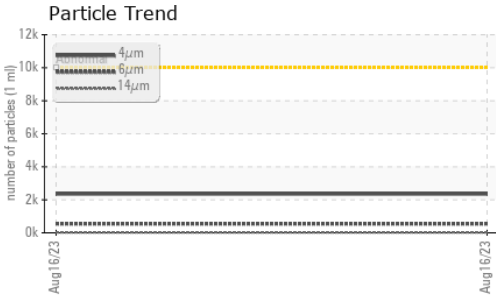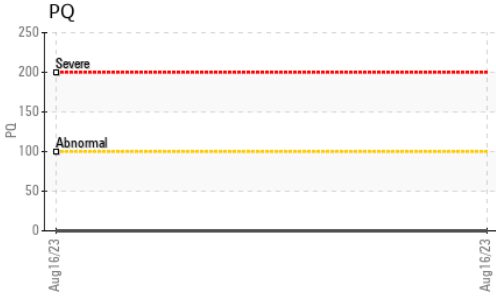

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	<b>0.02</b>	---	---





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>2	<b>NEG</b>	---	---
Free Water	scalar	Visual*		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	46.39	<b>44.4</b>	---	---

### SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

### GRAPHS

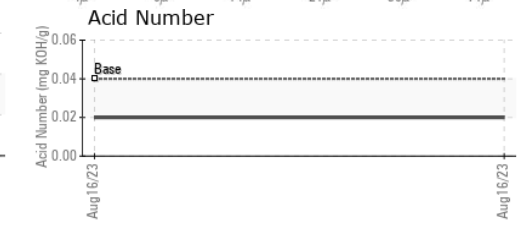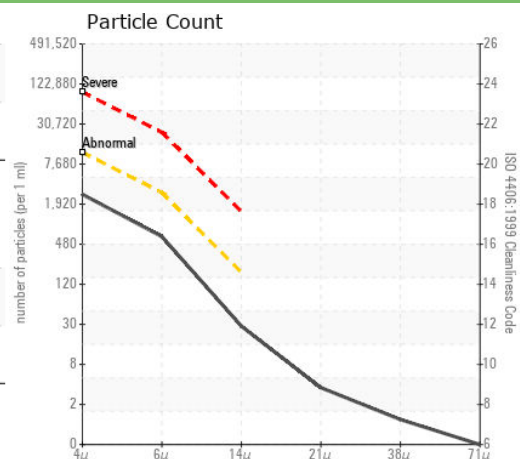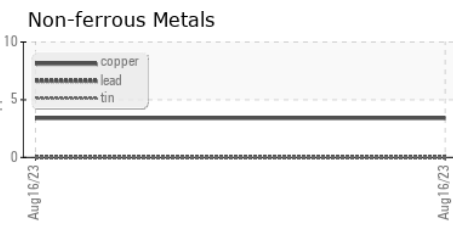

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Ontario Power Generation - Northeast Operations  
**Sample No.** : WC0785272 **Received** : 25 Aug 2023 801 MOUNTJOY ST S, BOX 966  
**Lab Number** : **02578455** **Diagnosed** : 29 Aug 2023 TIMMINS, ON  
**Unique Number** : 5631515 **Diagnostician** : Kevin Marson CA P4N 7H1  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount ) Contact: Mark Jones  
 mark.jones@opg.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.