FUEL REPORT

Sample Rating Trend

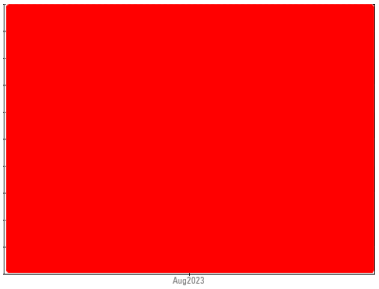

WEAR

Machine Id
TANK 3 WEST
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check all areas where contaminants can enter the system. We advise that you filter this fluid before use. We advise that you follow the water drain-off procedure for this component. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation.

Corrosion

Iron ppm levels are severe. Aluminum ppm levels are abnormal. The high metal levels indicate corrosion in the system.

Contaminants

There is a high amount of particulates (2 to 100 microns in size) present in the fuel. Excessive free water present. There is no bacteria or fungus (yeast and/or mold) present in the sample. Small amount of bacteria present. No reportable mold present. No reportable yeast present.

Fuel Condition

The fuel is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0838833**	---	---
Sample Date		Client Info		**18 Aug 2023**	---	---
Machine Age	hrs	Client Info		**0**	---	---
Sample Status				**SEVERE**	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	**0.824**	---	---
Fuel Color	text	Visual Screen*	Yllow	**Red**	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	**2.1**	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	**51.8**	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	**4**	---	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	**160**	---	---
5% Distillation Point	°C	ASTM D2887*		**181**	---	---
10% Distill Point	°C	ASTM D2887*	201	**191**	---	---
15% Distillation Point	°C	ASTM D2887*		**198**	---	---
20% Distill Point	°C	ASTM D2887*	216	**206**	---	---
30% Distill Point	°C	ASTM D2887*	230	**220**	---	---
40% Distill Point	°C	ASTM D2887*	243	**234**	---	---
50% Distill Point	°C	ASTM D2887*	255	**248**	---	---
60% Distill Point	°C	ASTM D2887*	267	**262**	---	---
70% Distill Point	°C	ASTM D2887*	280	**276**	---	---
80% Distill Point	°C	ASTM D2887*	295	**291**	---	---
85% Distillation Point	°C	ASTM D2887*		**302**	---	---
90% Distill Point	°C	ASTM D2887*	310	**312**	---	---
95% Distillation Point	°C	ASTM D2887*		**331**	---	---
Final Boiling Point	°C	ASTM D2887*	341	**349**	---	---

IGNITION QUALITY	method	limit/base	current	history1	history2
API Gravity	ASTM D1298*	37.7	**40**	---	---
Cetane Index	ASTM D4737*	<40.0	**51**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	**6**	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	**1**	---	---
Water	%	ASTM D6304*	<0.05	**0.014**	---	---
ppm Water	ppm	ASTM D6304*	<500	**140**	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	**138153**	---	---
Particles >6µm	ASTM D7647	>640	**123373**	---	---
Particles >14µm	ASTM D7647	>80	**61683**	---	---
Particles >21µm	ASTM D7647	>20	**27749**	---	---
Particles >38µm	ASTM D7647	>4	**395**	---	---
Particles >71µm	ASTM D7647	>3	**3**	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	**24/24/23**	---	---

FUEL REPORT

Particle Count

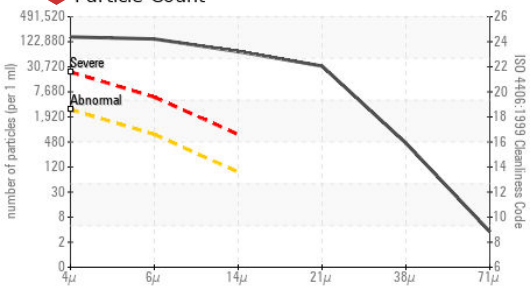

Particle Trend

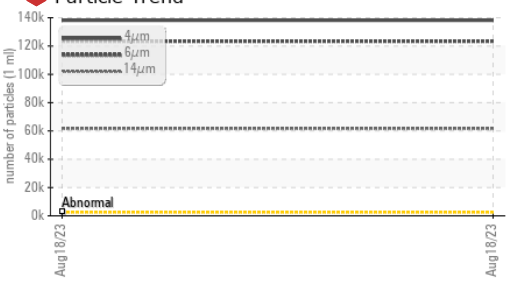

Ferrous Alloys

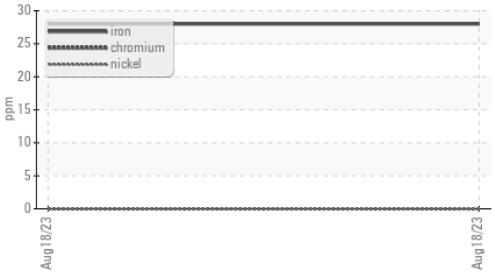

Aluminum (ppm)

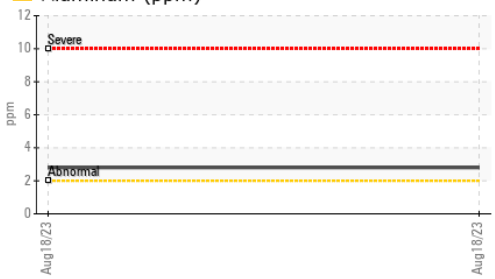

Glycol Contamination

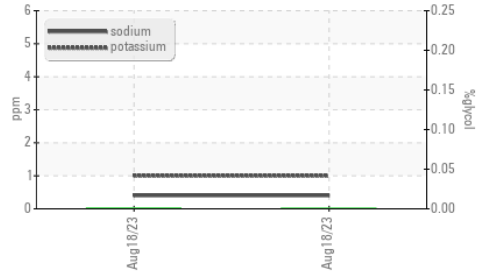

MICROBIAL		method	limit/base	current	history1	history2
Bacteria	CFU/ml	ASTM D6469*	>=100000	**100**	---	---
Yeast	CFU/ml	ASTM D6469*	>=100000	**0**	---	---
Mold	Colonies	ASTM D6469*	MODER	**NONE**	---	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	▲ **3**	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Lead	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Iron	ppm	ASTM D5185(m)	<0.1	⬢ **28**	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	**<1**	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	**0**	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	**0**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

GRAPHS

Fuel Distillation Curve

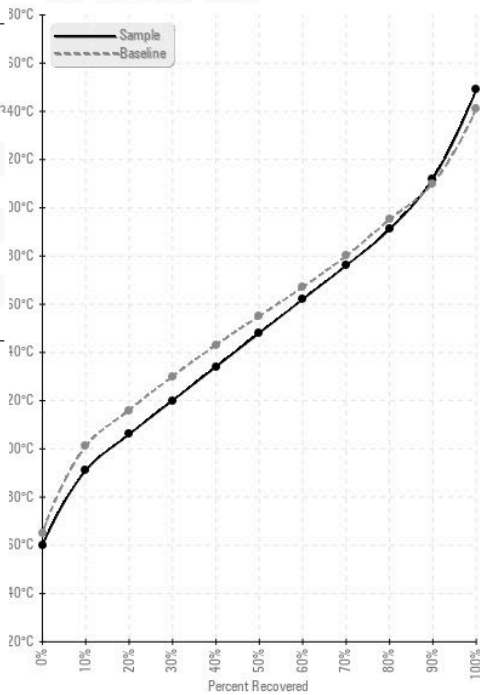

Pensky-Martens Flash Point (°C)

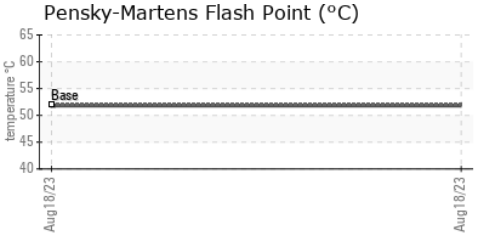

GCD Spectrum

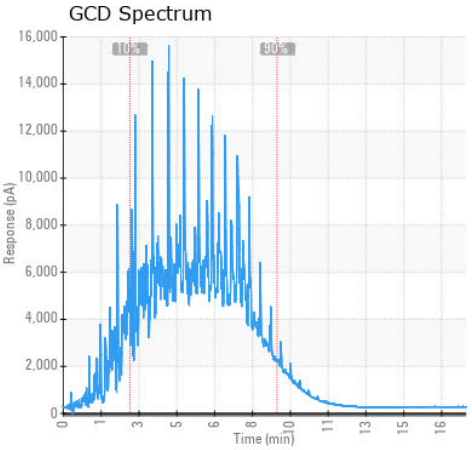

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0838833 **Received** : 25 Aug 2023
Lab Number : 02578568 **Diagnosed** : 30 Aug 2023
Unique Number : 5631628 **Diagnostician** : Kevin Marson
Test Package : FUEL (Additional Tests: Bacteria, CC Flash, GC-PercFuel, GLYCOL, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

HONEYWELL
1929 OGILVIE RD
GLOUCESTER, ON
CA K1J 0B9
Contact: Alain Guindon
joseph.guindon@cse-cst.gc.ca
T: (613)991-2659
F: