




PROBLEM SUMMARY

Sample Rating Trend

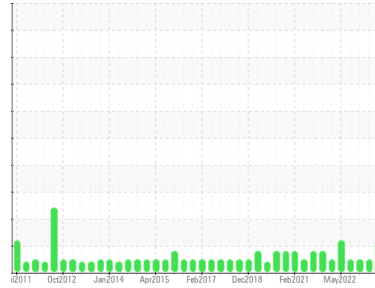


ISO



Area
SAB1
 Machine Id
SAB1 G4
 Component
Turbine Bearing
 Fluid
ESSO TERESSO ISO 46 (150 LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

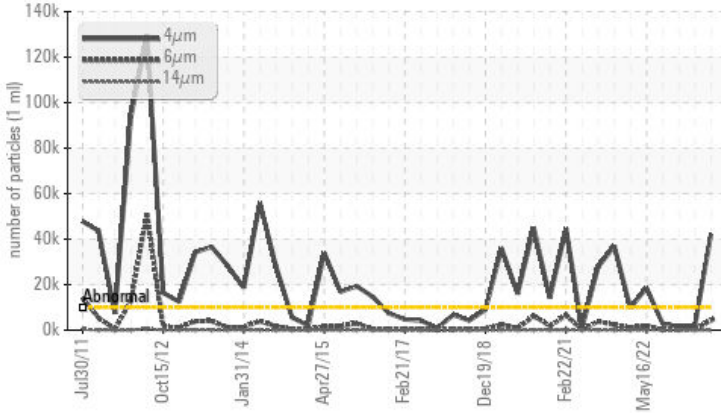

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | NORMAL | NORMAL |
|-----------------|--------------|-----------|------------|----------|----------|
| Particles >4µm | ASTM D7647 | >10000 | ▲ 42139 | 1659 | 1568 |
| Particles >6µm | ASTM D7647 | >1300 | ▲ 4254 | 543 | 236 |
| Oil Cleanliness | ISO 4406 (c) | >20/17/14 | ▲ 23/19/12 | 18/16/12 | 18/15/12 |

Customer Id: ONTQUE
 Sample No.: WC0828616
 Lab Number: 02578784
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Filter | --- | --- | ? | We recommend you service the filters on this component. |
| Resample | --- | --- | ? | We recommend an early resample to monitor this condition. |

HISTORICAL DIAGNOSIS

27 Mar 2023 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



21 Nov 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



27 Sep 2022 Diag: Kevin Marson

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

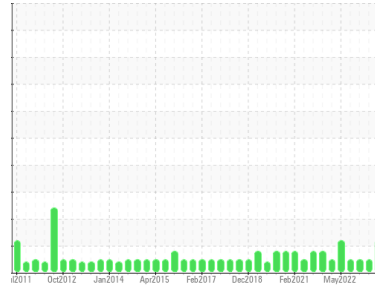

Area
SAB1
 Machine Id
SAB1 G4
 Component
Turbine Bearing
 Fluid
ESSO TERESSO ISO 46 (150 LTR)

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear
 All component wear rates are normal.

Contamination
 There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition
 The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0828616 | WC0642868 | WC0587295 |
| Sample Date | Client Info | | 27 Aug 2023 | 27 Mar 2023 | 21 Nov 2022 |
| Machine Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | ABNORMAL | NORMAL | NORMAL |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|-----------|-------------|-------------------|--------------|----------|----------|
| PQ | ASTM D8184* | | 0 | 0 | 0 |
| Iron | ppm | ASTM D5185(m) >7 | <1 | <1 | <1 |
| Chromium | ppm | ASTM D5185(m) >2 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) >2 | <1 | <1 | 0 |
| Titanium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185(m) >2 | <1 | 0 | 0 |
| Lead | ppm | ASTM D5185(m) >33 | 3 | <1 | <1 |
| Copper | ppm | ASTM D5185(m) >3 | <1 | 0 | 0 |
| Tin | ppm | ASTM D5185(m) >6 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) 0 | <1 | <1 | <1 |
| Barium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) 0 | <1 | <1 | 0 |
| Calcium | ppm | ASTM D5185(m) 0 | <1 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185(m) 2.4 | 2 | <1 | 2 |
| Zinc | ppm | ASTM D5185(m) 0 | 2 | <1 | <1 |
| Sulfur | ppm | ASTM D5185(m) | 627 | 667 | 693 |
| Lithium | ppm | ASTM D5185(m) | <1 | <1 | <1 |

CONTAMINANTS






| | method | limit/base | current | history1 | history2 |
|-----------|--------|-------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) >20 | 1 | <1 | 1 |
| Sodium | ppm | ASTM D5185(m) | 0 | 0 | <1 |
| Potassium | ppm | ASTM D5185(m) >20 | <1 | 0 | 0 |

FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-------------------|----------|----------|
| Particles >4µm | ASTM D7647 | >10000 | ▲ 42139 | 1659 | 1568 |
| Particles >6µm | ASTM D7647 | >1300 | ▲ 4254 | 543 | 236 |
| Particles >14µm | ASTM D7647 | >160 | 24 | 39 | 27 |
| Particles >21µm | ASTM D7647 | >40 | 3 | 9 | 8 |
| Particles >38µm | ASTM D7647 | >10 | 1 | 0 | 0 |
| Particles >71µm | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >20/17/14 | ▲ 23/19/12 | 18/16/12 | 18/15/12 |



OIL ANALYSIS REPORT

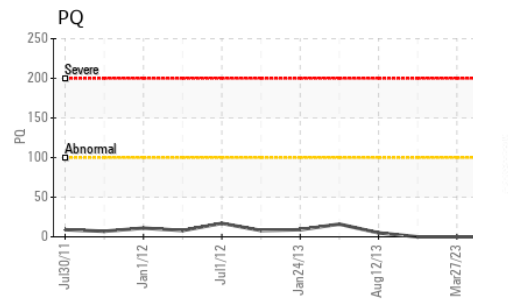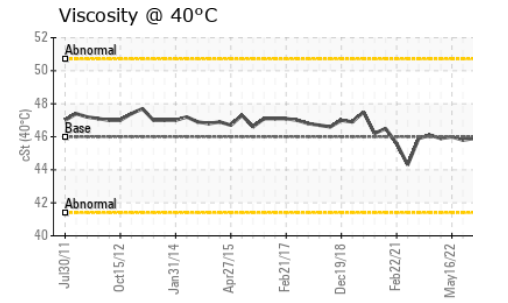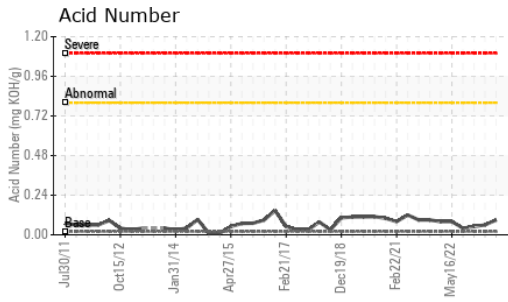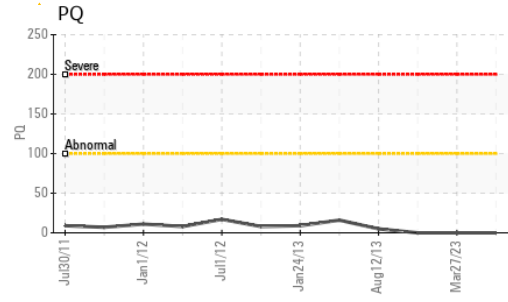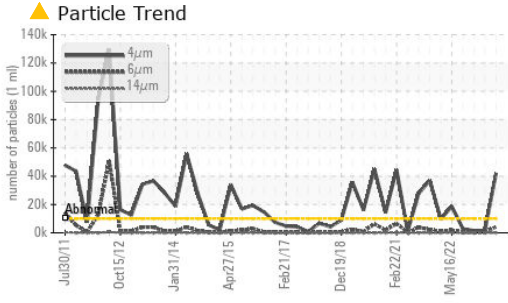


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974* | 0.02 | 0.09 | 0.06 | 0.05 |




| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | VLITE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|------------------|-----|---------------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 46 | 45.3 | 45.0 | 45.9 |

SAMPLE IMAGES

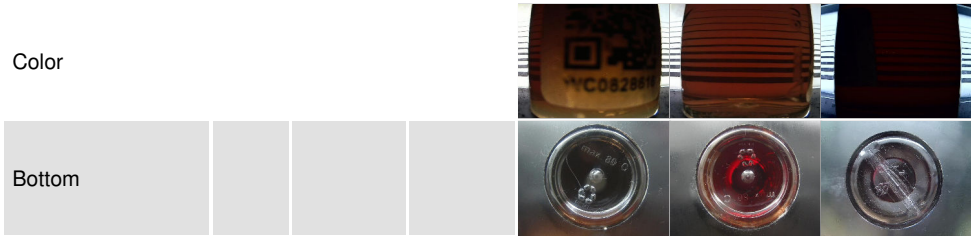

GRAPHS

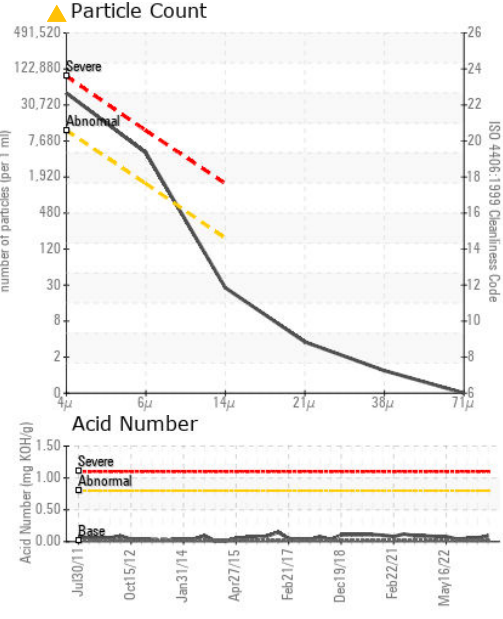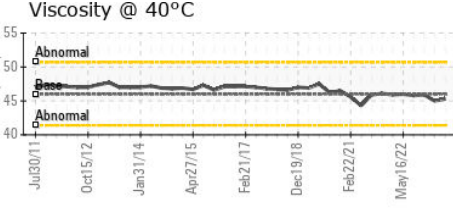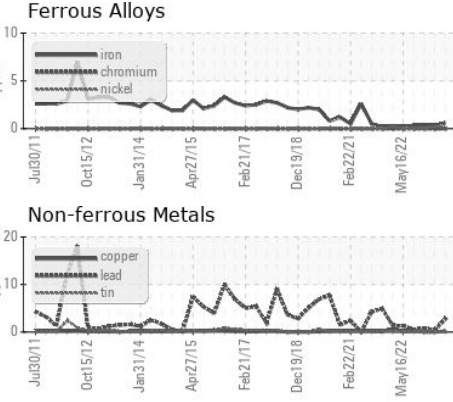

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0828616 **Received** : 28 Aug 2023
Lab Number : **02578784** **Diagnosed** : 29 Aug 2023
Unique Number : 5631844 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PQ, PrtCount, TAN Man)

Ontario Power Generation
 NIAGARA PLANT GROUP, 14000 NIAGARA PKWY
 NIAGARA ON THE LAKE, ON
 CA L0S 1J0
 Contact: Michael Brochu
 mike.brochu@opg.com
 T: (905)357-0322
 F: (905)374-5466

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.