




OIL ANALYSIS REPORT



Machine Id
LIDM06BE (S/N G2J-00165)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (540 LTR)

Sample Rating Trend

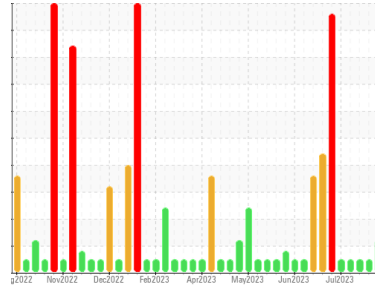

PH



DIAGNOSIS

Recommendation

Nous avons pris note que la vidange d'huile a été effectuée au moment de l'échantillonnage. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

Il n'y a aucun indice de contamination dans l'huile.

Fluid Condition

Le niveau de i-pH est anormalement bas. Le résultat pour le BN indique que la réserve d'alcalinité est acceptable pour l'huile. Le AN est acceptable pour ce fluide. l'huile ne peut plus être utilisée.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0817885	WC0817895	WC0817946
Sample Date	Client Info		28 Aug 2023	21 Aug 2023	15 Aug 2023
Machine Age	hrs	Client Info	22882	22716	22571
Oil Age	hrs	Client Info	969	798	653
Oil Changed	Client Info		Changed	Not Changd	Not Changd
Sample Status			ABNORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>15	4	3	3
Chromium	ppm	ASTM D5185(m)	>4	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>5	0	0	0
Aluminum	ppm	ASTM D5185(m)	>6	2	2	2
Lead	ppm	ASTM D5185(m)	>9	2	2	2
Copper	ppm	ASTM D5185(m)	>6	1	2	1
Tin	ppm	ASTM D5185(m)	>4	2	2	2
Antimony	ppm	ASTM D5185(m)		3	3	2
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		6	6	7
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		4	4	5
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		14	14	14
Calcium	ppm	ASTM D5185(m)		1844	1812	1771
Phosphorus	ppm	ASTM D5185(m)		271	276	267
Zinc	ppm	ASTM D5185(m)		309	304	293
Sulfur	ppm	ASTM D5185(m)		2670	2606	2320
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS




	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>181	109	98	78
Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	2	2	2

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.6	5.4	5.2
Sulfation	Abs./1mm	ASTM D7415*	>30	24.4	23.6	20.7



OIL ANALYSIS REPORT






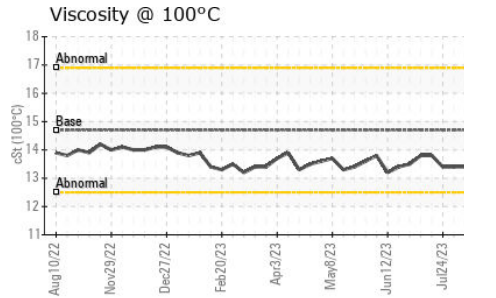
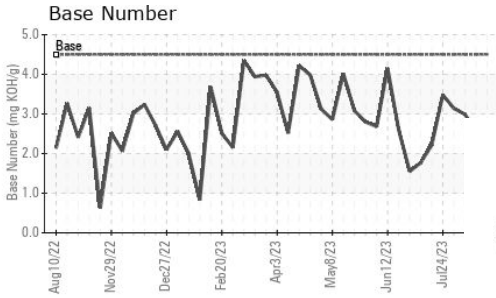
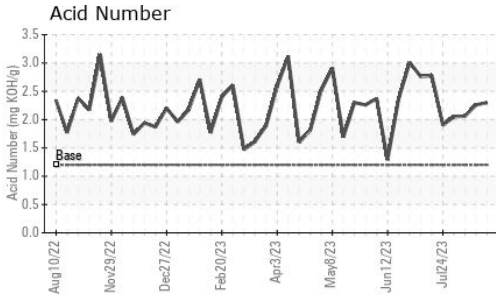


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.1	12.5	10.2
Acid Number (AN)	mg KOH/g	ASTM D974*	1.2	2.30	2.26	2.06
Base Number (BN)	mg KOH/g	ASTM D2896*	4.5	2.31	2.55	2.99
i-pH	Scale 0-14	ASTM D7946*	<4.5	▲ 4.48	4.67	5.17

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.7	13.6	13.4	13.4

GRAPHS

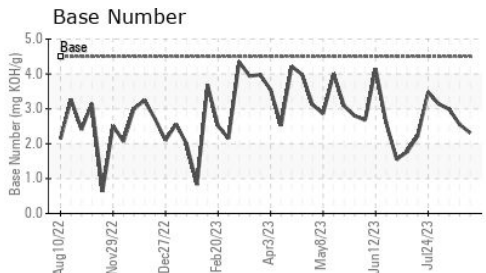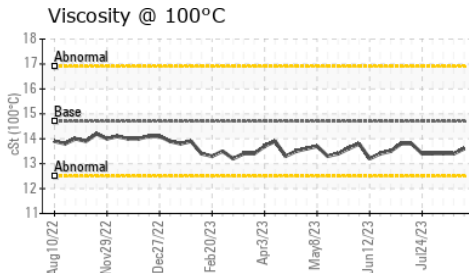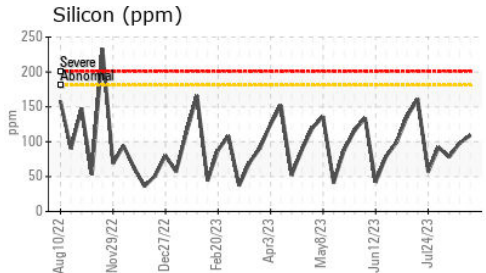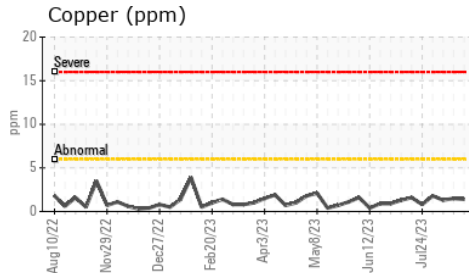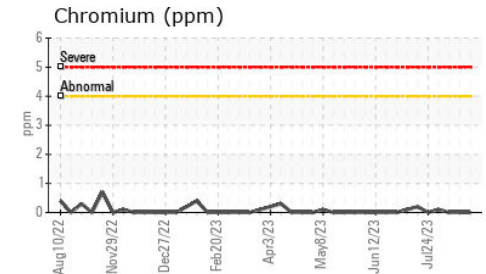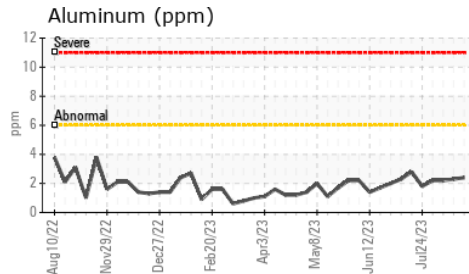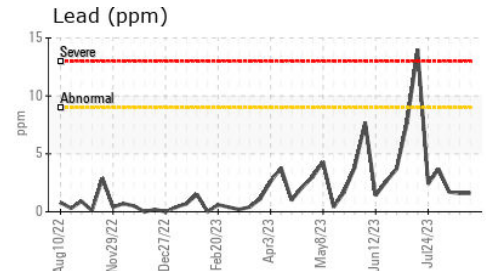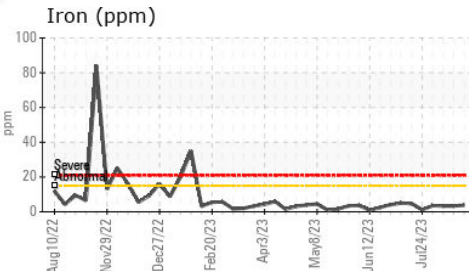

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0817885 **Received** : 29 Aug 2023
Lab Number : **02579080** **Diagnosed** : 30 Aug 2023
Unique Number : 5632140 **Diagnostician** : Kevin Marson
Test Package : MOB 2 (Additional Tests: i-pH, TAN Auto, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

EDL NA Recips-Lydia
 6985 CHEMIN DES SOURCES
 LACHUTE, QC
 CA J8H 2C5
 Contact: Eloi Legault
 eloi.legault@energydi.com
 T: (450)526-4001
 F: