



PROBLEM SUMMARY

Sample Rating Trend



ISO


Machine Id
NOR BULK

Component
New (Unused) Oil

Fluid
CHEVRON 1000 THF (780 LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

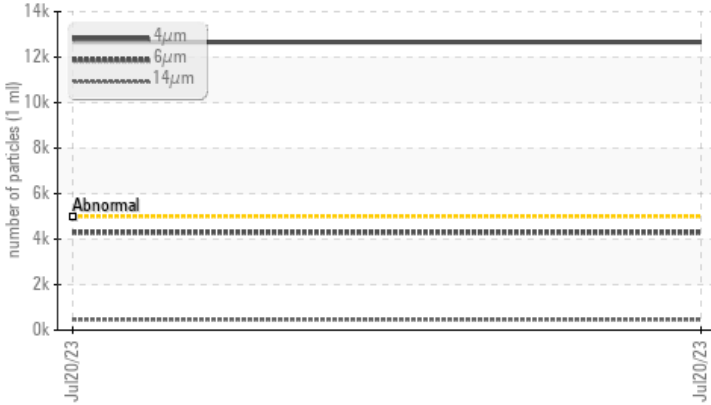

RECOMMENDATION

This is the baseline readout on this new (unused) oil. The fluid is suitable for service. We recommend an early resample to monitor this condition. NOTE: New oils are not generally filtered or guaranteed to a certain cleanliness code. We advise that you verify the target cleanliness code for your application and recommend the use of a portable filter cart to fill any system with a target code below the ISO cleanliness code of this product.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	---	---
Particles >4µm	>5000	▲ 12659	---	---	---
Particles >6µm	>1300	▲ 4296	---	---	---
Particles >14µm	>160	▲ 461	---	---	---
Particles >21µm	>40	▲ 122	---	---	---
Oil Cleanliness	>19/17/14	▲ 21/19/16	---	---	---

Customer Id: SAL364SAL
 Sample No.: WC0815332
 Lab Number: 02579101
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Alert	---	---	?	NOTE: New oils are not generally filtered or guaranteed to a certain cleanliness code. We advise that you verify the target cleanliness code for your application and recommend the use of a portable filter cart to fill any system with a target code below the ISO cleanliness code of this product.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

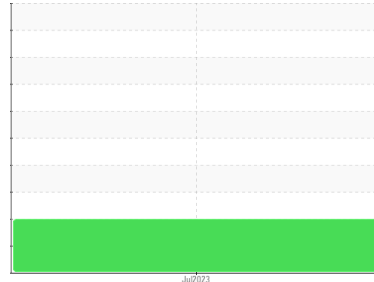

ISO



Machine Id
NOR BULK

Component

New (Unused) Oil

Fluid
CHEVRON 1000 THF (780 LTR)

DIAGNOSIS

▲ Recommendation

This is the baseline readout on this new (unused) oil. The fluid is suitable for service. We recommend an early resample to monitor this condition. NOTE: New oils are not generally filtered or guaranteed to a certain cleanliness code. We advise that you verify the target cleanliness code for your application and recommend the use of a portable filter cart to fill any system with a target code below the ISO cleanliness code of this product.

Wear

{not applicable}

▲ Contamination

There is a moderate amount of particulates (2 to 100 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for service. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0815332	---	---
Sample Date	Client Info		20 Jul 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	<1	---	---
Chromium	ppm	ASTM D5185(m)	0	---	---
Nickel	ppm	ASTM D5185(m)	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m)	<1	---	---
Lead	ppm	ASTM D5185(m)	0	---	---
Copper	ppm	ASTM D5185(m)	<1	---	---
Tin	ppm	ASTM D5185(m)	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	12	---	---
Barium	ppm	ASTM D5185(m)	0	---	---
Molybdenum	ppm	ASTM D5185(m)	4	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	23	---	---
Calcium	ppm	ASTM D5185(m)	2640	---	---
Phosphorus	ppm	ASTM D5185(m)	985	---	---
Zinc	ppm	ASTM D5185(m)	1162	---	---
Sulfur	ppm	ASTM D5185(m)	2781	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	17	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	0	---	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	---	---
Nitration	Abs/cm	ASTM D7624*	3.5	---	---
Sulfation	Abs/.1mm	ASTM D7415*	18.4	---	---



OIL ANALYSIS REPORT

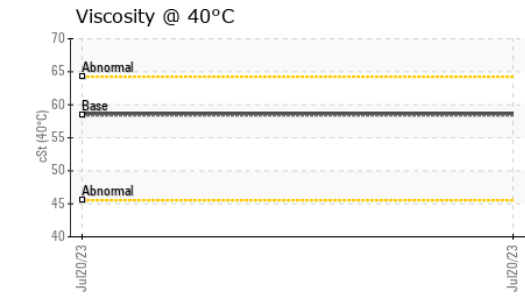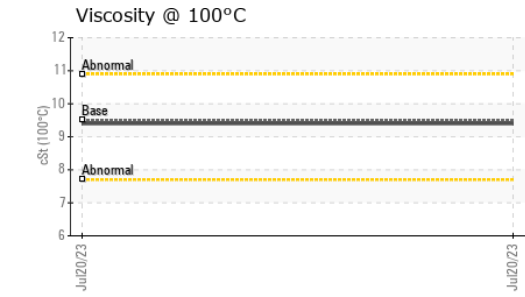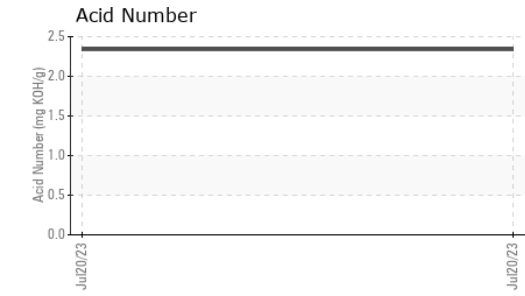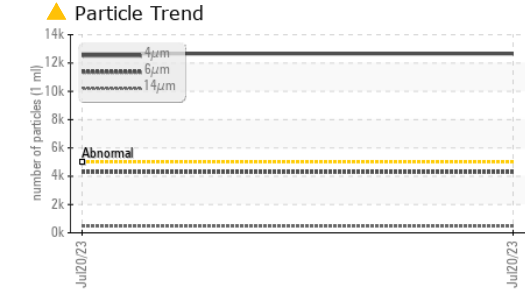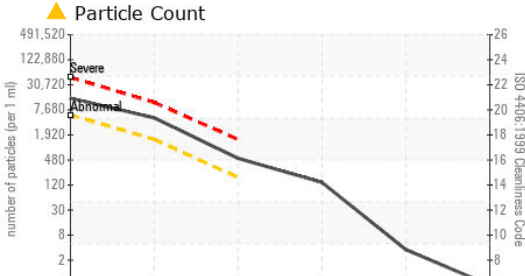

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0815332
Lab Number : 02579101
Unique Number : 5632161
Test Package : IND 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, TAN MAN, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 12659	---	---
Particles >6µm	ASTM D7647	>1300	▲ 4296	---	---
Particles >14µm	ASTM D7647	>160	▲ 461	---	---
Particles >21µm	ASTM D7647	>40	▲ 122	---	---
Particles >38µm	ASTM D7647	>10	3	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/16	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	8.6	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*	2.34	---	---

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	VLITE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	NEG	---	---	
Free Water	scalar	Visual*	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D2729(m)	58.4	58.7	---	---
Visc @ 100°C	cSt	ASTM D2729(m)	9.5	9.4	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	145	141	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image



Salford Group Inc
 364018 McBeth Rd
 Salford, ON
 CA N0J 1W0
 Contact: Chris Poppe
 chris.poppe@salfordgroup.com
 T: (519)485-3977
 F: