




OIL ANALYSIS REPORT

Sample Rating Trend

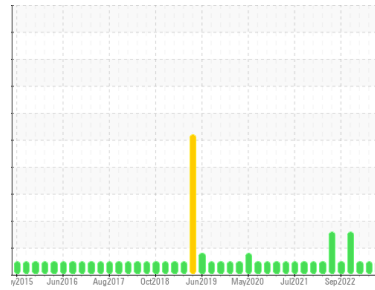

NORMAL



Area
Hydraulic System in Plant [412174458]
 Machine Id
Cooler #7/8 Main Power Pac - Maximo #3678 1000044304
 Component
Hydraulic System
 Fluid
KEYSTONE NEVASTANE AW ISO 46 (1800 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0828636	WC0807885	WC0761349
Sample Date	Client Info		08 Aug 2023	12 May 2023	15 Feb 2023
Machine Age	kms	Client Info	0	0	0
Oil Age	kms	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >20	13	12	11
Chromium	ppm	ASTM D5185(m) >10	<1	0	0
Nickel	ppm	ASTM D5185(m) >10	0	0	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >10	<1	<1	<1
Lead	ppm	ASTM D5185(m) >20	0	0	0
Copper	ppm	ASTM D5185(m) >20	<1	<1	<1
Tin	ppm	ASTM D5185(m) >10	0	<1	<1
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES




	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<1	<1	0
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	<1
Calcium	ppm	ASTM D5185(m)	<1	0	0
Phosphorus	ppm	ASTM D5185(m)	262	259	263
Zinc	ppm	ASTM D5185(m)	95	88	89
Sulfur	ppm	ASTM D5185(m)	1875	1869	1900
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	1	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	<1	<1	0



OIL ANALYSIS REPORT

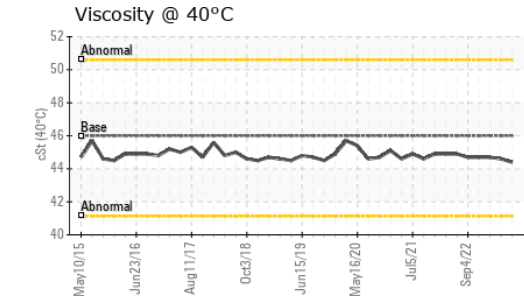
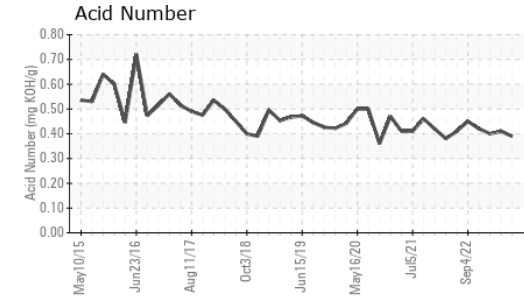
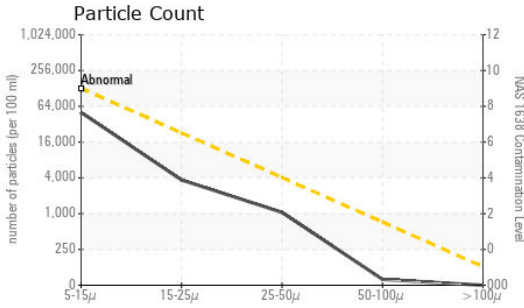





FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		---	3195	3175
Particles >6µm	ASTM D7647	>128000	---	849	894
Particles >14µm	ASTM D7647	>22800	---	67	66
Particles >21µm	ASTM D7647	>4050	---	17	20
Particles >38µm	ASTM D7647	>720	---	1	1
Particles >71µm	ASTM D7647	>128	---	0	0
Oil Cleanliness	ISO 4406 (c)	>9	---	19/17/13	19/17/13
Particles 5-15µm	count	NAS 1638 >128000	50414	---	---
Particles 15-25µm	count	NAS 1638 >22800	3687	---	---
Particles 25-50µm	count	NAS 1638 >4050	1052	---	---
Particles 50-100µm	count	NAS 1638 >720	41	---	---
Particles >100µm	count	NAS 1638 >128	0	---	---
NAS 1638	Class	NAS 1638 >9	8	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.39	0.41	0.40

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	46	44.4	44.6	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2	
Color						
Bottom						



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0828636 **Received** : 31 Aug 2023
Lab Number : **02579677** **Diagnosed** : 01 Sep 2023
Unique Number : 5632737 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PrtCountNAS)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Cargill Meat Solutions
 165 Dunlop Drive
 Guelph, ON
 CA N1L 1P4
 Contact: Jakub Posluszny
 jakub_posluszny@cargill.com
 T: (519)823-5200
 F: (519)823-5893