PROBLEM SUMMARY

Area
SAB2
Machine Id
SOUTH CRANE AUX HOIST GEARBOX
Component
Gearbox
Fluid
NOT GIVEN (--- GAL)

Sample Rating Trend

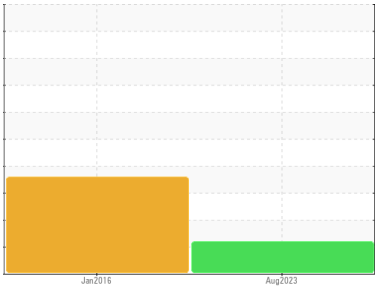

ISO

COMPONENT CONDITION SUMMARY

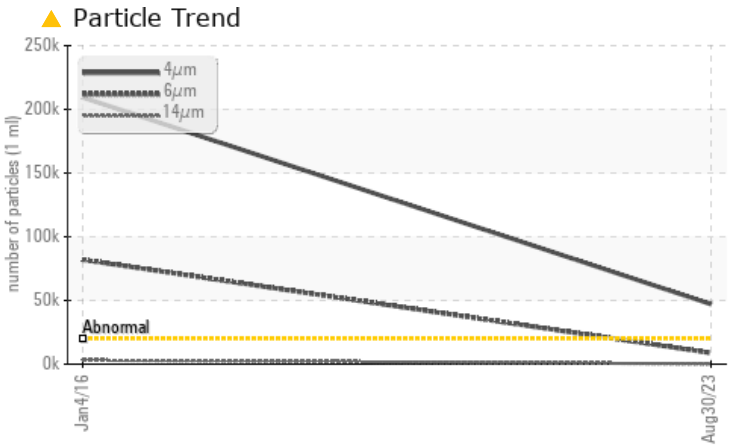

RECOMMENDATION

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	SEVERE	---
Particles >4µm		ASTM D7647	>20000	**47083**	209406	---
Particles >6µm		ASTM D7647	>5000	**8769**	81986	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	**23/20/14**	25/24/19	---

Customer Id: ONTQUE
Sample No.: WC0565989
Lab Number: 02579810
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Alert	---	---	?	Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

HISTORICAL DIAGNOSIS

ISO

04 Jan 2016 Diag: Wes Davis

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.All component wear rates are normal. Particles >6µm are severely high. Particles >4µm are severely high. Particles >14µm are abnormally high. Particles >21µm are abnormally high. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

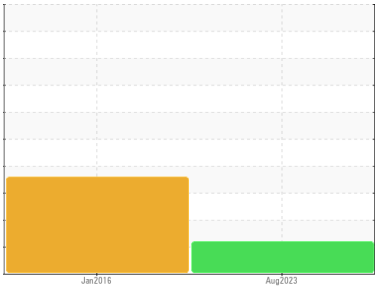

ISO

Area
SAB2
Machine Id
SOUTH CRANE AUX HOIST GEARBOX
Component
Gearbox
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0565989**	WC22112789	---
Sample Date		Client Info		**30 Aug 2023**	04 Jan 2016	---
Machine Age	yrs	Client Info		**0**	0	---
Oil Age	yrs	Client Info		**0**	0	---
Oil Changed		Client Info		**N/A**	N/A	---
Sample Status				**ABNORMAL**	SEVERE	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	---	---
Iron	ppm	ASTM D5185(m)	>200	**2**	2	---
Chromium	ppm	ASTM D5185(m)	>15	**0**	0	---
Nickel	ppm	ASTM D5185(m)	>15	**0**	<1	---
Titanium	ppm	ASTM D5185(m)		**0**	0	---
Silver	ppm	ASTM D5185(m)		**0**	0	---
Aluminum	ppm	ASTM D5185(m)	>25	**0**	<1	---
Lead	ppm	ASTM D5185(m)	>100	**17**	54	---
Copper	ppm	ASTM D5185(m)	>200	**4**	3	---
Tin	ppm	ASTM D5185(m)	>25	**0**	0	---
Antimony	ppm	ASTM D5185(m)	>5	**1**	7	---
Vanadium	ppm	ASTM D5185(m)		**0**	0	---
Beryllium	ppm	ASTM D5185(m)		**0**	0	---
Cadmium	ppm	ASTM D5185(m)		**0**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		**<1**	1	---
Barium	ppm	ASTM D5185(m)		**1**	8	---
Molybdenum	ppm	ASTM D5185(m)		**0**	<1	---
Manganese	ppm	ASTM D5185(m)		**0**	0	---
Magnesium	ppm	ASTM D5185(m)		**0**	0	---
Calcium	ppm	ASTM D5185(m)		**<1**	1	---
Phosphorus	ppm	ASTM D5185(m)		**418**	464	---
Zinc	ppm	ASTM D5185(m)		**24**	46	---
Sulfur	ppm	ASTM D5185(m)		**1916**	2073	---
Lithium	ppm	ASTM D5185(m)		**6**	50	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	**21**	24	---
Sodium	ppm	ASTM D5185(m)		**<1**	<1	---
Potassium	ppm	ASTM D5185(m)	>20	**<1**	<1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	▲ **47083**	⬢ 209406	---
Particles >6µm		ASTM D7647	>5000	▲ **8769**	⬢ 81986	---
Particles >14µm		ASTM D7647	>640	**139**	▲ 3104	---
Particles >21µm		ASTM D7647	>160	**27**	▲ 693	---
Particles >38µm		ASTM D7647	>40	**10**	49	---
Particles >71µm		ASTM D7647	>10	**9**	4	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ **23/20/14**	⬢ 25/24/19	---

OIL ANALYSIS REPORT

Particle Trend

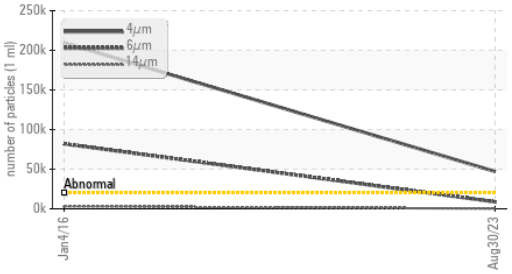

PQ

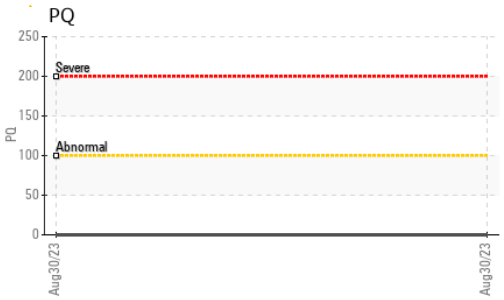

Acid Number

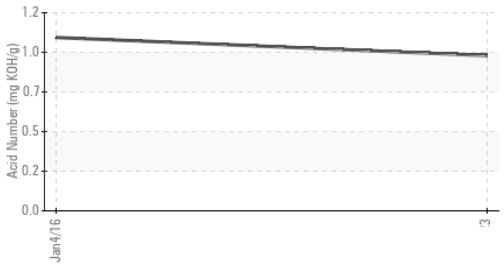

Viscosity @ 40°C

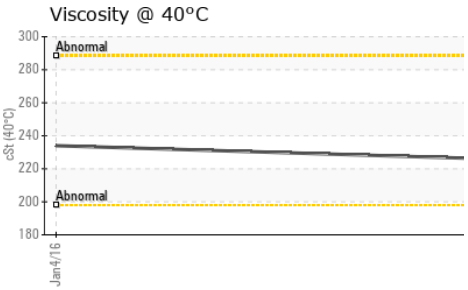

PQ

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		**0.94**	1.05	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	---
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	---
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	---
Silt	scalar	Visual*	NONE	**NONE**	NONE	---
Debris	scalar	Visual*	NONE	**VLITE**	NONE	---
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	---
Appearance	scalar	Visual*	NORML	**NORML**	NORML	---
Odor	scalar	Visual*	NORML	**NORML**	NORML	---
Emulsified Water	scalar	Visual*	>0.2	**NEG**	NEG	---
Free Water	scalar	Visual*		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)		**226**	234	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

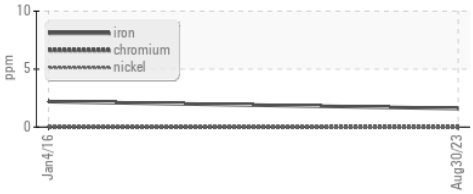

Non-ferrous Metals

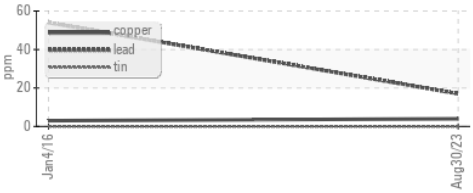

Viscosity @ 40°C

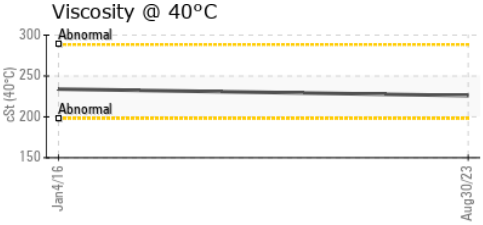

Particle Count

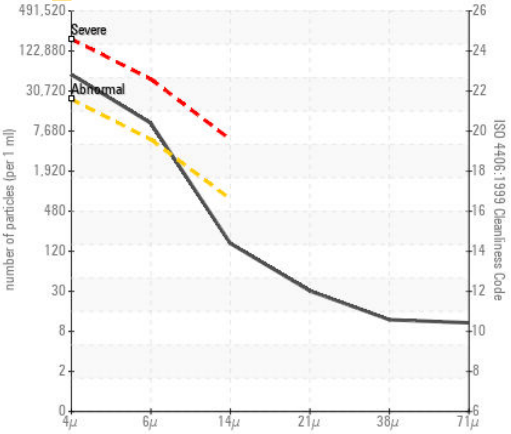

Acid Number

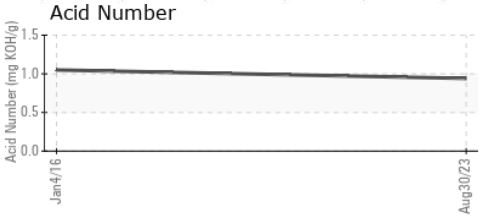

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0565989 **Received** : 31 Aug 2023
Lab Number : 02579810 **Diagnosed** : 01 Sep 2023
Unique Number : 5632870 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

Ontario Power Generation
NIAGARA PLANT GROUP,, 14000 NIAGARA PKWY
NIAGARA ON THE LAKE, ON
CA L0S 1J0
Contact: Michael Brochu
mike.brochu@opg.com
T: (905)357-0322
F: (905)374-5466