




# PROBLEM SUMMARY

Sample Rating Trend


ISO

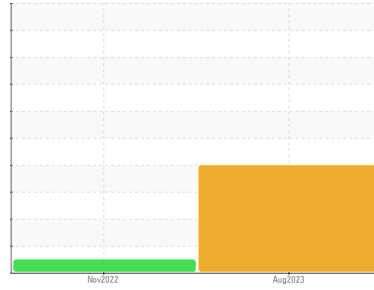

Area  
**SAB2**  
 Machine Id  
**SAB2 South Main Gearbox**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL (PAG) ISO 220 (--- LTR)**

## COMPONENT CONDITION SUMMARY

### Particle Trend

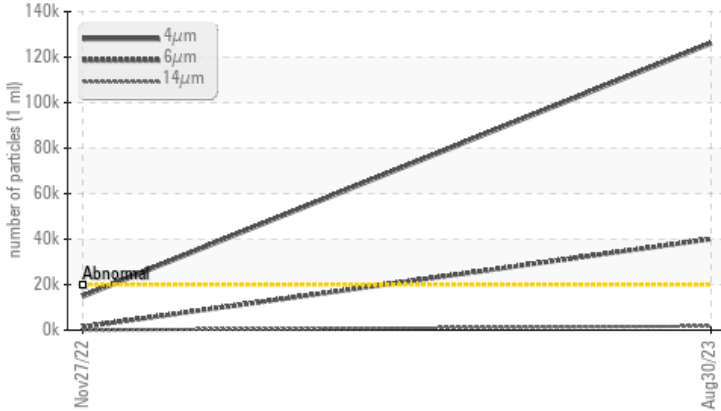

## RECOMMENDATION

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) GEAR OIL (PAG) ISO 220. Please confirm. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

## PROBLEMATIC TEST RESULTS

| Sample Status   | ASTM D7647             | SEVERE            | NORMAL   | --- |
|-----------------|------------------------|-------------------|----------|-----|
| Particles >4µm  | >20000                 | ▲ <b>126073</b>   | 14829    | --- |
| Particles >6µm  | >5000                  | ● <b>40032</b>    | 1429     | --- |
| Particles >14µm | >640                   | ▲ <b>1753</b>     | 18       | --- |
| Particles >21µm | >160                   | ▲ <b>505</b>      | 5        | --- |
| Oil Cleanliness | ISO 4406 (c) >21/19/16 | ● <b>24/23/18</b> | 21/18/11 | --- |

Customer Id: ONTQUE  
 Sample No.: WC0565988  
 Lab Number: 02579812  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

| Action               | Status | Date | Done By | Description   |
|----------------------|--------|------|---------|---|
| Change Filter        | ---    | ---  | ?       | We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.  |
| Resample             | ---    | ---  | ?       | Resample in 30-45 days to monitor this situation.   |
| Alert                | ---    | ---  | ?       | Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. |
| Information Required | ---    | ---  | ?       | NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.  |
| Check Breathers      | ---    | ---  | ?       | The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.  |
| Check Dirt Access    | ---    | ---  | ?       | We advise that you check all areas where contaminants can enter the system.   |
| Filter Fluid         | ---    | ---  | ?       | We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.  |

## HISTORICAL DIAGNOSIS

NORMAL



### 27 Nov 2022 Diag: Kevin Marson

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**SAB2**  
 Machine Id  
**SAB2 South Main Gearbox**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL (PAG) ISO 220 (--- LTR)**

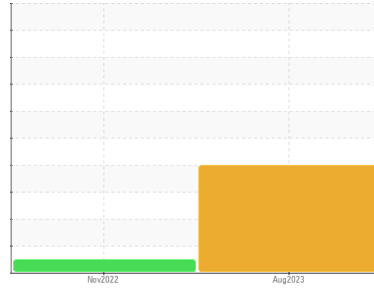

## DIAGNOSIS

### Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) GEAR OIL (PAG) ISO 220. Please confirm. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates (2 to 100 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info |             | <b>WC0565988</b>   | WC          | ---      |
| Sample Date   | Client Info |             | <b>30 Aug 2023</b> | 27 Nov 2022 | ---      |
| Machine Age   | hrs         | Client Info | <b>0</b>           | 0           | ---      |
| Oil Age       | hrs         | Client Info | <b>0</b>           | 0           | ---      |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | ---      |
| Sample Status |             |             | <b>SEVERE</b>      | NORMAL      | ---      |

## WEAR METALS

|           | method      | limit/base         | current      | history1 | history2 |
|-----------|-------------|--------------------|--------------|----------|----------|
| PQ        | ASTM D8184* |                    | <b>0</b>     | 0        | ---      |
| Iron      | ppm         | ASTM D5185(m) >200 | <b>2</b>     | 2        | ---      |
| Chromium  | ppm         | ASTM D5185(m) >15  | <b>0</b>     | 0        | ---      |
| Nickel    | ppm         | ASTM D5185(m) >15  | <b>0</b>     | 0        | ---      |
| Titanium  | ppm         | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |
| Silver    | ppm         | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |
| Aluminum  | ppm         | ASTM D5185(m) >25  | <b>&lt;1</b> | 0        | ---      |
| Lead      | ppm         | ASTM D5185(m) >100 | <b>30</b>    | 0        | ---      |
| Copper    | ppm         | ASTM D5185(m) >200 | <b>12</b>    | 0        | ---      |
| Tin       | ppm         | ASTM D5185(m) >25  | <b>1</b>     | 0        | ---      |
| Antimony  | ppm         | ASTM D5185(m) >5   | <b>0</b>     | 0        | ---      |
| Vanadium  | ppm         | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |
| Beryllium | ppm         | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |
| Cadmium   | ppm         | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |

## ADDITIVES

|            | method | limit/base         | current      | history1 | history2 |
|------------|--------|--------------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185(m) 5    | <b>&lt;1</b> | <1       | ---      |
| Barium     | ppm    | ASTM D5185(m) 5    | <b>0</b>     | 0        | ---      |
| Molybdenum | ppm    | ASTM D5185(m) 5    | <b>0</b>     | 0        | ---      |
| Manganese  | ppm    | ASTM D5185(m)      | <b>0</b>     | 0        | ---      |
| Magnesium  | ppm    | ASTM D5185(m) 5    | <b>0</b>     | 0        | ---      |
| Calcium    | ppm    | ASTM D5185(m) 5    | <b>&lt;1</b> | 0        | ---      |
| Phosphorus | ppm    | ASTM D5185(m) 775  | <b>409</b>   | 924      | ---      |
| Zinc       | ppm    | ASTM D5185(m) 5    | <b>4</b>     | 4        | ---      |
| Sulfur     | ppm    | ASTM D5185(m) 2000 | <b>2208</b>  | 214      | ---      |
| Lithium    | ppm    | ASTM D5185(m)      | <b>&lt;1</b> | <1       | ---      |

## CONTAMINANTS





|           | method | limit/base        | current      | history1 | history2 |
|-----------|--------|-------------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185(m) >50 | <b>14</b>    | 15       | ---      |
| Sodium    | ppm    | ASTM D5185(m)     | <b>&lt;1</b> | <1       | ---      |
| Potassium | ppm    | ASTM D5185(m) >20 | <b>0</b>     | 0        | ---      |

## FLUID CLEANLINESS

|                 | method       | limit/base | current           | history1 | history2 |
|-----------------|--------------|------------|-------------------|----------|----------|
| Particles >4µm  | ASTM D7647   | >20000     | <b>▲ 126073</b>   | 14829    | ---      |
| Particles >6µm  | ASTM D7647   | >5000      | <b>● 40032</b>    | 1429     | ---      |
| Particles >14µm | ASTM D7647   | >640       | <b>▲ 1753</b>     | 18       | ---      |
| Particles >21µm | ASTM D7647   | >160       | <b>▲ 505</b>      | 5        | ---      |
| Particles >38µm | ASTM D7647   | >40        | <b>21</b>         | 0        | ---      |
| Particles >71µm | ASTM D7647   | >10        | <b>2</b>          | 0        | ---      |
| Oil Cleanliness | ISO 4406 (c) | >21/19/16  | <b>● 24/23/18</b> | 21/18/11 | ---      |



# OIL ANALYSIS REPORT

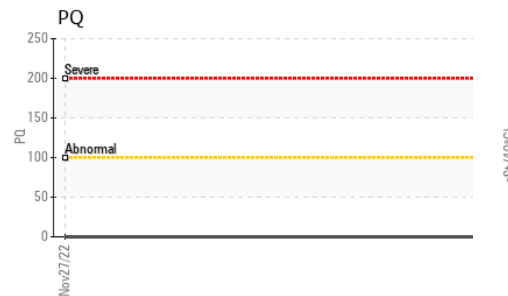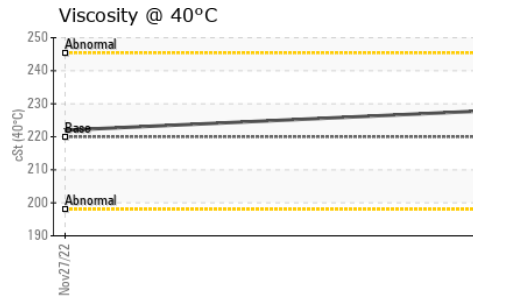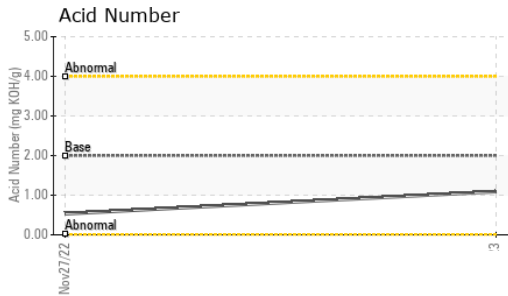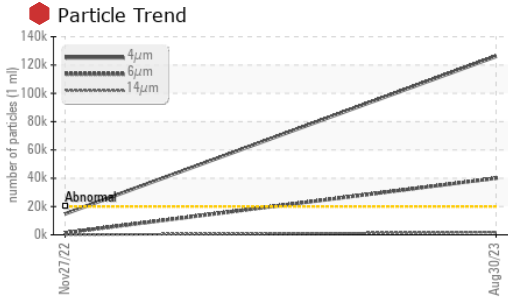


| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D974* | 2.00       | <b>1.09</b> | 0.53     | ---      |





| VISUAL           |        | method  | limit/base | current      | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal      | scalar | Visual* | NONE       | <b>NONE</b>  | NONE     | ---      |
| Yellow Metal     | scalar | Visual* | NONE       | <b>NONE</b>  | NONE     | ---      |
| Precipitate      | scalar | Visual* | NONE       | <b>NONE</b>  | NONE     | ---      |
| Silt             | scalar | Visual* | NONE       | <b>NONE</b>  | NONE     | ---      |
| Debris           | scalar | Visual* | NONE       | <b>VLITE</b> | NONE     | ---      |
| Sand/Dirt        | scalar | Visual* | NONE       | <b>NONE</b>  | NONE     | ---      |
| Appearance       | scalar | Visual* | NORML      | <b>NORML</b> | NORML    | ---      |
| Odor             | scalar | Visual* | NORML      | <b>NORML</b> | NORML    | ---      |
| Emulsified Water | scalar | Visual* | >0.2       | <b>NEG</b>   | NEG      | ---      |
| Free Water       | scalar | Visual* |            | <b>NEG</b>   | NEG      | ---      |

| FLUID PROPERTIES |     | method        | limit/base | current    | history1 | history2 |
|------------------|-----|---------------|------------|------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D7279(m) | 220        | <b>228</b> | 222      | ---      |

### SAMPLE IMAGES

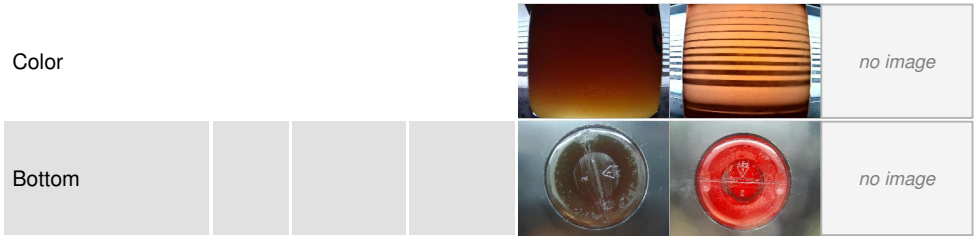

### GRAPHS

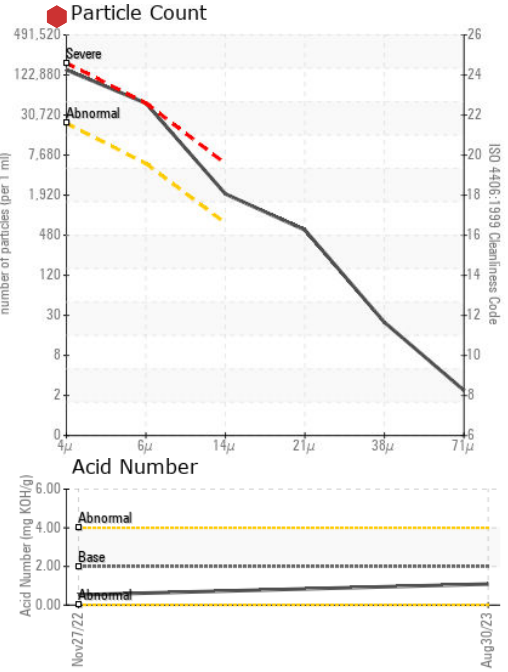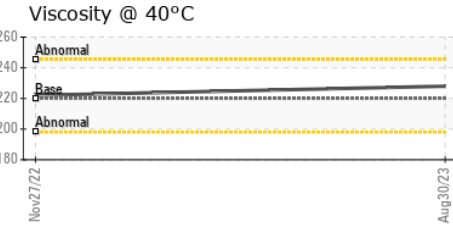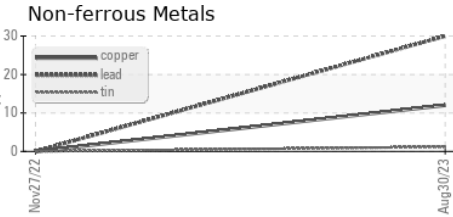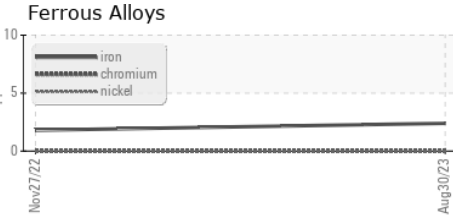

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0565988 **Received** : 31 Aug 2023  
**Lab Number** : **02579812** **Diagnosed** : 01 Sep 2023  
**Unique Number** : 5632872 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount )

**Ontario Power Generation**  
 NIAGARA PLANT GROUP, 14000 NIAGARA PKWY  
 NIAGARA ON THE LAKE, ON  
 CA L0S 1J0  
 Contact: Michael Brochu  
 mike.brochu@opg.com  
 T: (905)357-0322  
 F: (905)374-5466

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.