



PROBLEM SUMMARY

Sample Rating Trend


OFF SPEC

Area
[02437560]

Machine Id
A5 - Governor Oil Sump


Component
Governor System

Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

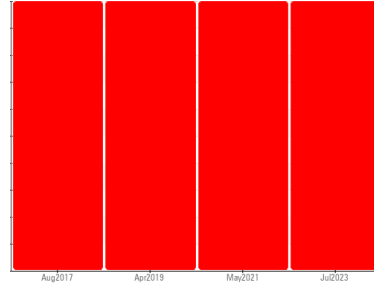


COMPONENT CONDITION SUMMARY

Water Separability

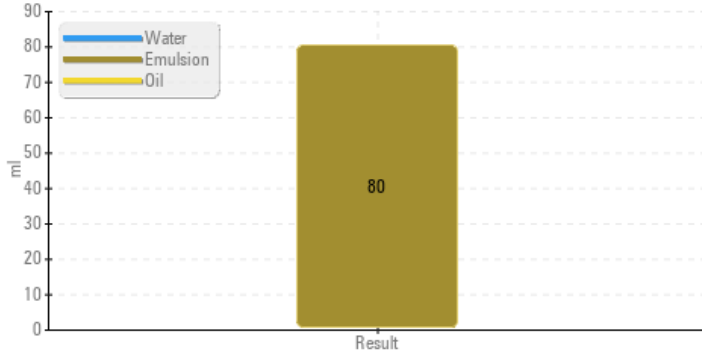

Particle Trend

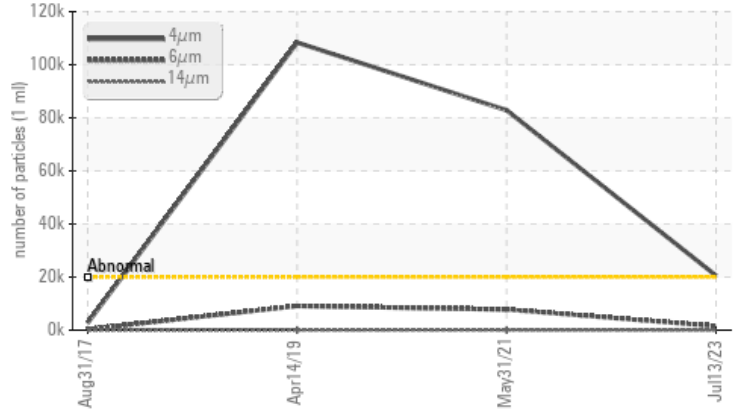

RECOMMENDATION

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you investigate the system for introduction of a surfactant to the reservoir. Some potential surfactants include incorrect oil make-up with an oil containing emulsifying agents (engine oil, compressor oil, gear oil), or soaps entering the system after wash down. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE
Particles >4µm	ASTM D7647	>20000	▲ 20550	▲ 82868	▲ 108382
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 22/18/11	▲ 24/20/12	▲ 24/20/12
Separability	oil/h2o/em	ASTM D1401*	● 0/0/80 (30)	● 1/0/79 (30)	● 1/2/77 (30)
Foam Tendency	I/II/III	ASTM D892*	▲ 550/50/460	▲ 555/60/515	▲ 530/50/400
Foam Stability	I/II/III	ASTM D892*	● 110/0/0	● 180/0/100	● 30/0/0

Customer Id: CHUCHU
 Sample No.: WC0786880
 Lab Number: 02579992
 Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Filter Fluid	---	---	?	We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability.

HISTORICAL DIAGNOSIS

OFF SPEC



31 May 2021 Diag: Kevin Marson

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you investigate the system for introduction of a surfactant to the reservoir. Some potential surfactants include incorrect oil make-up with an oil containing emulsifying agents (engine oil, compressor oil, gear oil), or soaps entering the system after wash down. We recommend you service the filters on this component. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Separability (Emulsion) % is severely high. Separability (Oil) % is severely low. Separability (Water) % is severely low. MPC Varnish Potential contamination levels are severely high. Particles >4µm are abnormally high. Particles >6µm are notably high. MPC (Membrane Patch Colorimetry) test indicates a high concentration of varnish present. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The water content is negligible. Foaming Stability (ASTM D892) results are abnormal indicating an oil foaming problem that could lead to erratic operation. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



OFF SPEC



14 Apr 2019 Diag: Bill Quesnel

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you investigate the system for introduction of a surfactant to the reservoir. Some potential surfactants include incorrect oil make-up with an oil containing emulsifying agents (engine oil, compressor oil, gear oil), or soaps entering the system after wash down. We recommend you service the filters on this component. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. We recommend an early resample to monitor this condition. Wear particle analysis indicates that the ferrous rubbing particles are noted. All other component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Separability (Emulsion) % is severely high. Separability (Oil) % is severely low. Separability (Water) % is severely low. MPC Varnish Potential contamination levels are abnormally high. Particles >4µm are abnormally high. Particles >6µm are notably high. MPC (Membrane Patch Colorimetry) test indicates a moderate concentration of varnish present. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The water content is negligible. Foaming Stability stage I (ASTM D892) result is abnormal indicating an oil foaming problem that could lead to erratic operation. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



OFF SPEC



31 Aug 2017 Diag: Bill Quesnel

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you investigate the system for introduction of a surfactant to the reservoir. Some potential surfactants include incorrect oil make-up with an oil containing emulsifying agents (engine oil, compressor oil, gear oil), or soaps entering the system after wash down. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The Air Release Value (ASTM D3427) indicates that the oil has poor deaeration properties. Foaming Stability (ASTM D892) results are abnormal indicating an oil foaming problem that could lead to erratic operation. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid.

view report






OIL ANALYSIS REPORT

Sample Rating Trend

OFF SPEC

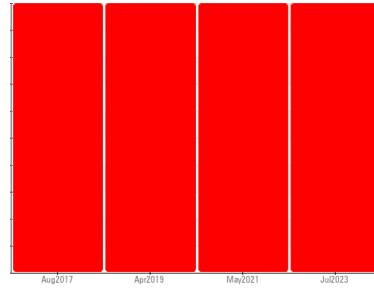

Area
[02437560]

Machine Id
A5 - Governor Oil Sump

Component
Governor System

Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

DIAGNOSIS

Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you investigate the system for introduction of a surfactant to the reservoir. Some potential surfactants include incorrect oil make-up with an oil containing emulsifying agents (engine oil, compressor oil, gear oil), or soaps entering the system after wash down. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

There is a light amount of silt (particulates < 14 microns in size) present in the oil. Water Separability results (ASTM D1401) are poor and indicate that the oil will form emulsions with water. The water content is negligible.

Oil Condition

Foaming Stability stage I (ASTM D892) result is abnormal indicating an oil foaming problem that could lead to erratic operation. Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0786880	WC0308134	WC
Sample Date	Client Info		13 Jul 2023	31 May 2021	14 Apr 2019
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	11
Iron	ppm	ASTM D5185(m) >50	2	6	7
Chromium	ppm	ASTM D5185(m) >10	0	0	0
Nickel	ppm	ASTM D5185(m) >10	0	<1	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >3	<1	0	0
Lead	ppm	ASTM D5185(m) >75	<1	<1	<1
Copper	ppm	ASTM D5185(m) >15	<1	<1	<1
Tin	ppm	ASTM D5185(m) >55	0	0	0
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	<1
Magnesium	ppm	ASTM D5185(m)	<1	<1	<1
Calcium	ppm	ASTM D5185(m) 0	1	1	2
Phosphorus	ppm	ASTM D5185(m) 3	3	3	4
Zinc	ppm	ASTM D5185(m) 0	2	1	2
Sulfur	ppm	ASTM D5185(m)	84	79	80
Lithium	ppm	ASTM D5185(m)	<1	<1	0

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >8	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	0	<1	<1
Water	%	ASTM D6304* >0.1	0.003	0.001	0.00
ppm Water	ppm	ASTM D6304* >1000	30.0	6.5	0.00

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0	0
Nitration	Abs/cm	ASTM D7624*	1.7	1.6	2.0
Sulfation	Abs/.1mm	ASTM D7415*	12.4	11.4	12.3

OIL ANALYSIS REPORT


Foaming SEQ I/II/III

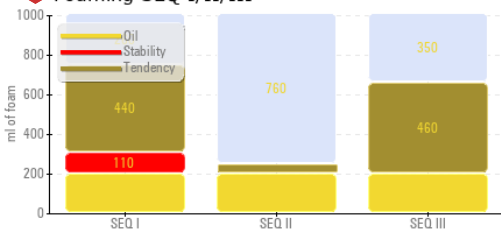


Water Separability

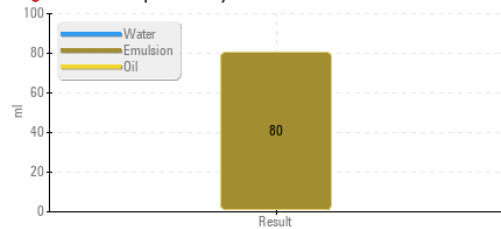


Particle Count

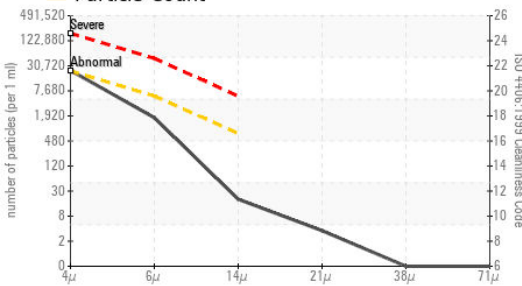

Particle Trend

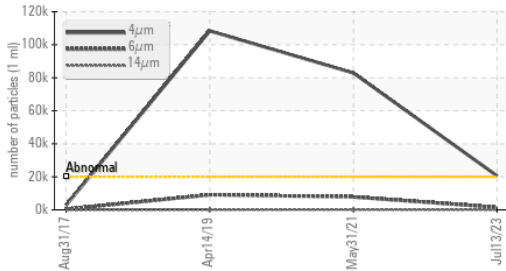

RPVOT

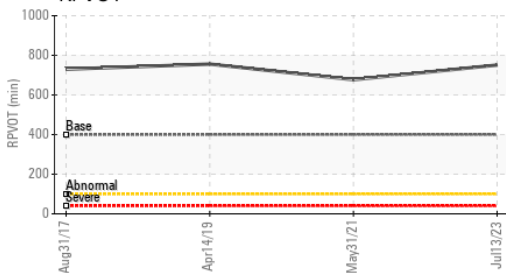

ISO 17025:2017
Accredited
Laboratory

Laboratory
Sample No.
Lab Number
Unique Number
Test Package

To discuss this sample report, cc
Test denoted (*) outside scope o
Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 20550	▲ 82868	▲ 108382
Particles >6µm	ASTM D7647	>5000	1526	▲ 7790	▲ 9126
Particles >14µm	ASTM D7647	>640	17	39	35
Particles >21µm	ASTM D7647	>160	3	6	4
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 22/18/11	▲ 24/20/12	▲ 24/20/12


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		2.4	2.8	2.6
Acid Number (AN)	mg KOH/g ASTM D974*	0.12	0.09	0.10	0.113
Anti-Oxidant 1	% ASTM D6971*	<25	90	101	98
Anti-Oxidant 2	% ASTM D6971*	<25	79	100	92
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	6	49	38

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	44.4	46.2	46.4	46.8
Visc @ 100°C	cSt ASTM D7279(m)	6.72	6.9	6.9	6.9
Viscosity Index (VI)	Scale ASTM D2270*	104	104	103	102
Separability	oil/h2o/em ASTM D1401*	41/39/0	0/0/80 (30)	1/0/79 (30)	1/2/77 (30)
Air Release Time	min ASTM D3427*	3.5	6.50	7.00	8.00
Foam Tendency	I/II/III ASTM D892*	10	550/50/460	555/60/515	530/50/400
Foam Stability	I/II/III ASTM D892*	0	110/0/0	180/0/100	30/0/0
ASTM Color	scalar ASTM D1500*	0.5	L1.0	<1.5	1.0
Rust Prevention	PASS/FAIL ASTM D665*	PASS	PASS	PASS	PASS
Oxidation Test (RPVOT)	minutes ASTM D2272*	400	751	677	756

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		0.035	0.087	0.322
Toluene Insolubles	% ASTM D893(m)*		0.009	0.066	0.048

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



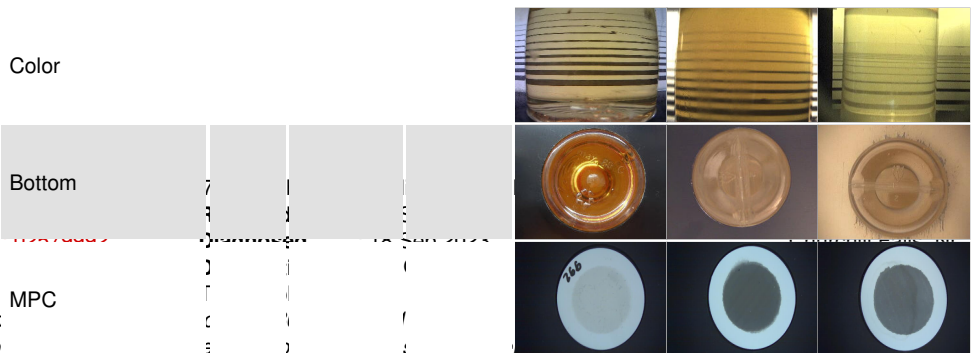


F: (709)925-8220



FERROGRAPHY REPORT

Area
[02437560]
 Machine Id
A5 - Governor Oil Sump
 Component
Governor System
 Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

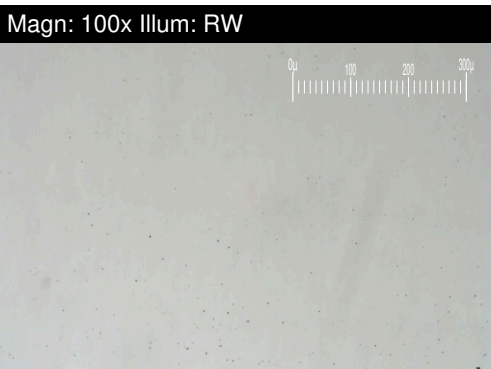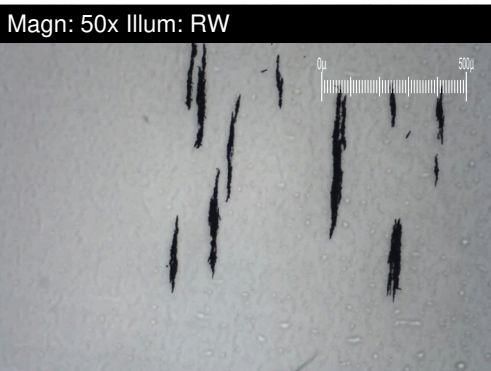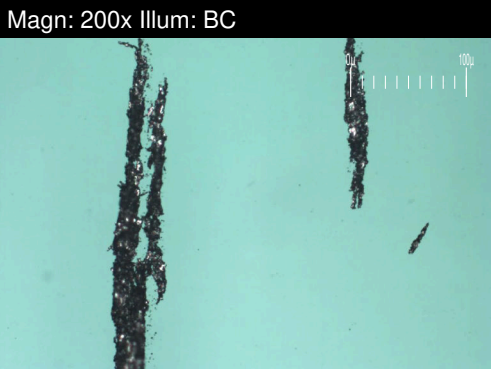


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		24.5	25.3	98.8
Small Particles		DR-Ferr*		7.9	11.3	56.5
Total Particles		DR-Ferr*	>---	32.4	36.6	155.3
Large Particles Percentage	%	DR-Ferr*		51.2	38.3	27.2
Severity Index		DR-Ferr*		407	35420	4179


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		3	4	4
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	2	2
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*			1	1
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	2	1

WEAR


All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

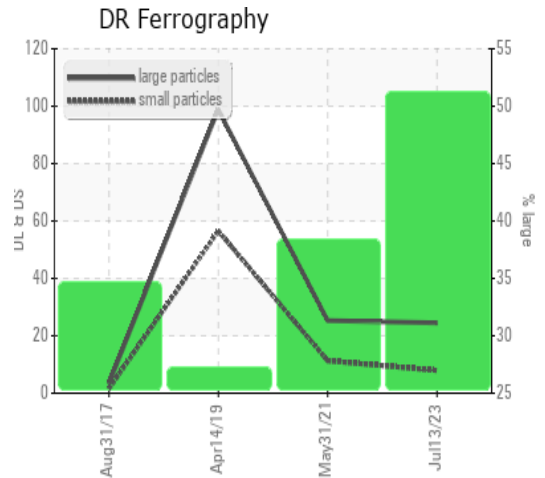


Rotating Pressure Vessel Oxidation Test

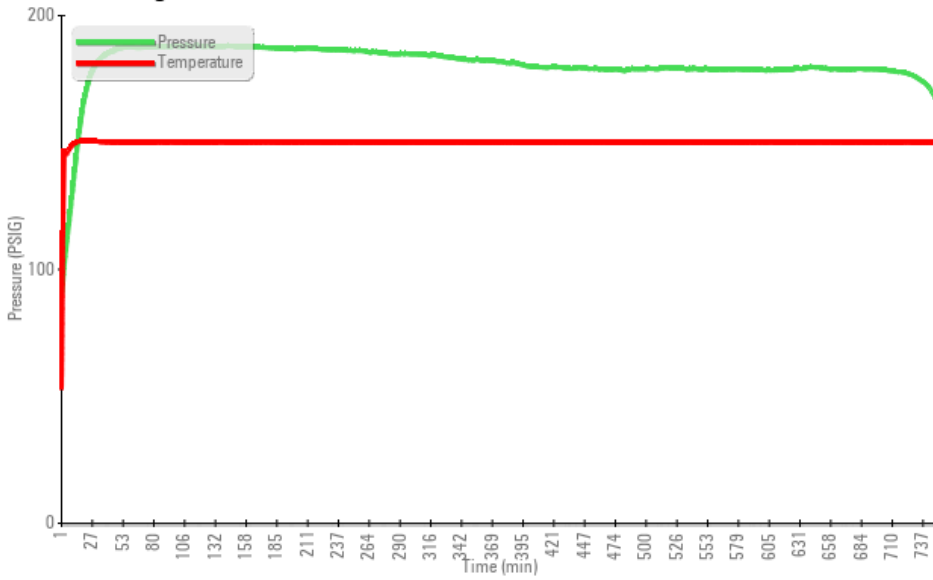


Foaming SEQ I/II/III

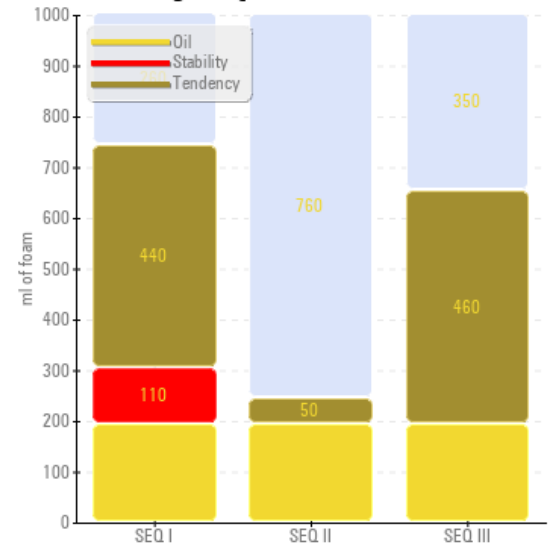


Remaining Useful Life (RULER)

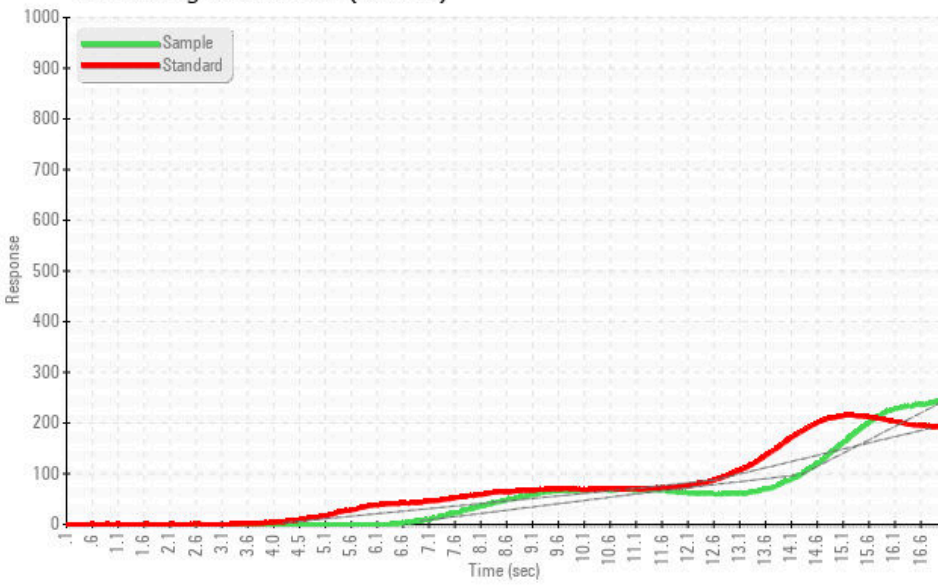

Water Separability

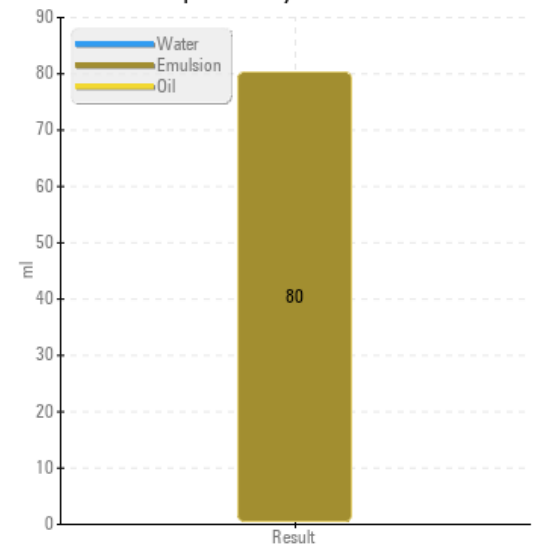

MPC (Varnish Test)

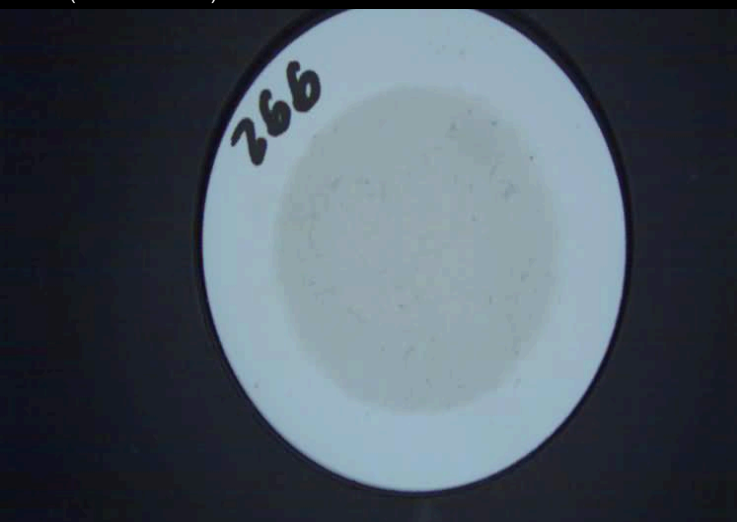

Sample Color & Clarity

