




PROBLEM SUMMARY

Sample Rating Trend

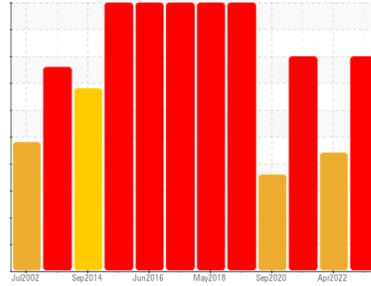

WEAR PARTICLES




Machine Id
A8 - Thrust Bearing

Component
Thrust Bearing

Fluid
PETRO CANADA TURBOFLO R&O 46 (5705 LTR)

COMPONENT CONDITION SUMMARY

▲ Remaining Life (RULER)

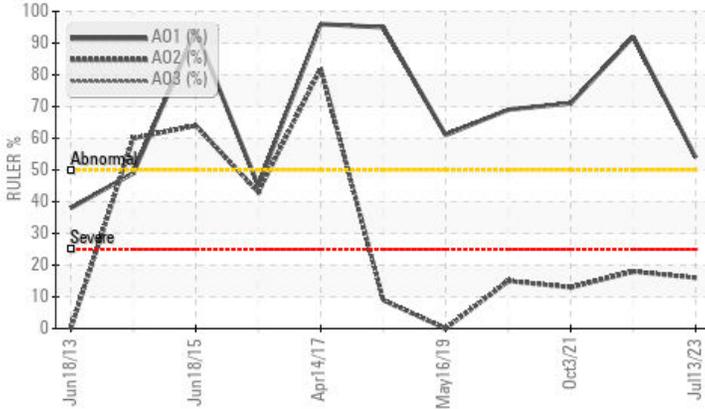

RECOMMENDATION

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. No other corrective action is recommended at this time.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	SEVERE
Ferrous Rolling	Scale 0-10	ASTM D7684*	▲ 3		
Ferrous Spheres	Scale 0-10	ASTM D7684*	▲ 2		
Anti-Oxidant 2	%	ASTM D6971* <25	▲ 16	▲ 18	● 13
Foam Tendency	I/II/III	ASTM D892* 10	▲ 510/65/470	▲ 540/60/540	▲ 530/70/400
PrtFilter					

Customer Id: CHUCHU
Sample No.: WC0669281
Lab Number: 02580003
Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:
Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1
(289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Filter Fluid	---	---	?	We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability.

HISTORICAL DIAGNOSIS

07 Apr 2022 Diag: Bill Quesnel

DEGRADATION



We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. Linear Sweep Voltammetry (RULER– ASTM D6971) testing indicates a low amount of one of the anti-oxidants present in the oil, however, the other anti-oxidant(s) are still performing adequately. The AN level is acceptable for this fluid.

[view report](#)



03 Oct 2021 Diag: Bill Quesnel

DEGRADATION



We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend that you sweeten the oil by draining off half the system oil (50%) and replacing with new oil. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The water content is negligible. Water Separability results (ASTM D1401) indicate good water shedding properties. Foaming Tendency stage I (ASTM D892) result is abnormal indicating a tendency for oil foaming. Linear Sweep Voltammetry (RULER– ASTM D6971) testing indicates one of the anti-oxidants present in the oil will soon be depleted. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid.

[view report](#)



23 Sep 2020 Diag: Bill Quesnel

DEGRADATION



We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. Water Separability results (ASTM D1401) indicate good water shedding properties. The system and fluid cleanliness is acceptable. Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. Linear Sweep Voltammetry (RULER– ASTM D6971) testing indicates a low amount of one of the anti-oxidants present in the oil, however, the other anti-oxidant(s) are still performing adequately. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

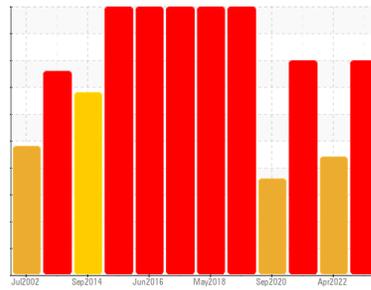

WEAR PARTICLES



Machine Id
A8 - Thrust Bearing

Component
Thrust Bearing

Fluid
PETRO CANADA TURBOFLO R&O 46 (5705 LTR)

DIAGNOSIS

Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. No other corrective action is recommended at this time.

Wear

Wear particle analysis indicates that the ferrous spheres and ferrous rolling particles are marginal. All other component wear rates are normal.

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Oil Condition

Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. Linear Sweep Voltammetry (RULER- ASTM D6971) testing indicates a low amount of one of the anti-oxidants present in the oil, however, the other anti-oxidant(s) are still performing adequately. Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid.

Particle Filter (Magn: 200 x)



SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0669281	WC0679957	WC0438975
Sample Date	Client Info		13 Jul 2023	07 Apr 2022	03 Oct 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m) >85	<1	<1	0
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	<1
Aluminum	ppm	ASTM D5185(m) >40	<1	0	0
Lead	ppm	ASTM D5185(m) >60	0	<1	<1
Copper	ppm	ASTM D5185(m) >7	<1	0	<1
Tin	ppm	ASTM D5185(m) >40	0	0	0
Antimony	ppm	ASTM D5185(m)	0	<1	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0
Calcium	ppm	ASTM D5185(m) 0	<1	0	<1
Phosphorus	ppm	ASTM D5185(m) 3	2	2	1
Zinc	ppm	ASTM D5185(m) 0	2	<1	<1
Sulfur	ppm	ASTM D5185(m)	695	784	828
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >20	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	<1	0	0
Potassium	ppm	ASTM D5185(m) >20	0	<1	<1
Water	%	ASTM D6304* >2	0.001	0.001	0.002
ppm Water	ppm	ASTM D6304*	9.4	11.7	20.7


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0	0
Nitration	Abs/cm	ASTM D7624*	2.3	2.3	2.4
Sulfation	Abs/.1mm	ASTM D7415*	13.0	12.6	12.8




OIL ANALYSIS REPORT


▲ Foaming SEQ I/II/III

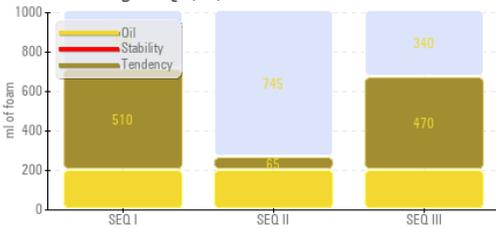


▲ Remaining Life (RULER)

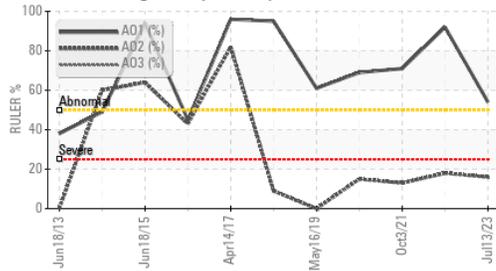


Varnish Potential

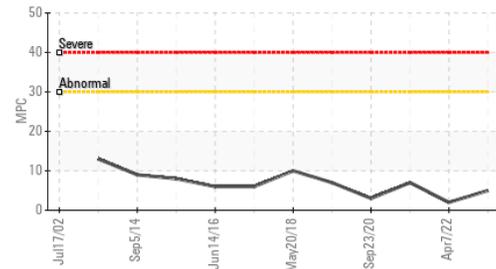

RPVOT

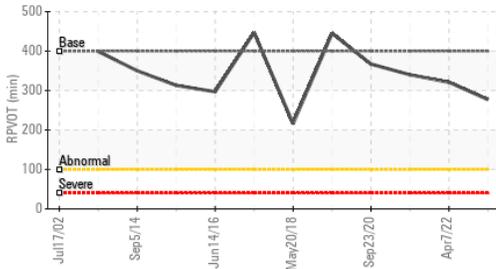

Particle Count

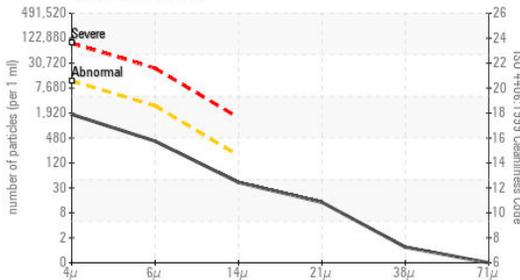

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	1563	1042	1995
Particles >6µm	ASTM D7647	>2500	354	215	345
Particles >14µm	ASTM D7647	>160	36	24	17
Particles >21µm	ASTM D7647	>40	12	6	4
Particles >38µm	ASTM D7647	>10	1	1	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	18/16/12	17/15/12	18/16/11

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		3.0	3.6	3.5
Acid Number (AN)	mg KOH/g ASTM D974*	0.12	0.07	0.06	0.07
Anti-Oxidant 1	% ASTM D6971*	<25	54	92	71
Anti-Oxidant 2	% ASTM D6971*	<25	▲ 16	▲ 18	◆ 13
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	5	2	7

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	VLITE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>2	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	44.4	46.2	46.3	46.2
Visc @ 100°C	cSt ASTM D7279(m)	6.72	6.8	6.9	6.9
Viscosity Index (VI)	Scale ASTM D2270*	104	100	104	104
Separability	oil/h ₂ o/lem ASTM D1401*	41/39/0	43/37/0 (15)	41/39/0 (20)	▲ 42/38/0 (20)
Air Release Time	min ASTM D3427*	3.5	6.50	7.70	7.90
Foam Tendency	I/II/III ASTM D892*	10	▲ 510/65/470	▲ 540/60/540	▲ 530/70/400
Foam Stability	I/II/III ASTM D892*	0	0/0/0	0/0/0	0/0/0
ASTM Color	scalar ASTM D1500*	0.5	L3.0	<3.0	<3.0
Rust Prevention	PASS/FAIL ASTM D665*	PASS	PASS	PASS	PASS
Oxidation Test (RPVOT)	minutes ASTM D2272*	400	277	321	340

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		0.034	0.022	0.083
Toluene Insolubles	% ASTM D893(m)*		0.008	0.012	0.069








Laboratory Sample No.
Lab Number
Unique Number
Test Package

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 : WC0669281
 : **02580003**
 : 5633063
 : AOM 3 (Additional Tests: BottomAnalysis, FilterPatch, PrtFilter, Tollnsol)

Nalcor Energy - Churchill Falls
 PO Box 310
 Churchill Falls, NL
 CA A0R 1A0
 Contact: Robert Noel
 robertnoel@nlh.nl.ca
 T: (709)925-8294
 F: (709)925-8220






To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

OIL ANALYSIS REPORT

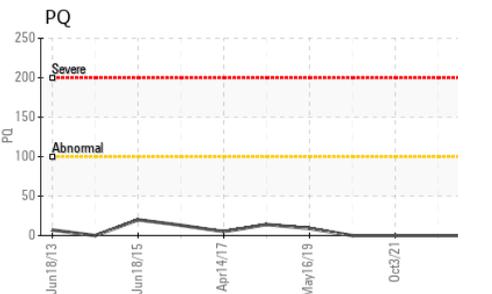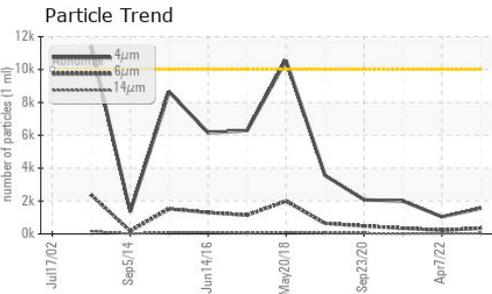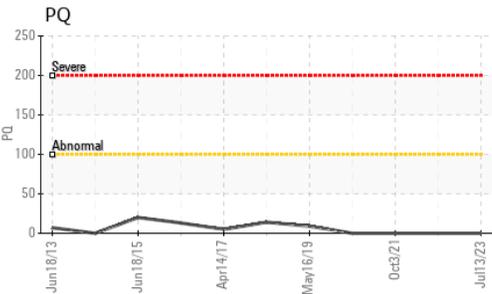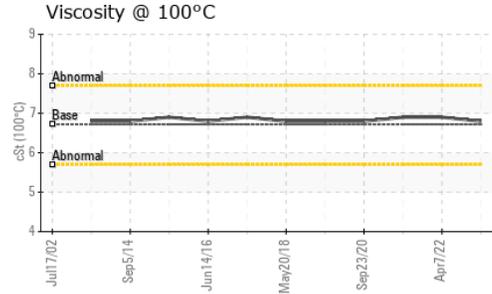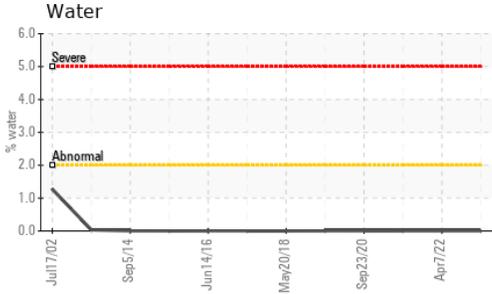

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter					
MPC					

GRAPHS

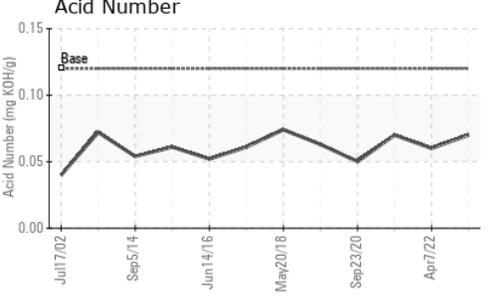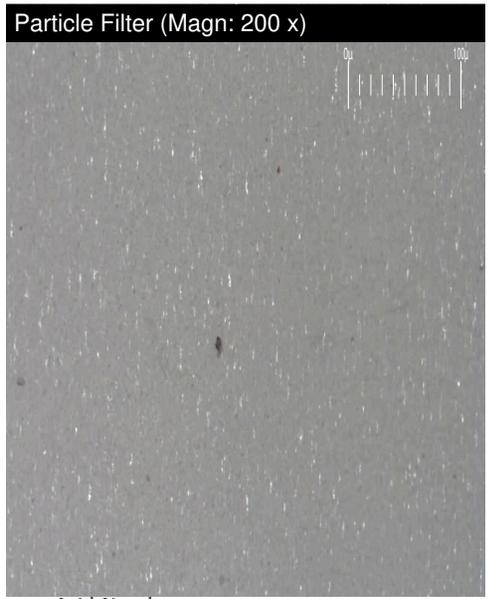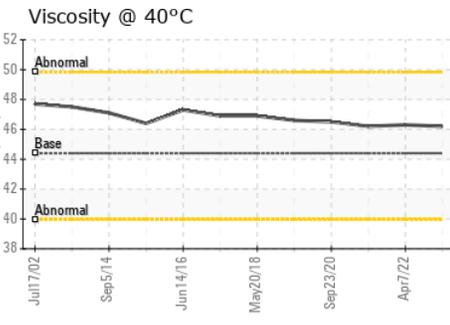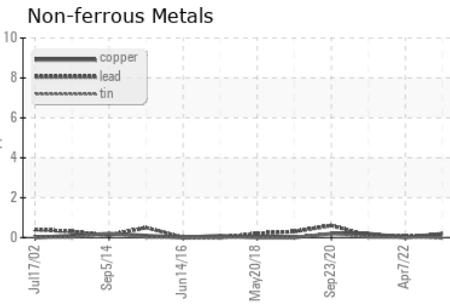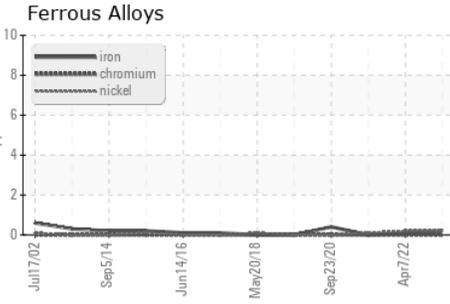

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0669281 **Received** : 01 Sep 2023
Lab Number : 02580003 **Diagnosed** : 18 Sep 2023
Unique Number : 5633063 **Diagnostician** : Bill Quesnel
Test Package : AOM 3 (Additional Tests: BottomAnalysis, FilterPatch, PrtFilter, Tollnsol)

Nalcor Energy - Churchill Falls
 PO Box 310
 Churchill Falls, NL
 CA A0R 1A0
 Contact: Robert Noel
 robertnoel@nlh.nl.ca
 T: (709)925-8294
 F: (709)925-8220



To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FERROGRAPHY REPORT

Machine Id
A8 - Thrust Bearing

Component
Thrust Bearing

Fluid
PETRO CANADA TURBOFLO R&O 46 (5705 LTR)

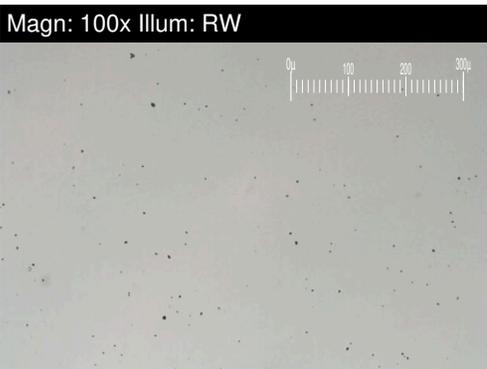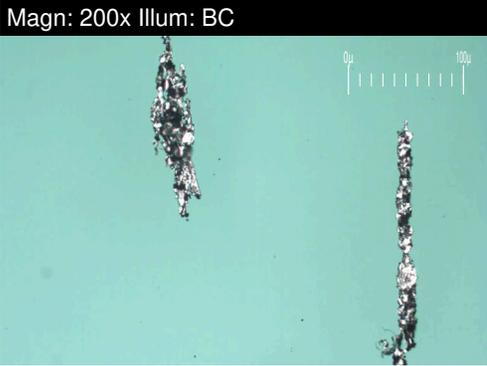


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		4.5	0.6	1.4
Small Particles		DR-Ferr*		4.2	0.4	0.8
Total Particles		DR-Ferr*	>---	8.7	1	2.2
Large Particles Percentage	%	DR-Ferr*		3.4	20	27.3
Severity Index		DR-Ferr*		1	0	0.8


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		■ 3	■ 1	■ 1
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		▲ 3		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*		▲ 2		
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		■ 1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		■ 1	■ 1	■ 1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		■ 1	■ 1	■ 1

WEAR


Wear particle analysis indicates that the ferrous spheres and ferrous rolling particles are marginal. All other component wear rates are normal.

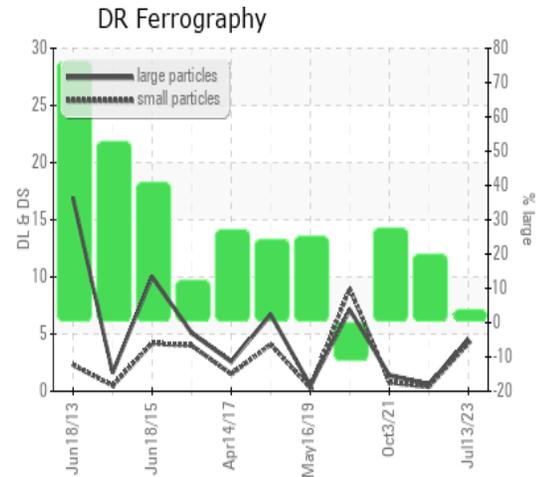


Rotating Pressure Vessel Oxidation Test

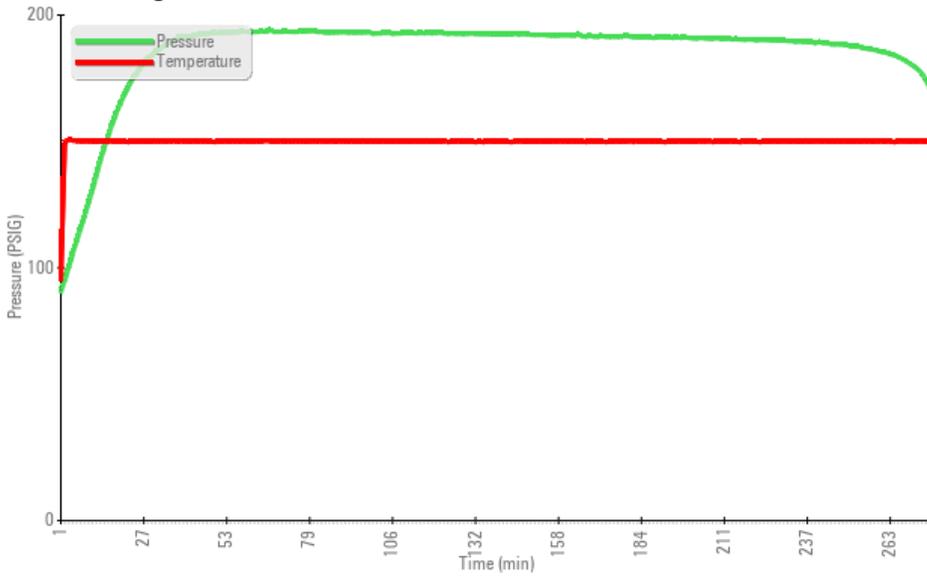


Foaming SEQ I/II/III

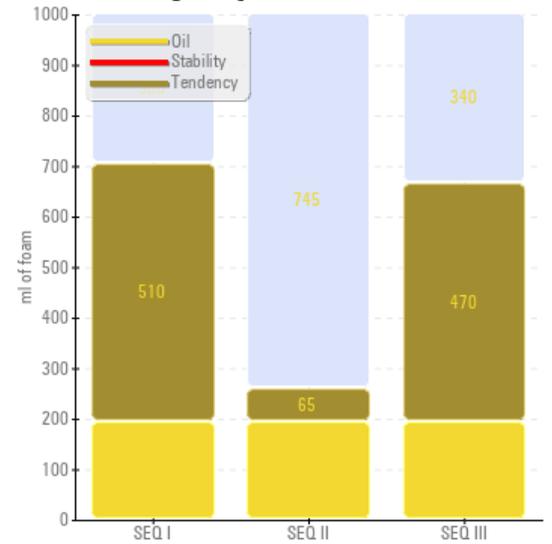


Remaining Useful Life (RULER)

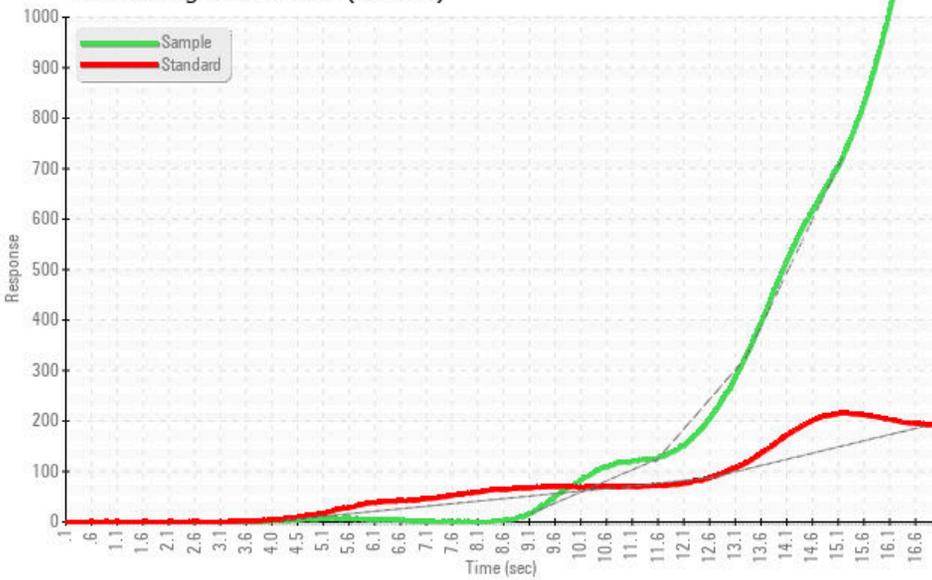

Water Separability

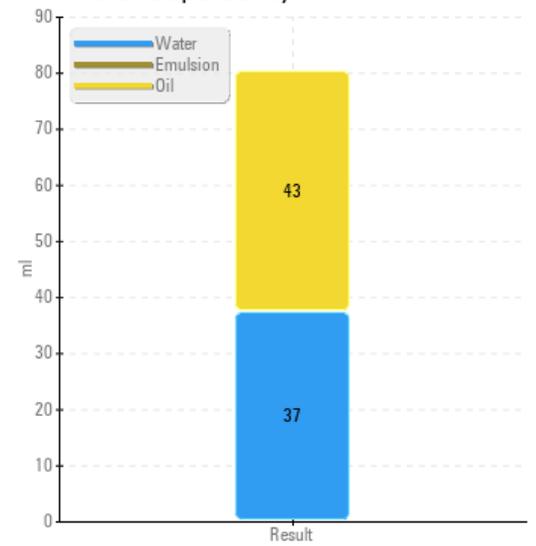

MPC (Varnish Test)

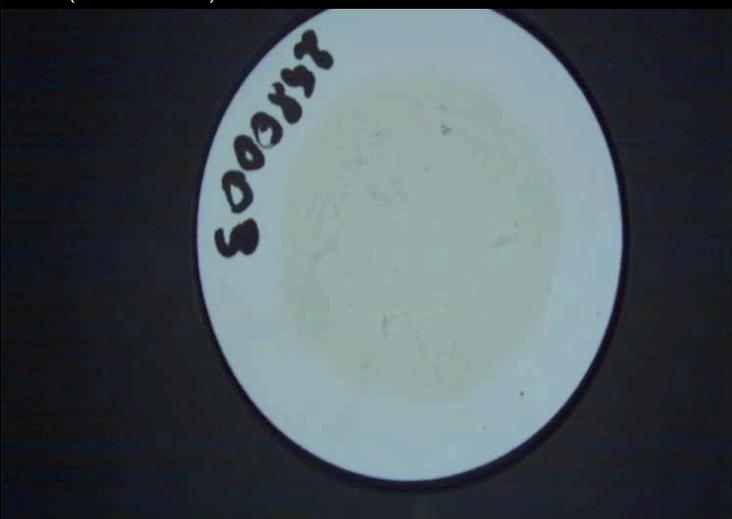

Sample Color & Clarity



This page left intentionally blank