



PROBLEM SUMMARY

Sample Rating Trend


DEGRADATION

Area
[02437560]

Machine Id
A3 - Governor Oil Sump


Component
Governor System

Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

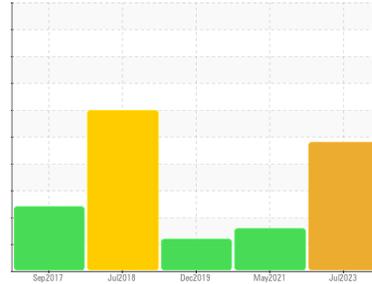


COMPONENT CONDITION SUMMARY

▲ Remaining Life (RULER)

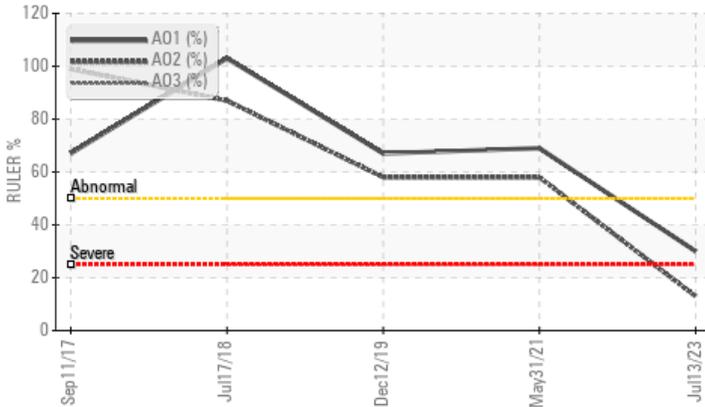

▲ Varnish Potential

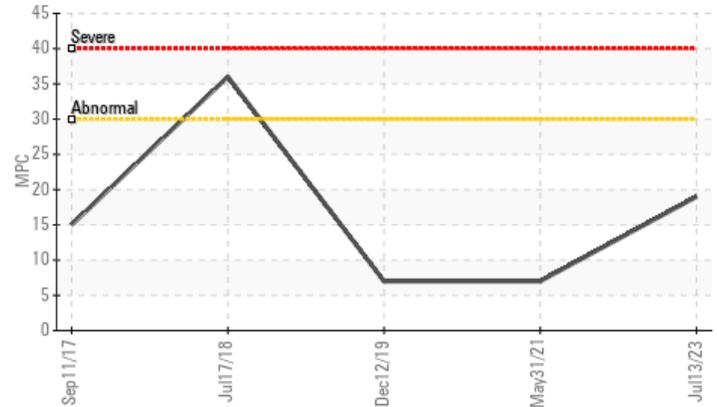

RECOMMENDATION

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. No other corrective action is recommended at this time.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Anti-Oxidant 2	%	ASTM D6971*	<25	▲ 13	58	58
MPC Varnish Potential	Scale	ASTM D7843(m)*	>15	▲ 19	7	7
Foam Tendency	I/II/III	ASTM D892*	10	▲ 510/60/470	▲ 520/50/500	▲ 485/50/410

Customer Id: CHUCHU
 Sample No.: WC0786872
 Lab Number: 02580005
 Test Package: AOM 3



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Bill Quesnel CLS, OMA II, MLA-III, LLA-I +1
 (289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Filter Fluid	---	---	?	We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability.

HISTORICAL DIAGNOSIS

OFF SPEC



31 May 2021 Diag: Kevin Marson

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. Water Separability results (ASTM D1401) indicate good water shedding properties. The system and fluid cleanliness is acceptable. Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid.

[view report](#)



OFF SPEC



12 Dec 2019 Diag: Bill Quesnel

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a light amount of silt (particulates < 14 microns in size) present in the oil. MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. The water content is negligible. Water Separability results (ASTM D1401) indicate good water shedding properties. Foaming Tendency stage I (ASTM D892) result is abnormal indicating a tendency for oil foaming. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid.

[view report](#)



WEAR PARTICLES



17 Jul 2018 Diag: Bill Quesnel

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend you service the filters on this component. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. We recommend an early resample to monitor this condition. Large Particles and severity index levels are abnormal. Wear particle analysis indicates that the ferrous rubbing particles are noted. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. MPC Varnish Potential contamination levels are abnormally high. Particles >4µm are abnormally high. Particles >6µm are notably high. MPC (Membrane Patch Colorimetry) test indicates a moderate concentration of varnish present. The water content is negligible. Water Separability results (ASTM D1401) indicate good water shedding properties. Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. The Air Release Value (ASTM D3427) indicates that the oil has good deaeration properties. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

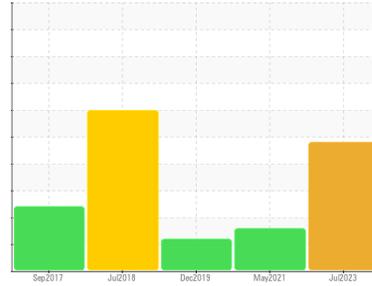

DEGRADATION



Area
[02437560]

Machine Id
A3 - Governor Oil Sump

Component
Governor System

Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

DIAGNOSIS

Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition. No other corrective action is recommended at this time.

Wear

All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

Contaminants

MPC (Membrane Patch Colorimetry) test indicates a light concentration of varnish present. The water content is negligible.

Oil Condition

Foaming Tendency (ASTM D892) results are abnormal indicating a tendency for oil foaming. Linear Sweep Voltammetry (RULER- ASTM D6971) testing indicates a low amount of one of the anti-oxidants present in the oil, however, the other anti-oxidant(s) are still performing adequately. Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0786872	WC	WC0308154
Sample Date	Client Info	13 Jul 2023	31 May 2021	12 Dec 2019
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	15
Iron	ppm	ASTM D5185(m) >50	1	<1
Chromium	ppm	ASTM D5185(m) >10	0	0
Nickel	ppm	ASTM D5185(m) >10	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0
Silver	ppm	ASTM D5185(m)	0	<1
Aluminum	ppm	ASTM D5185(m) >3	<1	0
Lead	ppm	ASTM D5185(m) >75	2	<1
Copper	ppm	ASTM D5185(m) >15	<1	<1
Tin	ppm	ASTM D5185(m) >55	0	0
Antimony	ppm	ASTM D5185(m) >5	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0
Beryllium	ppm	ASTM D5185(m)	0	0
Cadmium	ppm	ASTM D5185(m)	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1
Barium	ppm	ASTM D5185(m)	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0
Manganese	ppm	ASTM D5185(m)	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1
Calcium	ppm	ASTM D5185(m) 0	1	<1
Phosphorus	ppm	ASTM D5185(m) 3	6	6
Zinc	ppm	ASTM D5185(m) 0	3	3
Sulfur	ppm	ASTM D5185(m)	147	152
Lithium	ppm	ASTM D5185(m)	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >8	<1	<1
Sodium	ppm	ASTM D5185(m)	0	0
Potassium	ppm	ASTM D5185(m) >20	0	<1
Water	%	ASTM D6304* >0.1	0.001	0.001
ppm Water	ppm	ASTM D6304* >1000	7.1	10.2


INFRA-RED

method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0
Nitration	Abs/cm	ASTM D7624*	1.9	1.6
Sulfation	Abs/1mm	ASTM D7415*	12.2	11.4




OIL ANALYSIS REPORT


▲ Foaming SEQ I/II/III

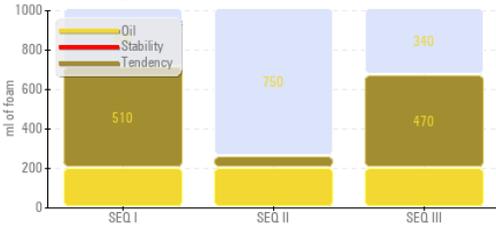


▲ Remaining Life (RULER)

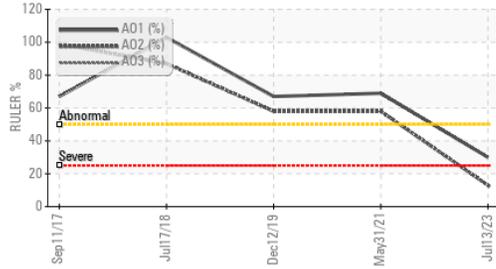


▲ Varnish Potential

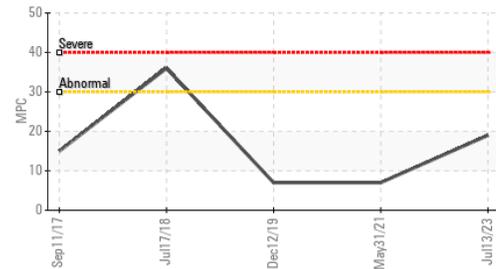

RPVOT

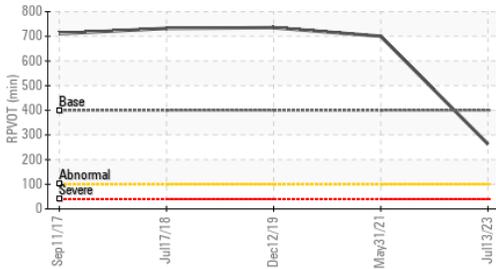

Particle Count

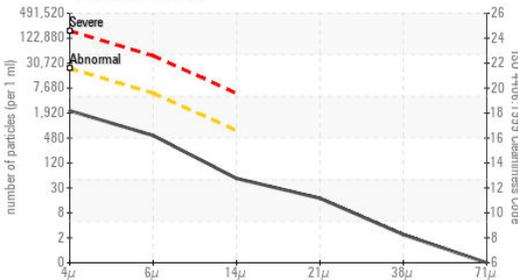

ISO 17025:2017
Accredited
Laboratory

Laboratory Sample No.
Lab Number
Unique Number
Test Package

To discuss this sample report, cc
Test denoted (*) outside scope o
Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	1913	2434	▲ 39286
Particles >6µm	ASTM D7647	>5000	484	468	4018
Particles >14µm	ASTM D7647	>640	45	39	124
Particles >21µm	ASTM D7647	>160	15	13	40
Particles >38µm	ASTM D7647	>40	2	1	2
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	18/16/13	18/16/12	▲ 22/19/14


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		2.6	2.8	2.6
Acid Number (AN)	mg KOH/g ASTM D974*	0.12	0.06	0.08	0.086
Anti-Oxidant 1	% ASTM D6971*	<25	30	69	67
Anti-Oxidant 2	% ASTM D6971*	<25	▲ 13	58	58
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	▲ 19	7	7

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	44.4	45.0	45.0	45.4
Visc @ 100°C	cSt ASTM D7279(m)	6.72	6.7	6.8	6.7
Viscosity Index (VI)	Scale ASTM D2270*	104	101	105	99
Separability	oil/h ₂ o/lem ASTM D1401*	41/39/0	42/38/0 (25)	41/39/0 (20)	41/39/0 (15)
Air Release Time	min ASTM D3427*	3.5	5.80	4.80	6.70
Foam Tendency	I/II/III ASTM D892*	10	▲ 510/60/470	▲ 520/50/500	▲ 485/50/410
Foam Stability	I/II/III ASTM D892*	0	0/0/0	0/0/0	0/0/0
ASTM Color	scalar ASTM D1500*	0.5	L2.0	<1.0	<0.5
Rust Prevention	PASS/FAIL ASTM D665*	PASS	PASS	PASS	PASS
Oxidation Test (RPVOT)	minutes ASTM D2272*	400	263	700	735

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		0.034	0.005	0.069
Toluene Insolubles	% ASTM D893(m)*		0.002	0.029	0.006




SAMPLE IMAGES

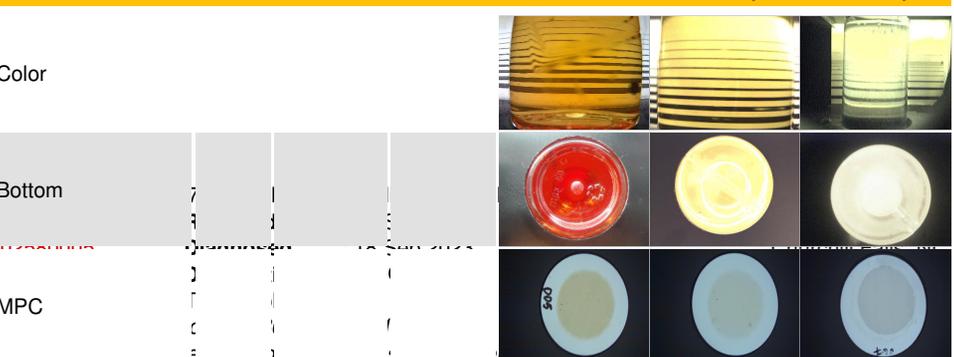

F: (709)925-8220

FERROGRAPHY REPORT

Area
[02437560]
 Machine Id
A3 - Governor Oil Sump
 Component
Governor System
 Fluid
PETRO CANADA TURBOFLO R&O 46 (6080 LTR)

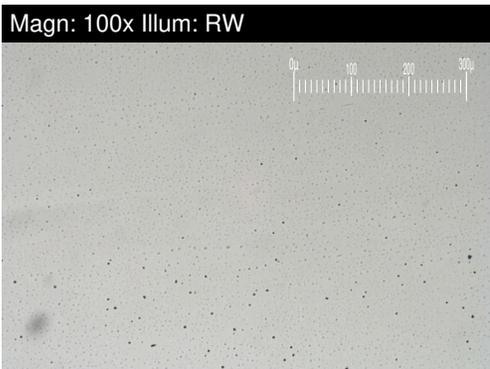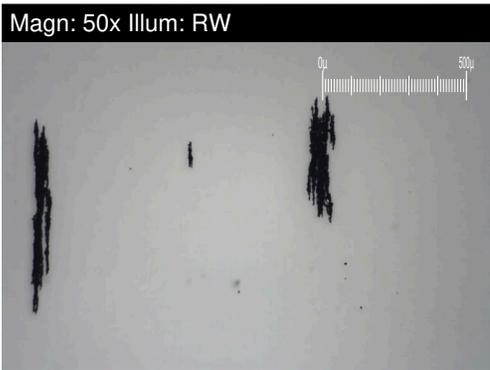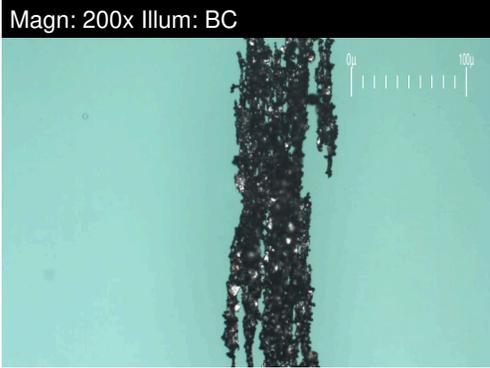


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		1.5	5.5	33.1
Small Particles		DR-Ferr*		1.3	3.3	10.2
Total Particles		DR-Ferr*	>---	2.8	8.8	43.3
Large Particles Percentage	%	DR-Ferr*		7.1	25	52.9
Severity Index		DR-Ferr*		0	12.1	758


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		3	1	3
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		2		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	1	2

WEAR


All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system.

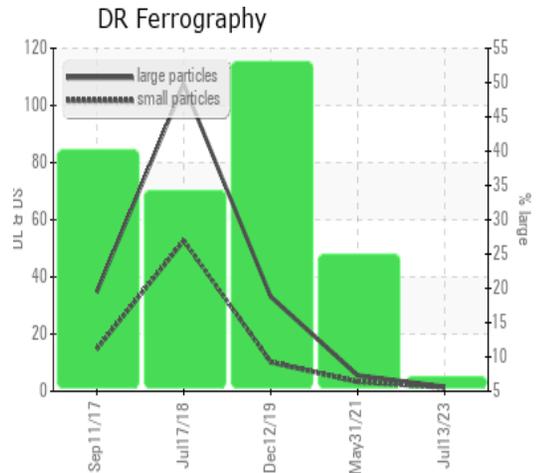


Rotating Pressure Vessel Oxidation Test

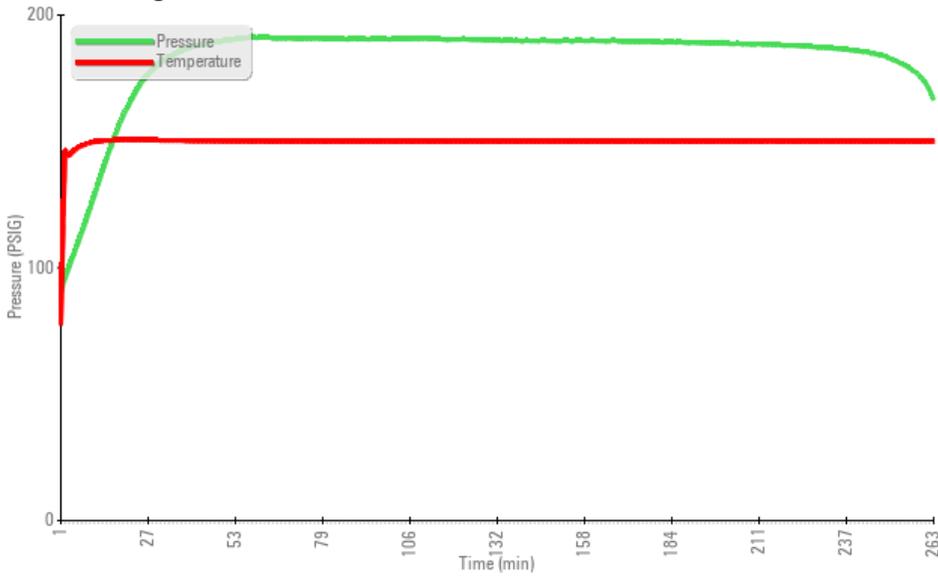


Foaming SEQ I/II/III

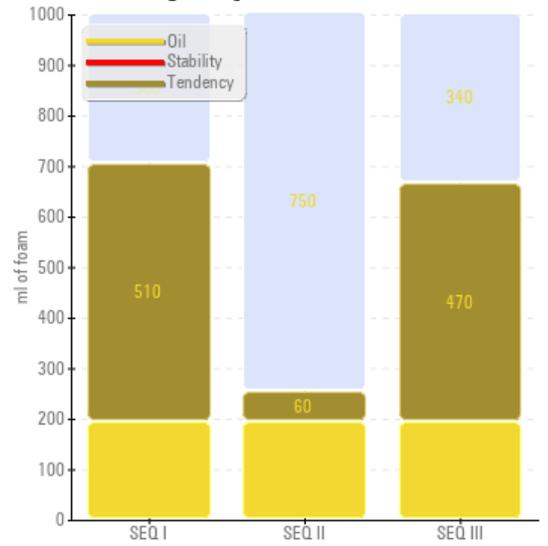

Remaining Useful Life (RULER)

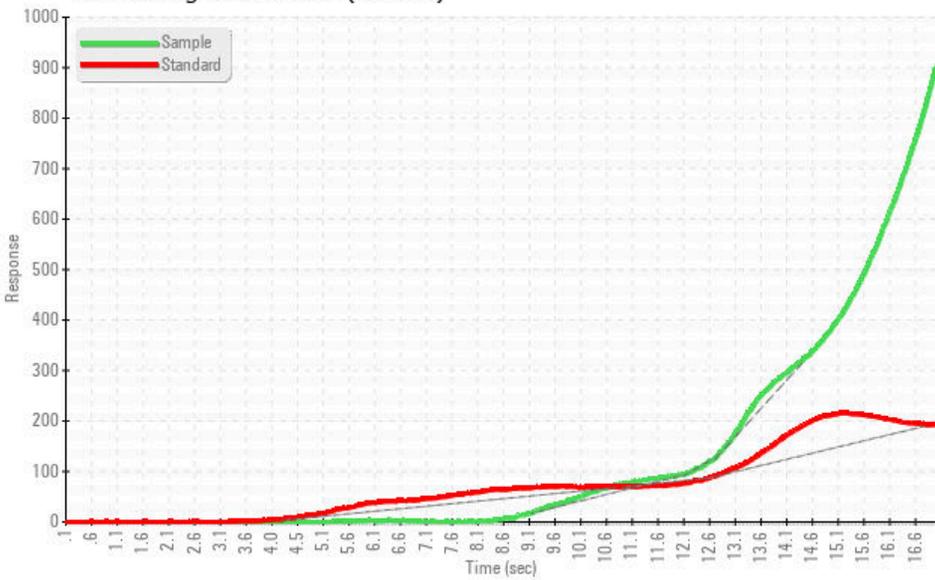

Water Separability

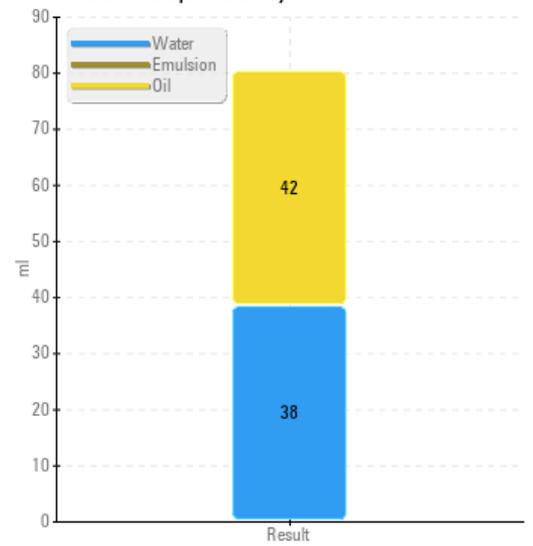

MPC (Varnish Test)



Sample Color & Clarity

