

OIL ANALYSIS REPORT

Sample Rating Trend







2B Component

Machine Id

Unknown Component

Fluid PETRO CANADA TURBOFLO XL46 (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Wear

{not applicable}

Contamination

ISO Cleanliness Code (ISO 4406:1999): 18/17/12; Cumulative particle counts $>4\mu m = 2450$, $>6\mu m = 837$, $>14\mu m = 27$, $>21\mu m = 6$, $>38\mu m = 0$, $>71\mu m = 0$.


Fluid Condition

{not applicable}

				Mug2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PP		
Sample Date		Client Info		31 Aug 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	2450		
Particles >6µm		ASTM D7647	>1300	837		
Particles >14µm		ASTM D7647	>160	27		
Particles >21µm		ASTM D7647	>40	6		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	18/17/12		
SAMPLE IMAGES	\$	method	limit/base	current	history1	history2
Color				no image	no image	no image
Bottom				no image	no image	no image



OIL ANALYSIS REPORT

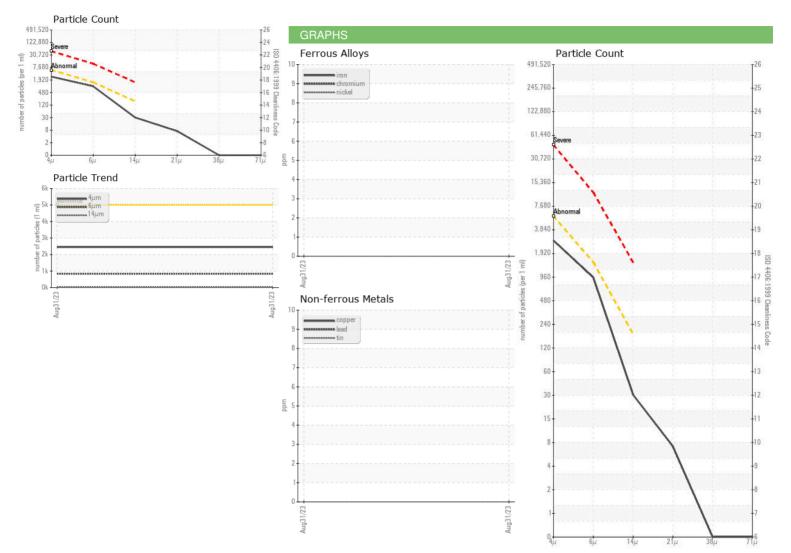

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 ANDRITZ HYDRO Laboratory CALA Sample No. 6100 AUT TRANSCANADIENNE : PP Received : 01 Sep 2023 5 Lab Number : 02580147 Diagnosed : 01 Sep 2023 POINT CLAIRE, QC ISO 17025:2017 Accredited Laboratory CA H9R 1B9 Unique Number : 5633207 Diagnostician : Kevin Marson Test Package : TEST (Additional Tests: PrtCount) Contact: Guy Cauchon To discuss this sample report, contact Customer Service at 1-800-268-2131. guy.cauchon@andritz.com Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Т: Validity of results and interpretation are based on the sample and information as supplied. F: