




OIL ANALYSIS REPORT

Sample Rating Trend

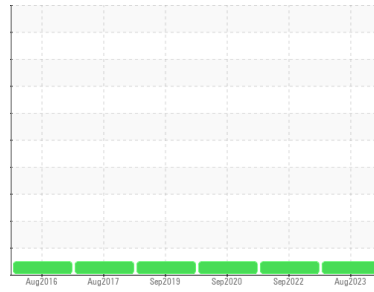

NORMAL



Machine Id
JOHN DEERE M0735
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (12 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0836776	WC0709872	WC0442656
Sample Date	Client Info		22 Aug 2023	19 Sep 2022	09 Sep 2020
Machine Age	hrs	Client Info	306	283	226
Oil Age	hrs	Client Info	61	39	53
Oil Changed	Client Info		Not Changed	Not Changd	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>2.1	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>51	4	3	4
Chromium	ppm	ASTM D5185(m)	>11	0	0	<1
Nickel	ppm	ASTM D5185(m)	>5	<1	0	<1
Titanium	ppm	ASTM D5185(m)		0	0	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>31	1	<1	1
Lead	ppm	ASTM D5185(m)	>26	<1	0	<1
Copper	ppm	ASTM D5185(m)	>26	<1	<1	1
Tin	ppm	ASTM D5185(m)	>4	0	0	<1
Antimony	ppm	ASTM D5185(m)		0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	250	5	5	4
Barium	ppm	ASTM D5185(m)	10	<1	<1	<1
Molybdenum	ppm	ASTM D5185(m)	100	6	6	37
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	98	101	743
Calcium	ppm	ASTM D5185(m)	3000	2136	2137	1318
Phosphorus	ppm	ASTM D5185(m)	1150	925	949	1057
Zinc	ppm	ASTM D5185(m)	1350	1006	987	1224
Sulfur	ppm	ASTM D5185(m)	4250	3020	3084	3001
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>22	2	2	2
Sodium	ppm	ASTM D5185(m)	>158	2	2	2
Potassium	ppm	ASTM D5185(m)	>20	2	1	1

INFRA-RED


	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.3	6.0	5.9
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.0	15.9	15.8

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	ASTM D7414*	>25	9.7	9.9	13.1











OIL ANALYSIS REPORT

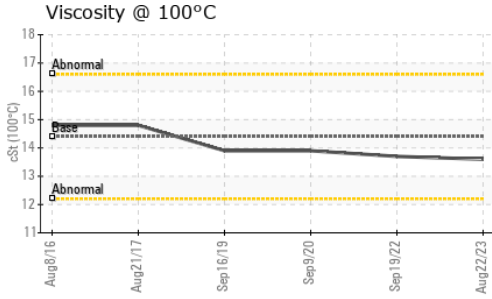

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.6	13.7

GRAPHS

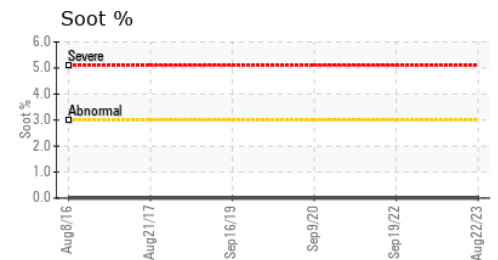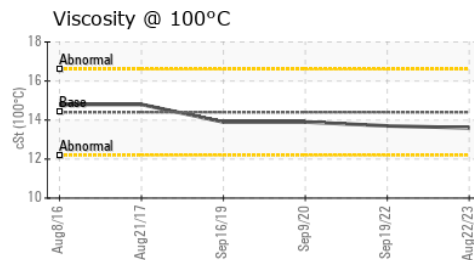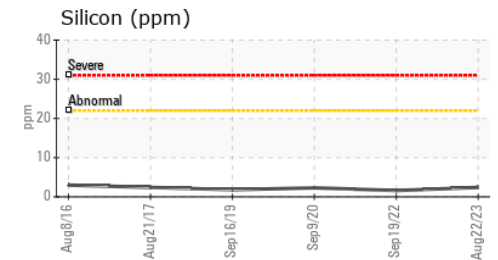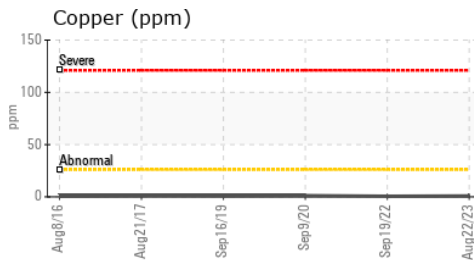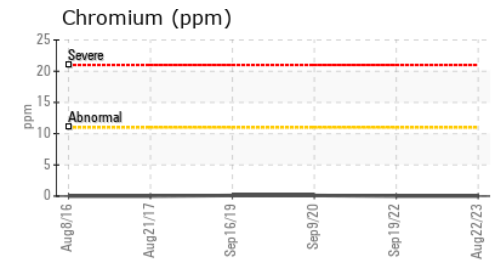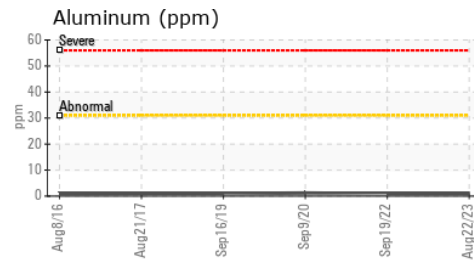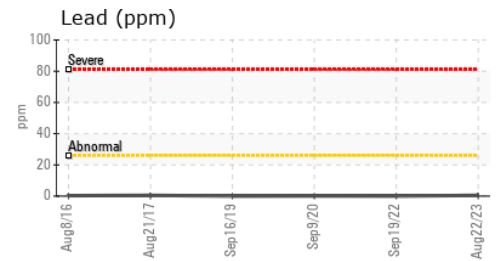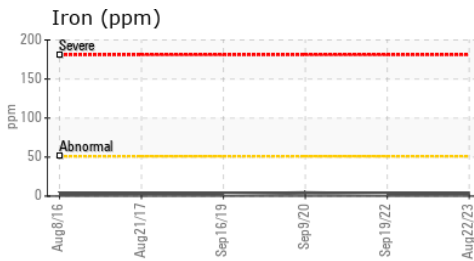

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0836776 **Received** : 05 Sep 2023
Lab Number : 02580204 **Diagnosed** : 05 Sep 2023
Unique Number : 5633264 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

GENCARE SERVICES LTD.
 360 SOVEREIGN ROAD
 LONDON, ON
 CA N6M 1A8
 Contact: Teresa Matthews
 tmatthews@gencare.com
 T: (519)659-7118
 F: (519)451-1707

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.