


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

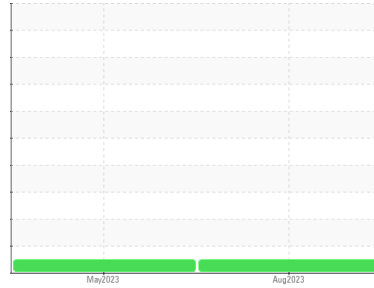

Machine Id
F02-BL 5120 Recycle Blower
Component
Drive End Bearing
Fluid
SWEPKO 704 HYDRAULIC OIL ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PLS0000769	WC0820466	---
Sample Date	Client Info			31 Aug 2023	23 May 2023	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				NORMAL	NORMAL	---





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	---
Iron	ppm	ASTM D5185(m)	>20	<1	<1	---
Chromium	ppm	ASTM D5185(m)	>20	0	0	---
Nickel	ppm	ASTM D5185(m)	>20	<1	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)	>20	0	<1	---
Lead	ppm	ASTM D5185(m)	>20	0	0	---
Copper	ppm	ASTM D5185(m)	>20	0	0	---
Tin	ppm	ASTM D5185(m)	>20	0	0	---
Antimony	ppm	ASTM D5185(m)		0	<1	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
Beryllium	ppm	ASTM D5185(m)		0	0	---
Cadmium	ppm	ASTM D5185(m)		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	0	---
Barium	ppm	ASTM D5185(m)		0	0	---
Molybdenum	ppm	ASTM D5185(m)		1	1	---
Manganese	ppm	ASTM D5185(m)		0	0	---
Magnesium	ppm	ASTM D5185(m)		98	99	---
Calcium	ppm	ASTM D5185(m)		71	75	---
Phosphorus	ppm	ASTM D5185(m)		328	335	---
Zinc	ppm	ASTM D5185(m)		368	378	---
Sulfur	ppm	ASTM D5185(m)		731	767	---
Lithium	ppm	ASTM D5185(m)		<1	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<1	0	---
Sodium	ppm	ASTM D5185(m)		1	<1	---
Potassium	ppm	ASTM D5185(m)	>20	<1	0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	8034	3354	---
Particles >6µm		ASTM D7647	>2500	2160	626	---
Particles >14µm		ASTM D7647	>160	169	44	---
Particles >21µm		ASTM D7647	>40	54	14	---
Particles >38µm		ASTM D7647	>10	5	2	---
Particles >71µm		ASTM D7647	>3	1	1	---
Oil Cleanliness		ISO 4406 (c)	>20/18/14	20/18/15	19/16/13	---

OIL ANALYSIS REPORT

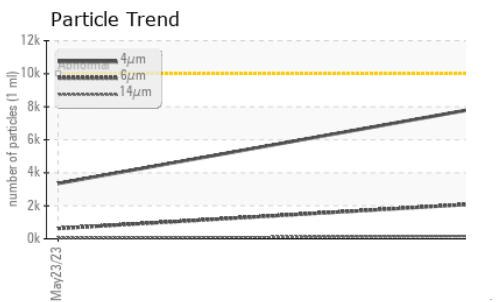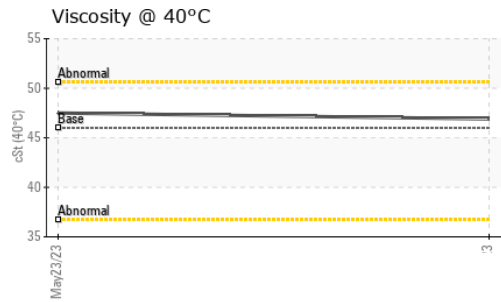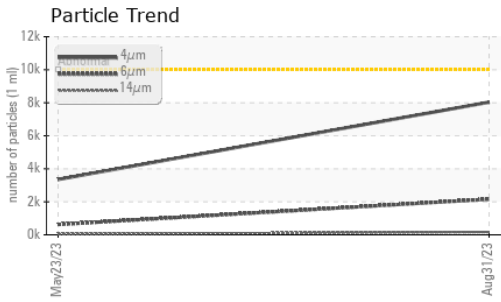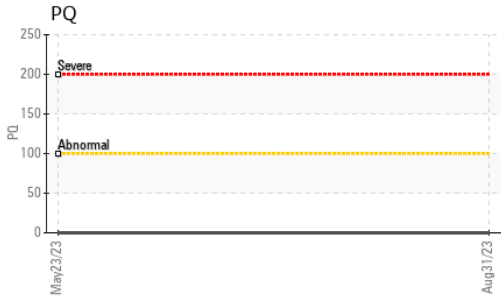


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.35	0.56	---






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	VLITE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>2	NEG	NEG	---
Free Water	scalar	Visual*		NEG	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	46.9	47.5	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

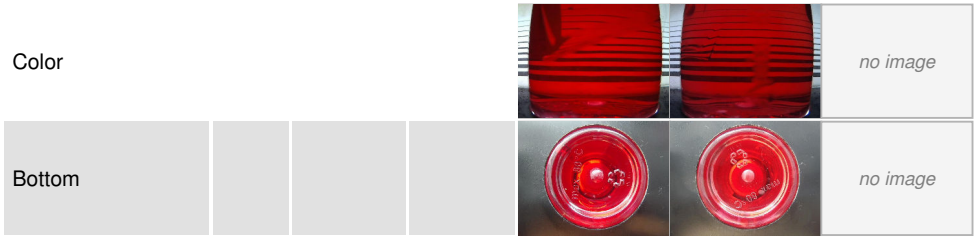

GRAPHS

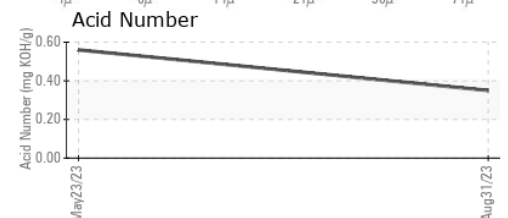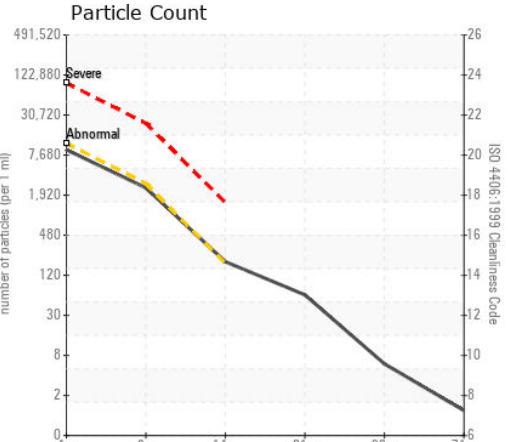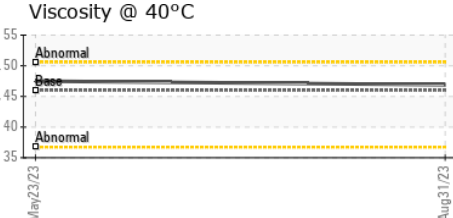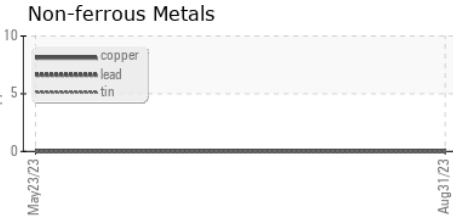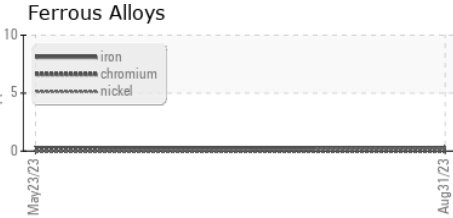

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Hexion Canada Inc. - EDMONTON PLANT
Sample No. : PLS0000769 **Received** : 05 Sep 2023
Lab Number : 02580380 **Diagnosed** : 07 Sep 2023
Unique Number : 5633440 **Diagnostician** : Mike Johnson
Test Package : IND 2 (Additional Tests: PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

12621 - 156th Street NW
 Edmonton, AB
 CA T5V 1E1
 Contact: Scott Mckenzie
 scott.mckenzie@henxion.com
 T: (780)447-8469
 F: (780)447-7268