



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
M0170

Component
Diesel Engine

Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

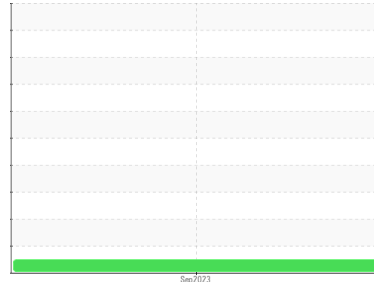

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0836780	---	---
Sample Date	Client Info	25 Sep 2023	---	---
Machine Age	hrs Client Info	532	---	---
Oil Age	hrs Client Info	29	---	---
Oil Changed	Client Info	Not Chngd	---	---
Sample Status		NORMAL	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<1.0	---	---
Glycol	WC Method	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >100	2	---	---
Chromium	ppm ASTM D5185(m) >20	0	---	---
Nickel	ppm ASTM D5185(m) >4	0	---	---
Titanium	ppm ASTM D5185(m)	2	---	---
Silver	ppm ASTM D5185(m) >3	<1	---	---
Aluminum	ppm ASTM D5185(m) >20	<1	---	---
Lead	ppm ASTM D5185(m) >40	0	---	---
Copper	ppm ASTM D5185(m) >330	<1	---	---
Tin	ppm ASTM D5185(m) >15	0	---	---
Antimony	ppm ASTM D5185(m)	0	---	---
Vanadium	ppm ASTM D5185(m)	0	---	---
Beryllium	ppm ASTM D5185(m)	0	---	---
Cadmium	ppm ASTM D5185(m)	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 250	13	---	---
Barium	ppm ASTM D5185(m) 10	<1	---	---
Molybdenum	ppm ASTM D5185(m) 100	<1	---	---
Manganese	ppm ASTM D5185(m)	0	---	---
Magnesium	ppm ASTM D5185(m) 450	84	---	---
Calcium	ppm ASTM D5185(m) 3000	2166	---	---
Phosphorus	ppm ASTM D5185(m) 1150	858	---	---
Zinc	ppm ASTM D5185(m) 1350	1000	---	---
Sulfur	ppm ASTM D5185(m) 4250	3029	---	---
Lithium	ppm ASTM D5185(m)	<1	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	3	---	---
Sodium	ppm ASTM D5185(m) >158	2	---	---
Potassium	ppm ASTM D5185(m) >20	2	---	---

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >3	0	---	---
Nitration	Abs/cm ASTM D7624* >20	5.4	---	---
Sulfation	Abs/.1mm ASTM D7415* >30	15.4	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414* >25	8.8	---	---











OIL ANALYSIS REPORT

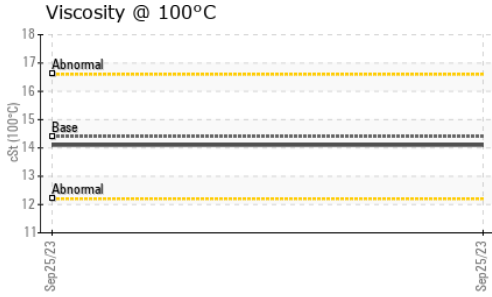

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	---	---
Precipitate	scalar	Visual*	NONE	---	---
Silt	scalar	Visual*	NONE	---	---
Debris	scalar	Visual*	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	---	---
Appearance	scalar	Visual*	NORML	---	---
Odor	scalar	Visual*	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	---	---
Free Water	scalar	Visual*	---	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.1	---	---

GRAPHS

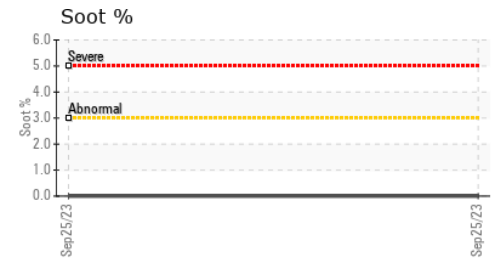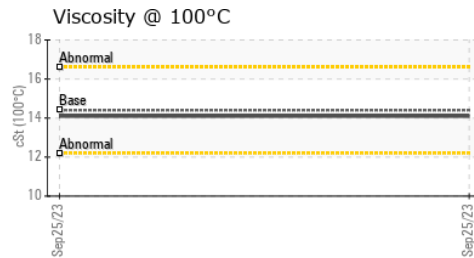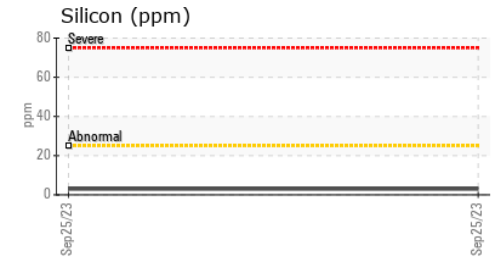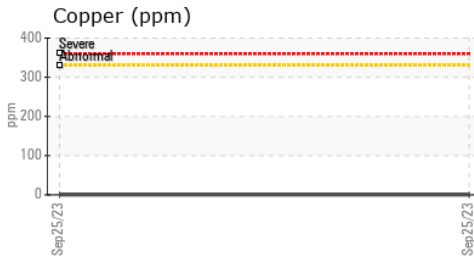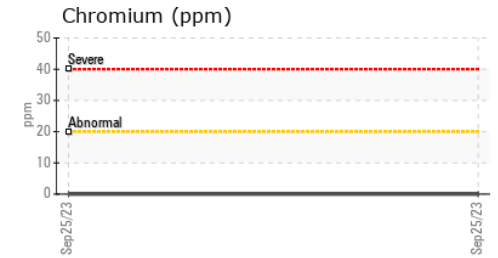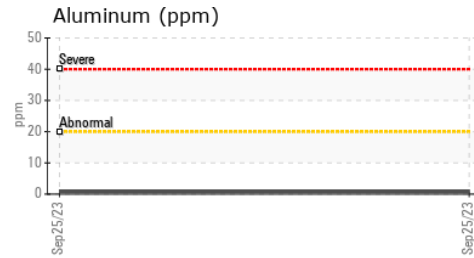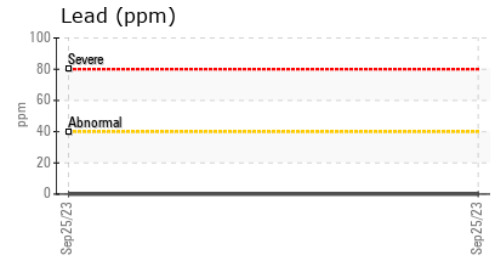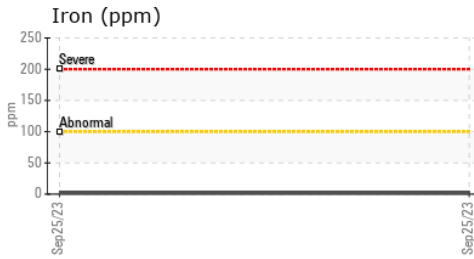

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0836780 **Received** : 04 Oct 2023
Lab Number : 02586683 **Diagnosed** : 04 Oct 2023
Unique Number : 5655749 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

GENCARE SERVICES LTD.
 360 SOVEREIGN ROAD
 LONDON, ON
 CA N6M 1A8
 Contact: Terri Wedzinga
 twedzinga@gencare.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T: (519)451-1707