




PROBLEM SUMMARY


Area
PUMPHOUSE/BOOSTER RAW WATER PUMPS
 Machine Id
C - Booster Raw Water Pump Gearbox Oil System
 Component
Lube System
 Fluid
PETRO CANADA HYDREX AW 100 (45 GAL)

Sample Rating Trend

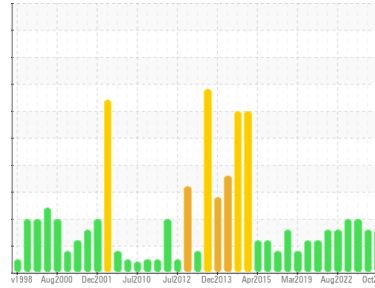

COMPONENT CONDITION SUMMARY

▲ Particle Trend

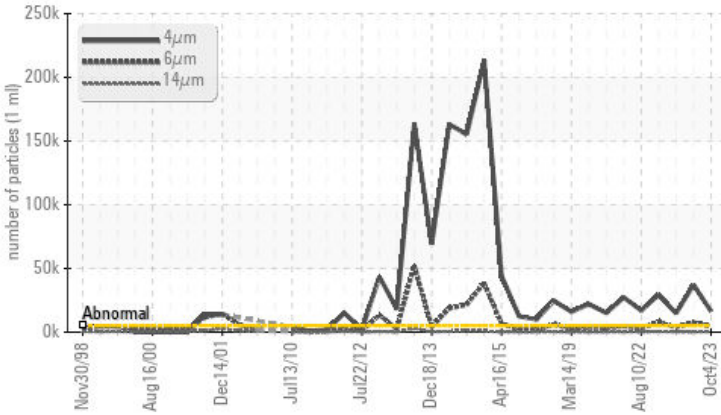

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>5000	▲ 16456	▲ 37111	▲ 14742
Particles >6µm	ASTM D7647	>1300	▲ 4414	▲ 7635	▲ 3779
Particles >14µm	ASTM D7647	>160	▲ 234	▲ 181	▲ 276
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/15	▲ 22/20/15	▲ 21/19/15

Customer Id: LEWBOSC
 Sample No.: WC0866308
 Lab Number: 02586916
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

31 May 2023 Diag: Bill Quesnel

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



27 Jan 2023 Diag: Kevin Marson

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Oil Cleanliness are abnormally high. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Particles >14µm are notably high. Particles >21µm are notably high. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



14 Dec 2022 Diag: Kevin Marson

ISO



We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. All component wear rates are normal. Oil Cleanliness are abnormally high. Particles >14µm are abnormally high. Particles >21µm are abnormally high. Particles >4µm are abnormally high. Particles >6µm are abnormally high. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

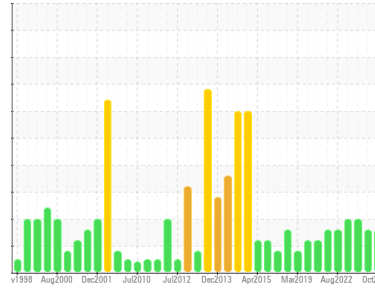

ISO



Area
PUMPHOUSE/BOOSTER RAW WATER PUMPS
 Machine Id
C - Booster Raw Water Pump Gearbox Oil System

Component
Lube System
 Fluid
PETRO CANADA HYDREX AW 100 (45 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0866308	WC0824393	WC0785657
Sample Date	Client Info		04 Oct 2023	31 May 2023	27 Jan 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*	>DFLT	0	0	0
Iron	ppm	ASTM D5185(m) >20	<1	<1	2
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	0	0	0
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	<1	0	0
Aluminum	ppm	ASTM D5185(m) >20	0	0	<1
Lead	ppm	ASTM D5185(m) >20	<1	1	<1
Copper	ppm	ASTM D5185(m) >20	2	<1	4
Tin	ppm	ASTM D5185(m) >20	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES






	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<1	0	<1
Barium	ppm	ASTM D5185(m) 0	<1	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m) 0	0	0	0
Magnesium	ppm	ASTM D5185(m) 0	0	<1	0
Calcium	ppm	ASTM D5185(m) 50	36	43	12
Phosphorus	ppm	ASTM D5185(m) 330	319	366	339
Zinc	ppm	ASTM D5185(m) 430	415	419	345
Sulfur	ppm	ASTM D5185(m) 760	2616	2749	6852
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	4	4	<1
Sodium	ppm	ASTM D5185(m)	<1	<1	<1
Potassium	ppm	ASTM D5185(m) >20	0	0	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 16456	▲ 37111	▲ 14742
Particles >6µm	ASTM D7647	>1300	▲ 4414	▲ 7635	▲ 3779
Particles >14µm	ASTM D7647	>160	▲ 234	▲ 181	▲ 276
Particles >21µm	ASTM D7647	>40	44	32	▲ 71
Particles >38µm	ASTM D7647	>10	1	0	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/15	▲ 22/20/15	▲ 21/19/15

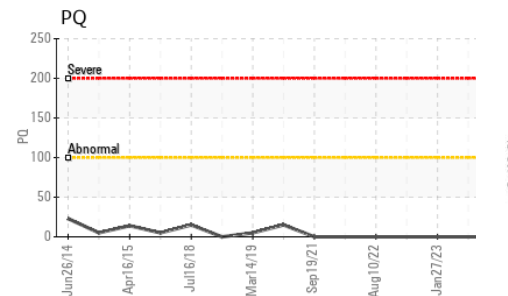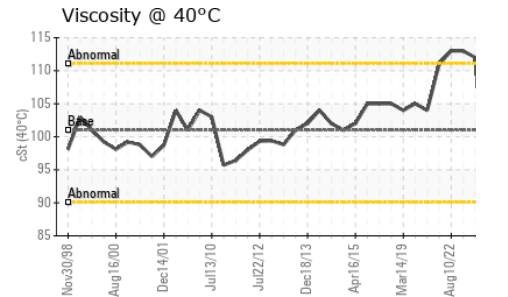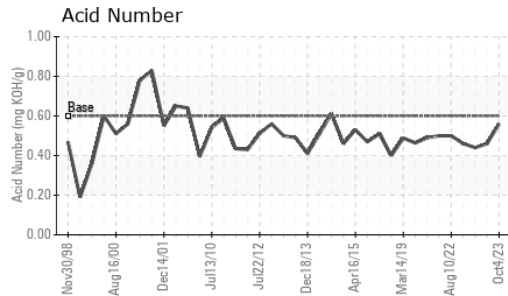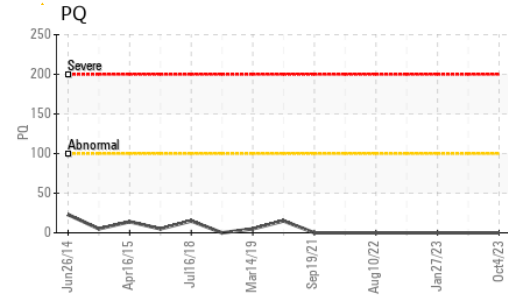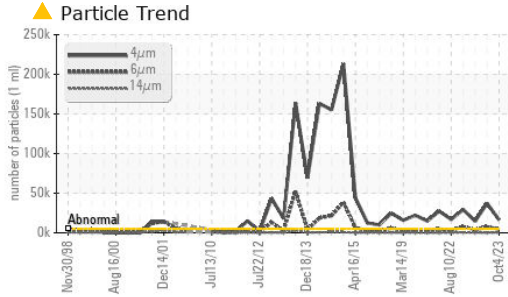


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.60	0.56	0.46	0.44






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	VLITE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	MILKY	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>5	NEG	.5%	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	101	93.7	93.2	112

SAMPLE IMAGES

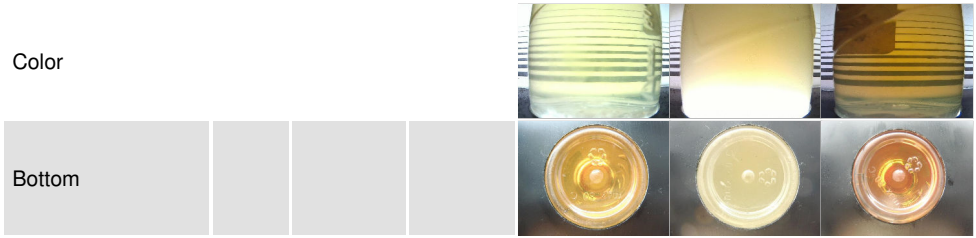

GRAPHS

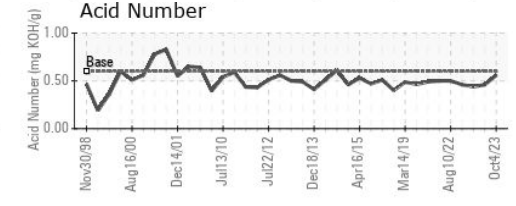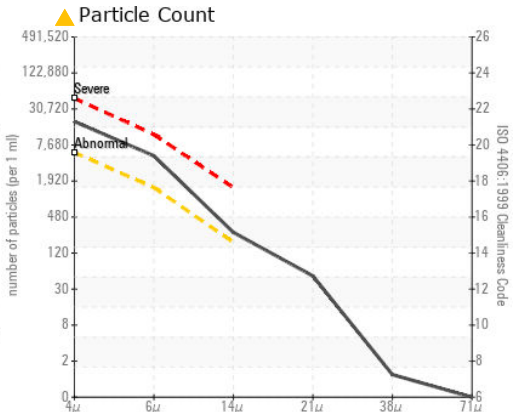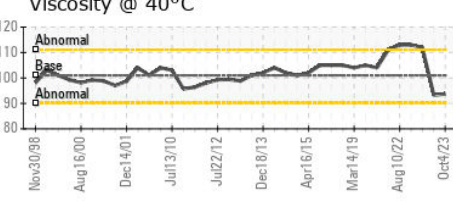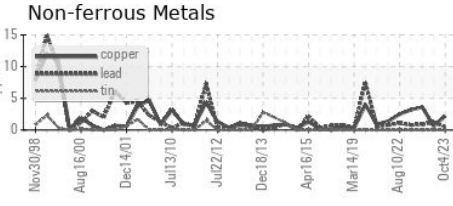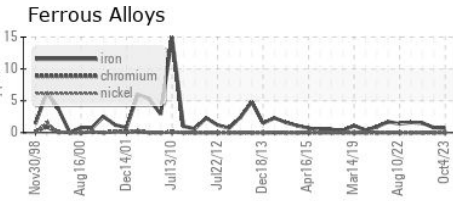

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **STELCO - BOSC - Basic Oxygen Slab Caster**
Sample No. : WC0866308 **Received** : 04 Oct 2023 2330 Regional Road #3, Door: BOSC8
Lab Number : 02586916 **Diagnosed** : 05 Oct 2023 NANTICOKE, ON
Unique Number : 5655982 **Diagnostician** : Wes Davis CA N0A 1L0
Test Package : IND 2 (Additional Tests: PQ, TAN Man)
 Contact: Tom Walden
 Thomas.Walden@stelco.com
 T: (519)587-4541
 F: (519)587-7702