


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

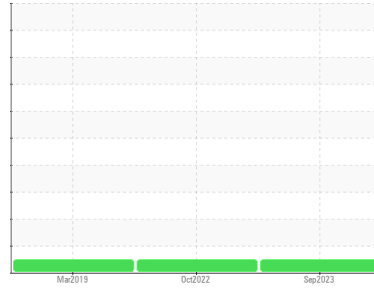

Area  
**OLIN CHLOR PLAN [6100196804]**  
Machine Id  
**DETROIT 8063-7405**

Component  
**Diesel Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0020076</b>	WA0018626	WA0013766
Sample Date	Client Info			<b>27 Sep 2023</b>	14 Oct 2022	27 Mar 2019
Machine Age	hrs	Client Info		<b>1177</b>	1165	1144
Oil Age	hrs	Client Info		<b>12</b>	1	0
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>3.0		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>200	<b>1</b>	1	6
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>30	<b>&lt;1</b>	1	1
Lead	ppm	ASTM D5185(m)	>30	<b>&lt;1</b>	<1	1
Copper	ppm	ASTM D5185(m)	>30	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	<1


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	<b>2</b>	4	84
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	100	<b>112</b>	113	33
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185(m)	450	<b>14</b>	32	609
Calcium	ppm	ASTM D5185(m)	3000	<b>2566</b>	2853	1372
Phosphorus	ppm	ASTM D5185(m)	1150	<b>992</b>	1107	924
Zinc	ppm	ASTM D5185(m)	1350	<b>1104</b>	1174	1074
Sulfur	ppm	ASTM D5185(m)	4250	<b>2693</b>	2866	3417
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>30	<b>3</b>	3	5
Sodium	ppm	ASTM D5185(m)	>158	<b>3</b>	3	4
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	<1	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>3.3</b>	3.5	6.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>13.2</b>	14.0	18.1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>6.0</b>	6.7	13.5









# OIL ANALYSIS REPORT

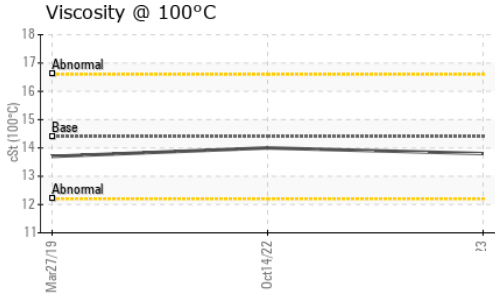

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.8	14.0

## GRAPHS

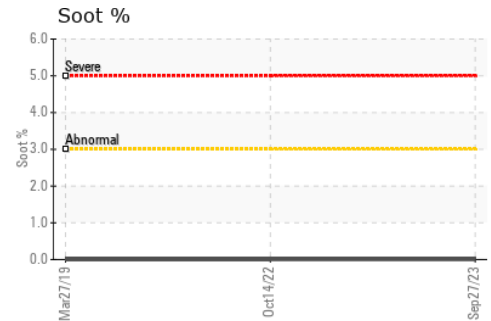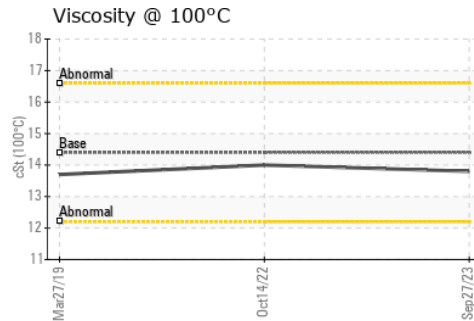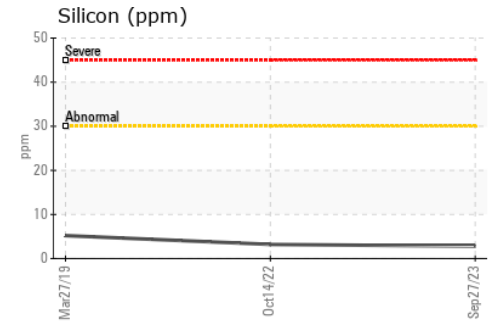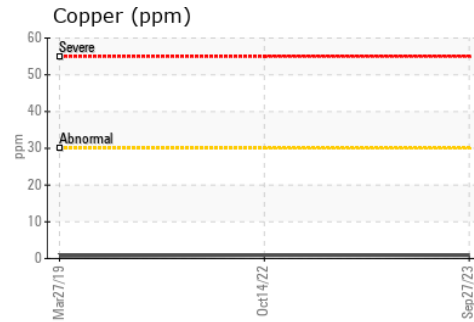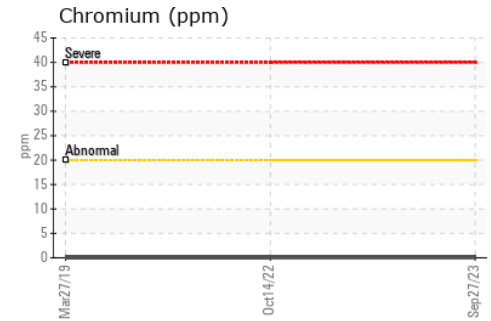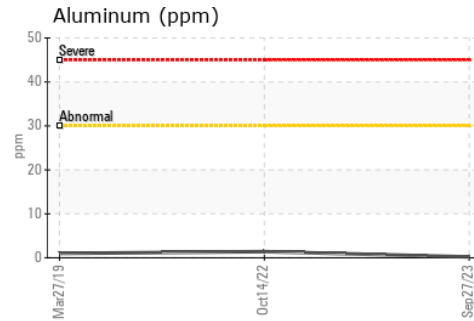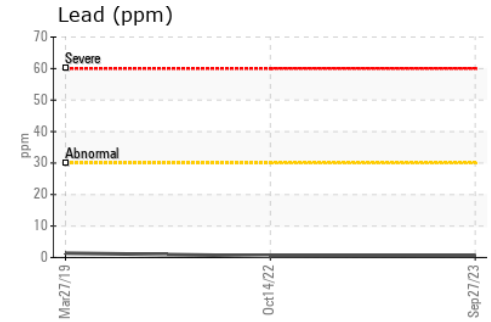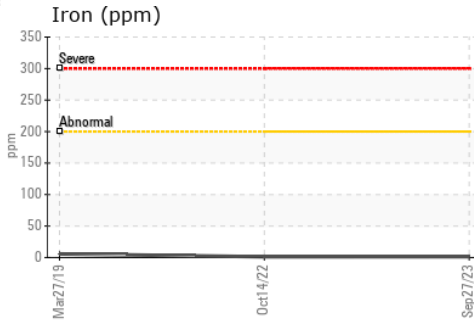

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020076 **Received** : 05 Oct 2023  
**Lab Number** : 02586988 **Diagnosed** : 05 Oct 2023  
**Unique Number** : 5656054 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

**Wajax Power Systems**  
 485 VENTURE DR  
 MONCTON, NB  
 CA E1H 2P4  
 Contact: Doug Balsler  
 dbalsler@wajax.com  
 T: (506)855-5371  
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.