

# OIL ANALYSIS REPORT


Sample Rating Trend

**NORMAL**



Area  
**SOUTH EAST HEALTHCARE [6100196754]**  
Machine Id  
**4729202880**

Component  
**Diesel Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

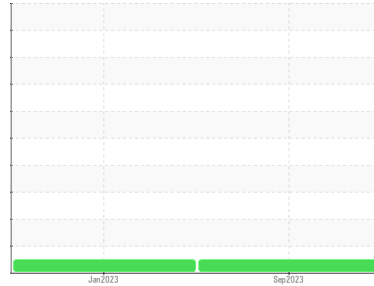

## DIAGNOSIS

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
Metal levels are typical for a new component breaking in.

**Contamination**  
There is no indication of any contamination in the oil.

**Fluid Condition**  
The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0020261</b>	WA0019350	---
Sample Date	Client Info			<b>28 Sep 2023</b>	27 Jan 2023	---
Machine Age	hrs Client Info			<b>285</b>	271	---
Oil Age	hrs Client Info			<b>14</b>	271	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>3</b>	13	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	1	---
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	<1	---
Silver	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	2	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	<1	---
Copper	ppm	ASTM D5185(m)	>330	<b>1</b>	11	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	<b>7</b>	37	---
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	<1	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>60</b>	58	---
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	6	---
Magnesium	ppm	ASTM D5185(m)	450	<b>968</b>	1058	---
Calcium	ppm	ASTM D5185(m)	3000	<b>1023</b>	878	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>1001</b>	1070	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1168</b>	1136	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2672</b>	3450	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	14	---
Sodium	ppm	ASTM D5185(m)	>158	<b>2</b>	9	---
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	2	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.0</b>	10.1	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>18.1</b>	21.9	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.1</b>	21.1	---









# OIL ANALYSIS REPORT

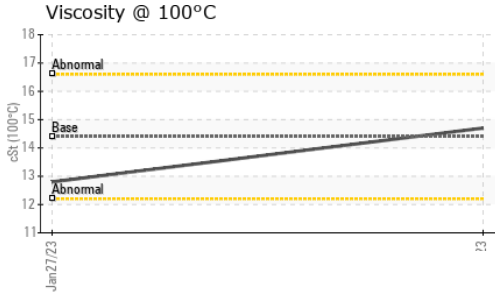

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>14.7</b>	12.8

## GRAPHS

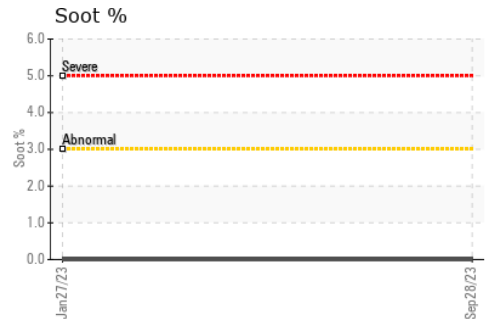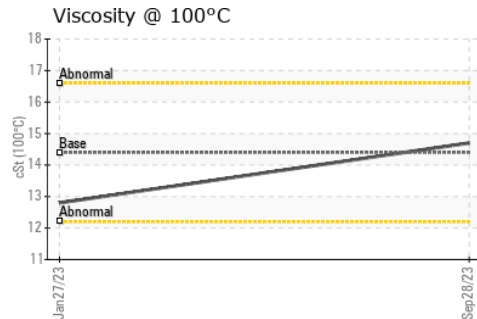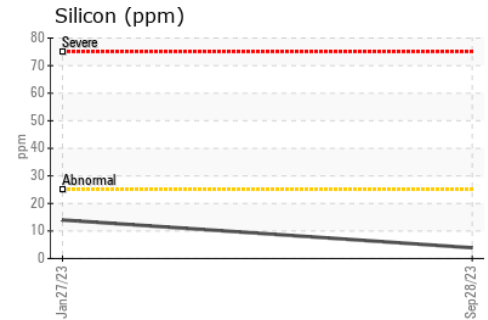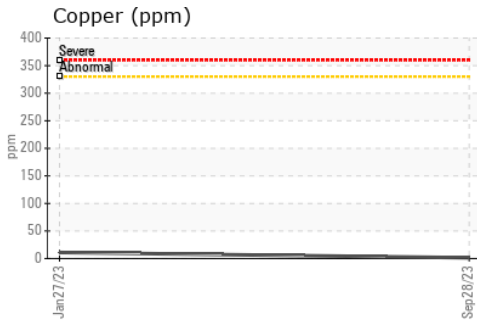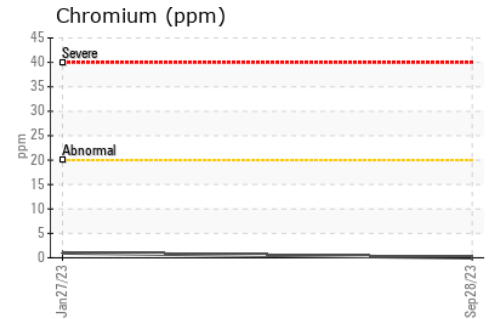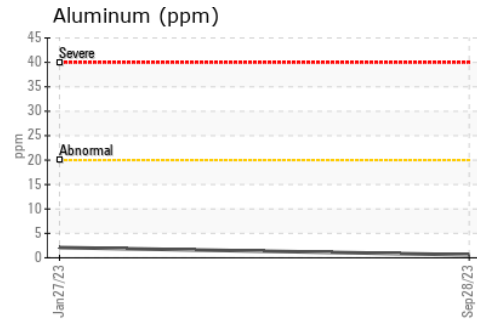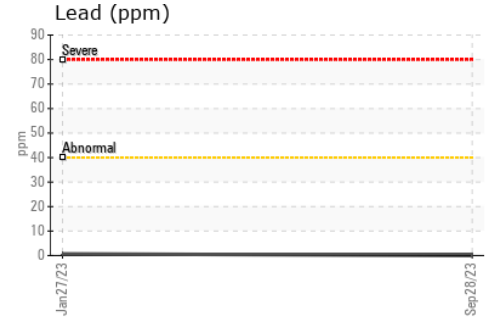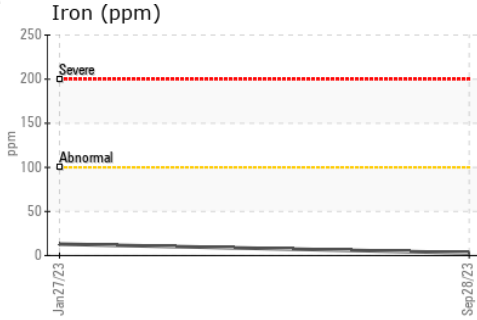

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020261 **Received** : 05 Oct 2023  
**Lab Number** : 02586990 **Diagnosed** : 05 Oct 2023  
**Unique Number** : 5656056 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

**Wajax Power Systems**  
 485 VENTURE DR  
 MONCTON, NB  
 CA E1H 2P4  
 Contact: Doug Balsler  
 dbalsler@wajax.com  
 T: (506)855-5371  
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.