

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
SHEDIAC LOBSTER [6100202173]
Machine Id
T04239T222214

Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
Metal levels are typical for a new component breaking in.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WA0020660	---	---
Sample Date	Client Info		25 Sep 2023	---	---
Machine Age	hrs Client Info		916	---	---
Oil Age	hrs Client Info		0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			NORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>2.1	<1.0	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m)	>51	6	---	---
Chromium	ppm ASTM D5185(m)	>11	0	---	---
Nickel	ppm ASTM D5185(m)	>5	<1	---	---
Titanium	ppm ASTM D5185(m)		0	---	---
Silver	ppm ASTM D5185(m)	>3	<1	---	---
Aluminum	ppm ASTM D5185(m)	>31	<1	---	---
Lead	ppm ASTM D5185(m)	>26	<1	---	---
Copper	ppm ASTM D5185(m)	>26	<1	---	---
Tin	ppm ASTM D5185(m)	>4	0	---	---
Antimony	ppm ASTM D5185(m)		0	---	---
Vanadium	ppm ASTM D5185(m)		0	---	---
Beryllium	ppm ASTM D5185(m)		0	---	---
Cadmium	ppm ASTM D5185(m)		0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	250	172	---	---
Barium	ppm ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm ASTM D5185(m)	100	1	---	---
Manganese	ppm ASTM D5185(m)		0	---	---
Magnesium	ppm ASTM D5185(m)	450	36	---	---
Calcium	ppm ASTM D5185(m)	3000	2268	---	---
Phosphorus	ppm ASTM D5185(m)	1150	983	---	---
Zinc	ppm ASTM D5185(m)	1350	1164	---	---
Sulfur	ppm ASTM D5185(m)	4250	3029	---	---
Lithium	ppm ASTM D5185(m)		<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	>22	2	---	---
Sodium	ppm ASTM D5185(m)	>158	3	---	---
Potassium	ppm ASTM D5185(m)	>20	7	---	---


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	% ASTM D7844*	>3	0	---	---
Nitration	Abs/cm ASTM D7624*	>20	6.3	---	---
Sulfation	Abs/.1mm ASTM D7415*	>30	20.4	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*	>25	16.3	---	---









OIL ANALYSIS REPORT

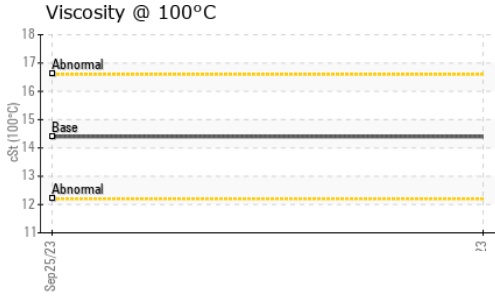

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.21	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.4	---

GRAPHS

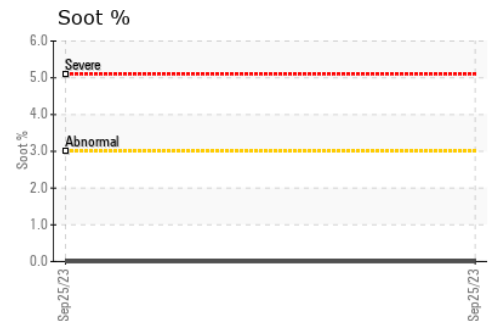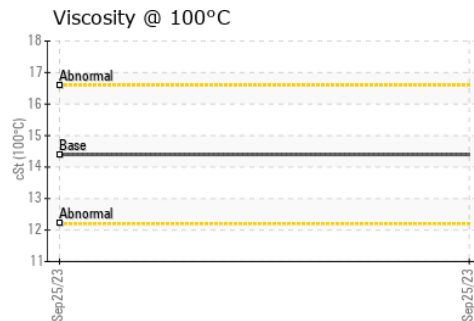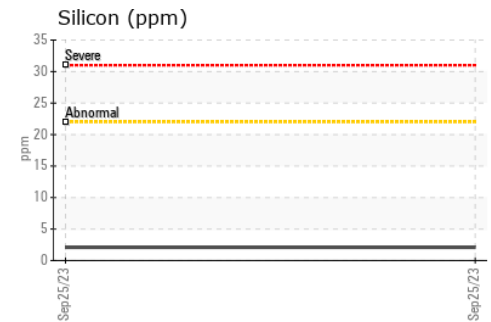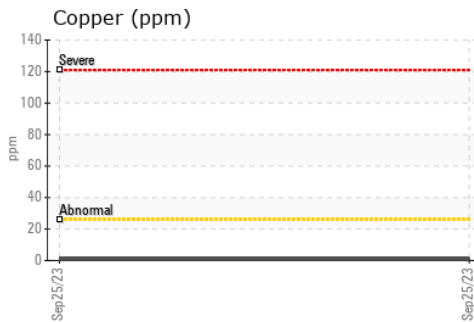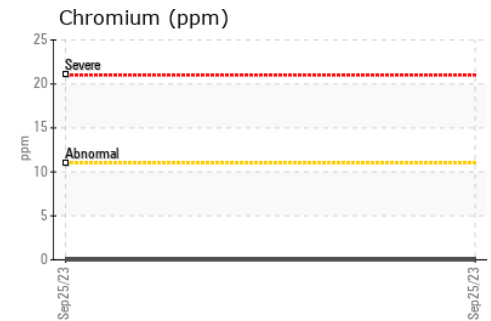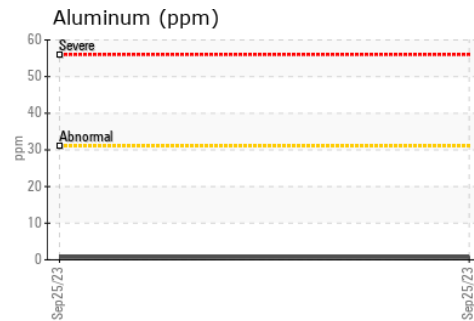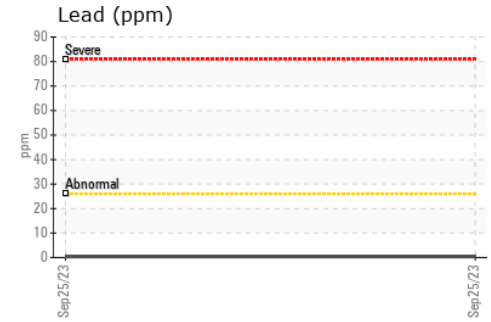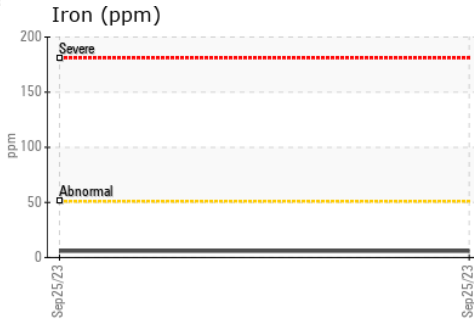

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020660 **Received** : 05 Oct 2023
Lab Number : 02586991 **Diagnosed** : 05 Oct 2023
Unique Number : 5656057 **Diagnostician** : Wes Davis
Test Package : MOB 1

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: M Cormier
 mcormier@wajax.com
 T: (902)496-5467
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.